


PLAN VIEW

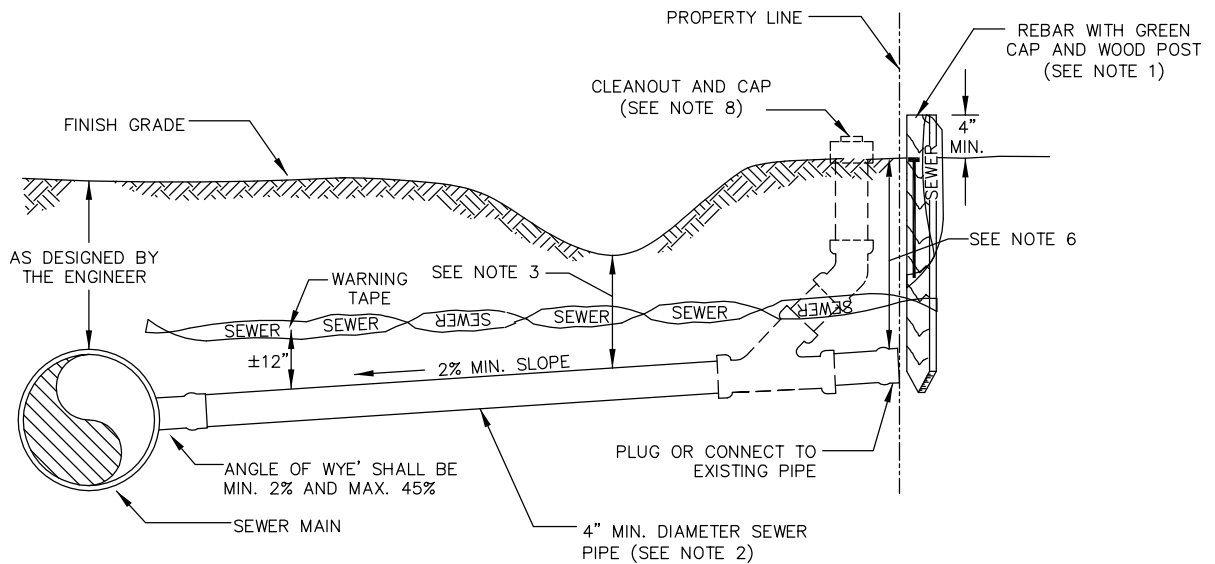

ELEVATION VIEW

NOTES:

1. MARK SERVICE WITH GREEN PAINTED 2"x4" POST OR STAMP "S" IN TOP OF CURB. POST SHALL EXTEND TO DEPTH OF SERVICE LATERAL. REBAR W/CAP SHALL BE DRIVEN TO GROUND LEVEL. EXTEND WARNING TAPE TO TOP OF POST AND STAPLE IN PLACE.
2. ACCEPTABLE PIPE FOR USE WITHIN R.O.W. INCLUDES C900 PVC, SDR 35 PVC AND DUCTILE IRON.
3. MINIMUM CLEARANCE OF 18" REQUIRED BENEATH EXISTING DITCH LINE. PIPE WITH LESS THAN 44" OF COVER SHALL BE INSULATED AS APPROVED BY THE ENGINEER.
4. DISTANCE FROM WYE TO MANHOLE AND TWO MEASURED DISTANCES FROM END OF SERVICE PIPE TO PERMANENT OBJECTS SHALL BE NOTED ON AS-BUILT PLANS.
5. SERVICE LATERAL SHALL END AT THE PROPERTY LINE WITH A BELL AT THE END OF PIPE.
6. LATERAL DEPTH AT PROPERTY LINE SHALL ACCOMMODATE EXISTING BUILDING SEWER OR FUTURE BUILDING SITE(S).
7. PIPE CONNECTIONS IN THE RIGHT-OF-WAY THAT DO NOT USE BELL AND SPIGOT SHALL CONFORM TO STANDARD 218.
8. CLEANOUT MAY BE REQUIRED AT THE DIRECTION OF THE ENGINEER.

SCALE: NTS	DATE: 12/2/96	CITY AND BOROUGH OF JUNEAU, ALASKA SANITARY SEWER SERVICE LATERAL	
DRAWN BY: DRW	CHECKED BY: STAFF		
APPROVED BY: <i>DRW</i>	REVISED: 8/14/2011	STANDARD 213	