


36"W X 48"H X 12"D (MIN DIMENSIONS) NEMA 4X STAINLESS STEEL ENCLOSURE.
 PROVIDE WITH VENTILATION GRILLS AND FAN IF HEAT LOAD CALCULATIONS REQUIRE.

INTERIOR ELEVATION - PUMP PANEL
 NO SCALE

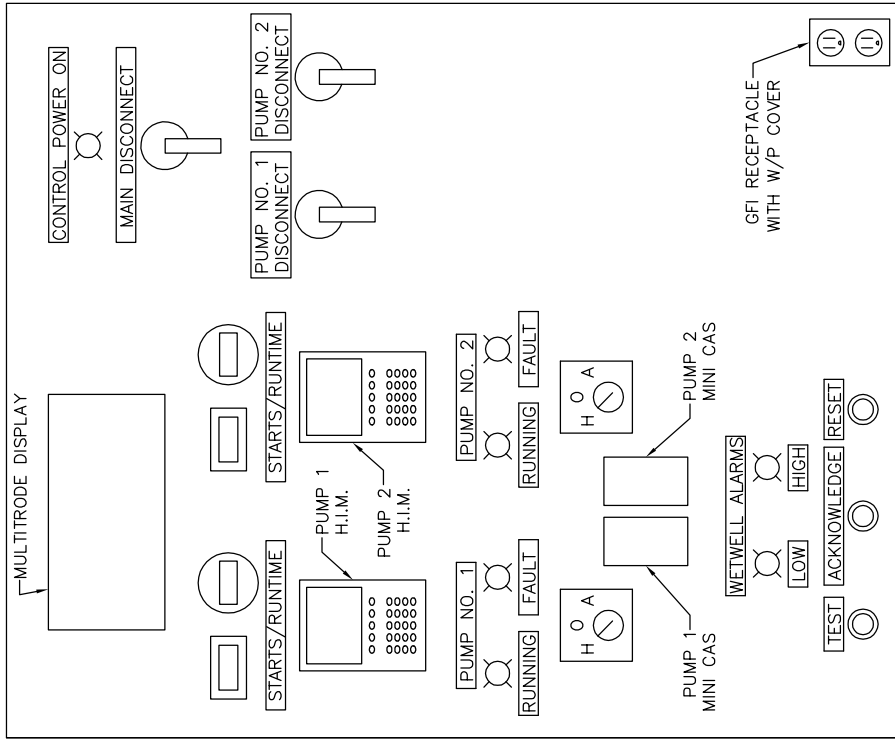

DOOR ELEVATION - PUMP PANEL
 NO SCALE

NOTES:

- SEE SHEET 220-10 FOR THE CONTROL LEGEND.
- ALL PANEL ALARM INDICATOR LIGHTS SHALL HAVE PUSH-TO-TEST LIGHTS MOUNTED ON THE PANEL DOOR.
- THE MAIN DISCONNECT AND PUMP DISCONNECTS SHALL CONSIST OF FUSES AND DISCONNECT SWITCHES NOT CIRCUIT BREAKERS. THE MAIN DISCONNECT SHALL DISCONNECT POWER INSIDE PANEL WHEN THE DOOR OPENS.
- ALL RELAYS SHALL BE INDUSTRIAL CONTROL RELAYS. ALLEN BRADLEY BULLETIN "700" SERIES OR EQUAL. PROVIDE WITH NUMBER OF AUX CONTACTS AS REQUIRED (MIN. OF 2).
- ALL INDICATING LIGHTS SHALL BE 30MM NEMA 4X OIL TIGHT/WATER TIGHT/CORROSION RESISTANT PUSH-TO-TEST LED TYPE. PROVIDE ALLEN BRADLEY BULLETIN "800" SERIES OR EQUAL.
- ALL SELECTOR SWITCHES SHALL BE 30MM NEMA 4X OIL TIGHT/WATER TIGHT/CORROSION RESISTANT TYPE WITH GLOVED HAND KNOBS. PROVIDE ALLEN BRADLEY BULLETIN "800" SERIES OR EQUAL.
- THE NUMBER OF STARTS COUNTER SHALL BE A RED LION P/N CUB30000 OR EQUAL. THE RUN TIME COUNTER SHALL BE AN ETM P/N FWZ72 OR EQUAL.

SCALE: NTS	DATE: 1/18/00	CITY AND BOROUGH OF JUNEAU, ALASKA	
DRAWN BY: STAFF	CHECKED BY: JB/STAFF	PUMP STATION	
APPROVED BY: <i>DRWA</i>	REVISED: 8/14/2011	PUMP PANEL DOOR ELEVATION	
		STANDARD 220-7	