


SECTION A-A

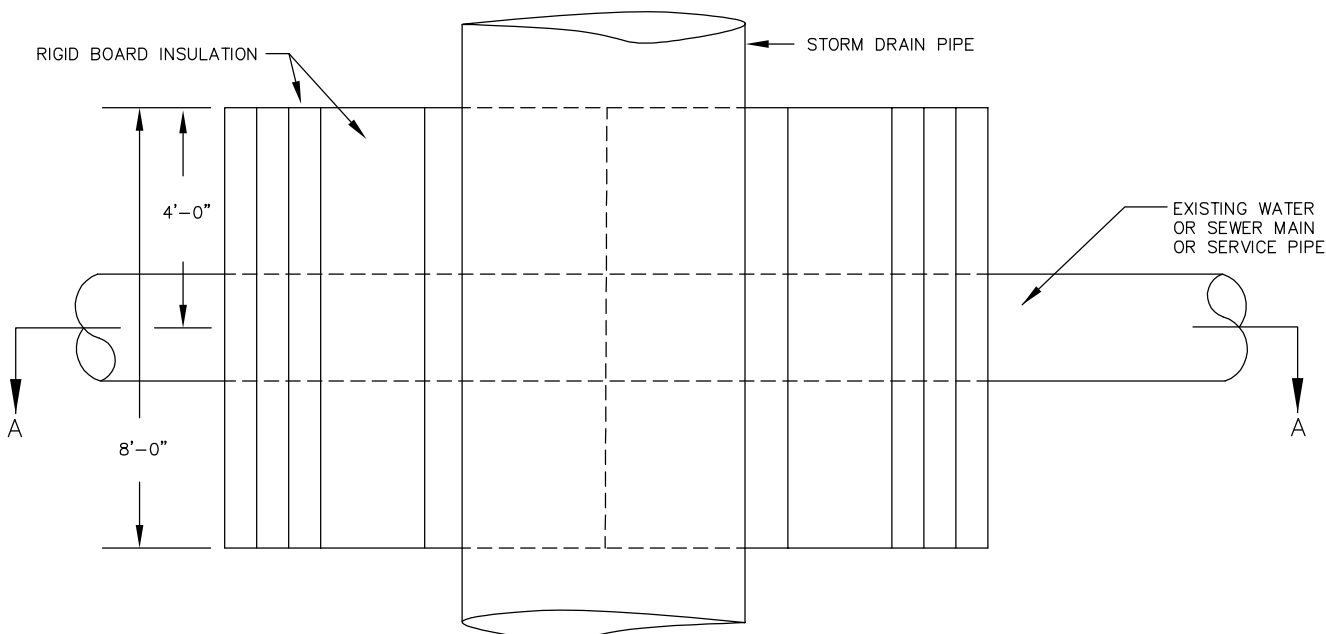

PLAN VIEW

NOTES

1. INSTALL INSULATION AS SHOWN WHEN "D" IS LESS THAN 5'-0" FOR WATER PIPE OR 3'8" FOR SEWER PIPE.
2. INSULATION SHALL CONFORM TO SECTION Q2607 OF THE STANDARD SPECIFICATIONS.
3. PIPE INSULATION SHALL BE 8'-0" IN LENGTH, CENTERED OVER EXISTING WATER OR SEWER PIPE.
4. PIPE INSULATION WITH R-FACTOR EQUAL TO RIGID BOARD MAY BE SUBSTITUTED IF APPROVED BY THE ENGINEER.
5. CROSSING SHALL BE PROTECTED WITH A MINIMUM 6" OF INSULATION BOARDS WITH A 12" OVER LAP AS SHOWN.

SCALE: NTS	DATE: 7/5/95	CITY AND BOROUGH OF JUNEAU, ALASKA	
DRAWN BY: DRW	CHECKED BY: STAFF	RIGID INSULATION	
APPROVED BY: <i>DRW</i>	REVISED: 8/14/2011	STANDARD 412	