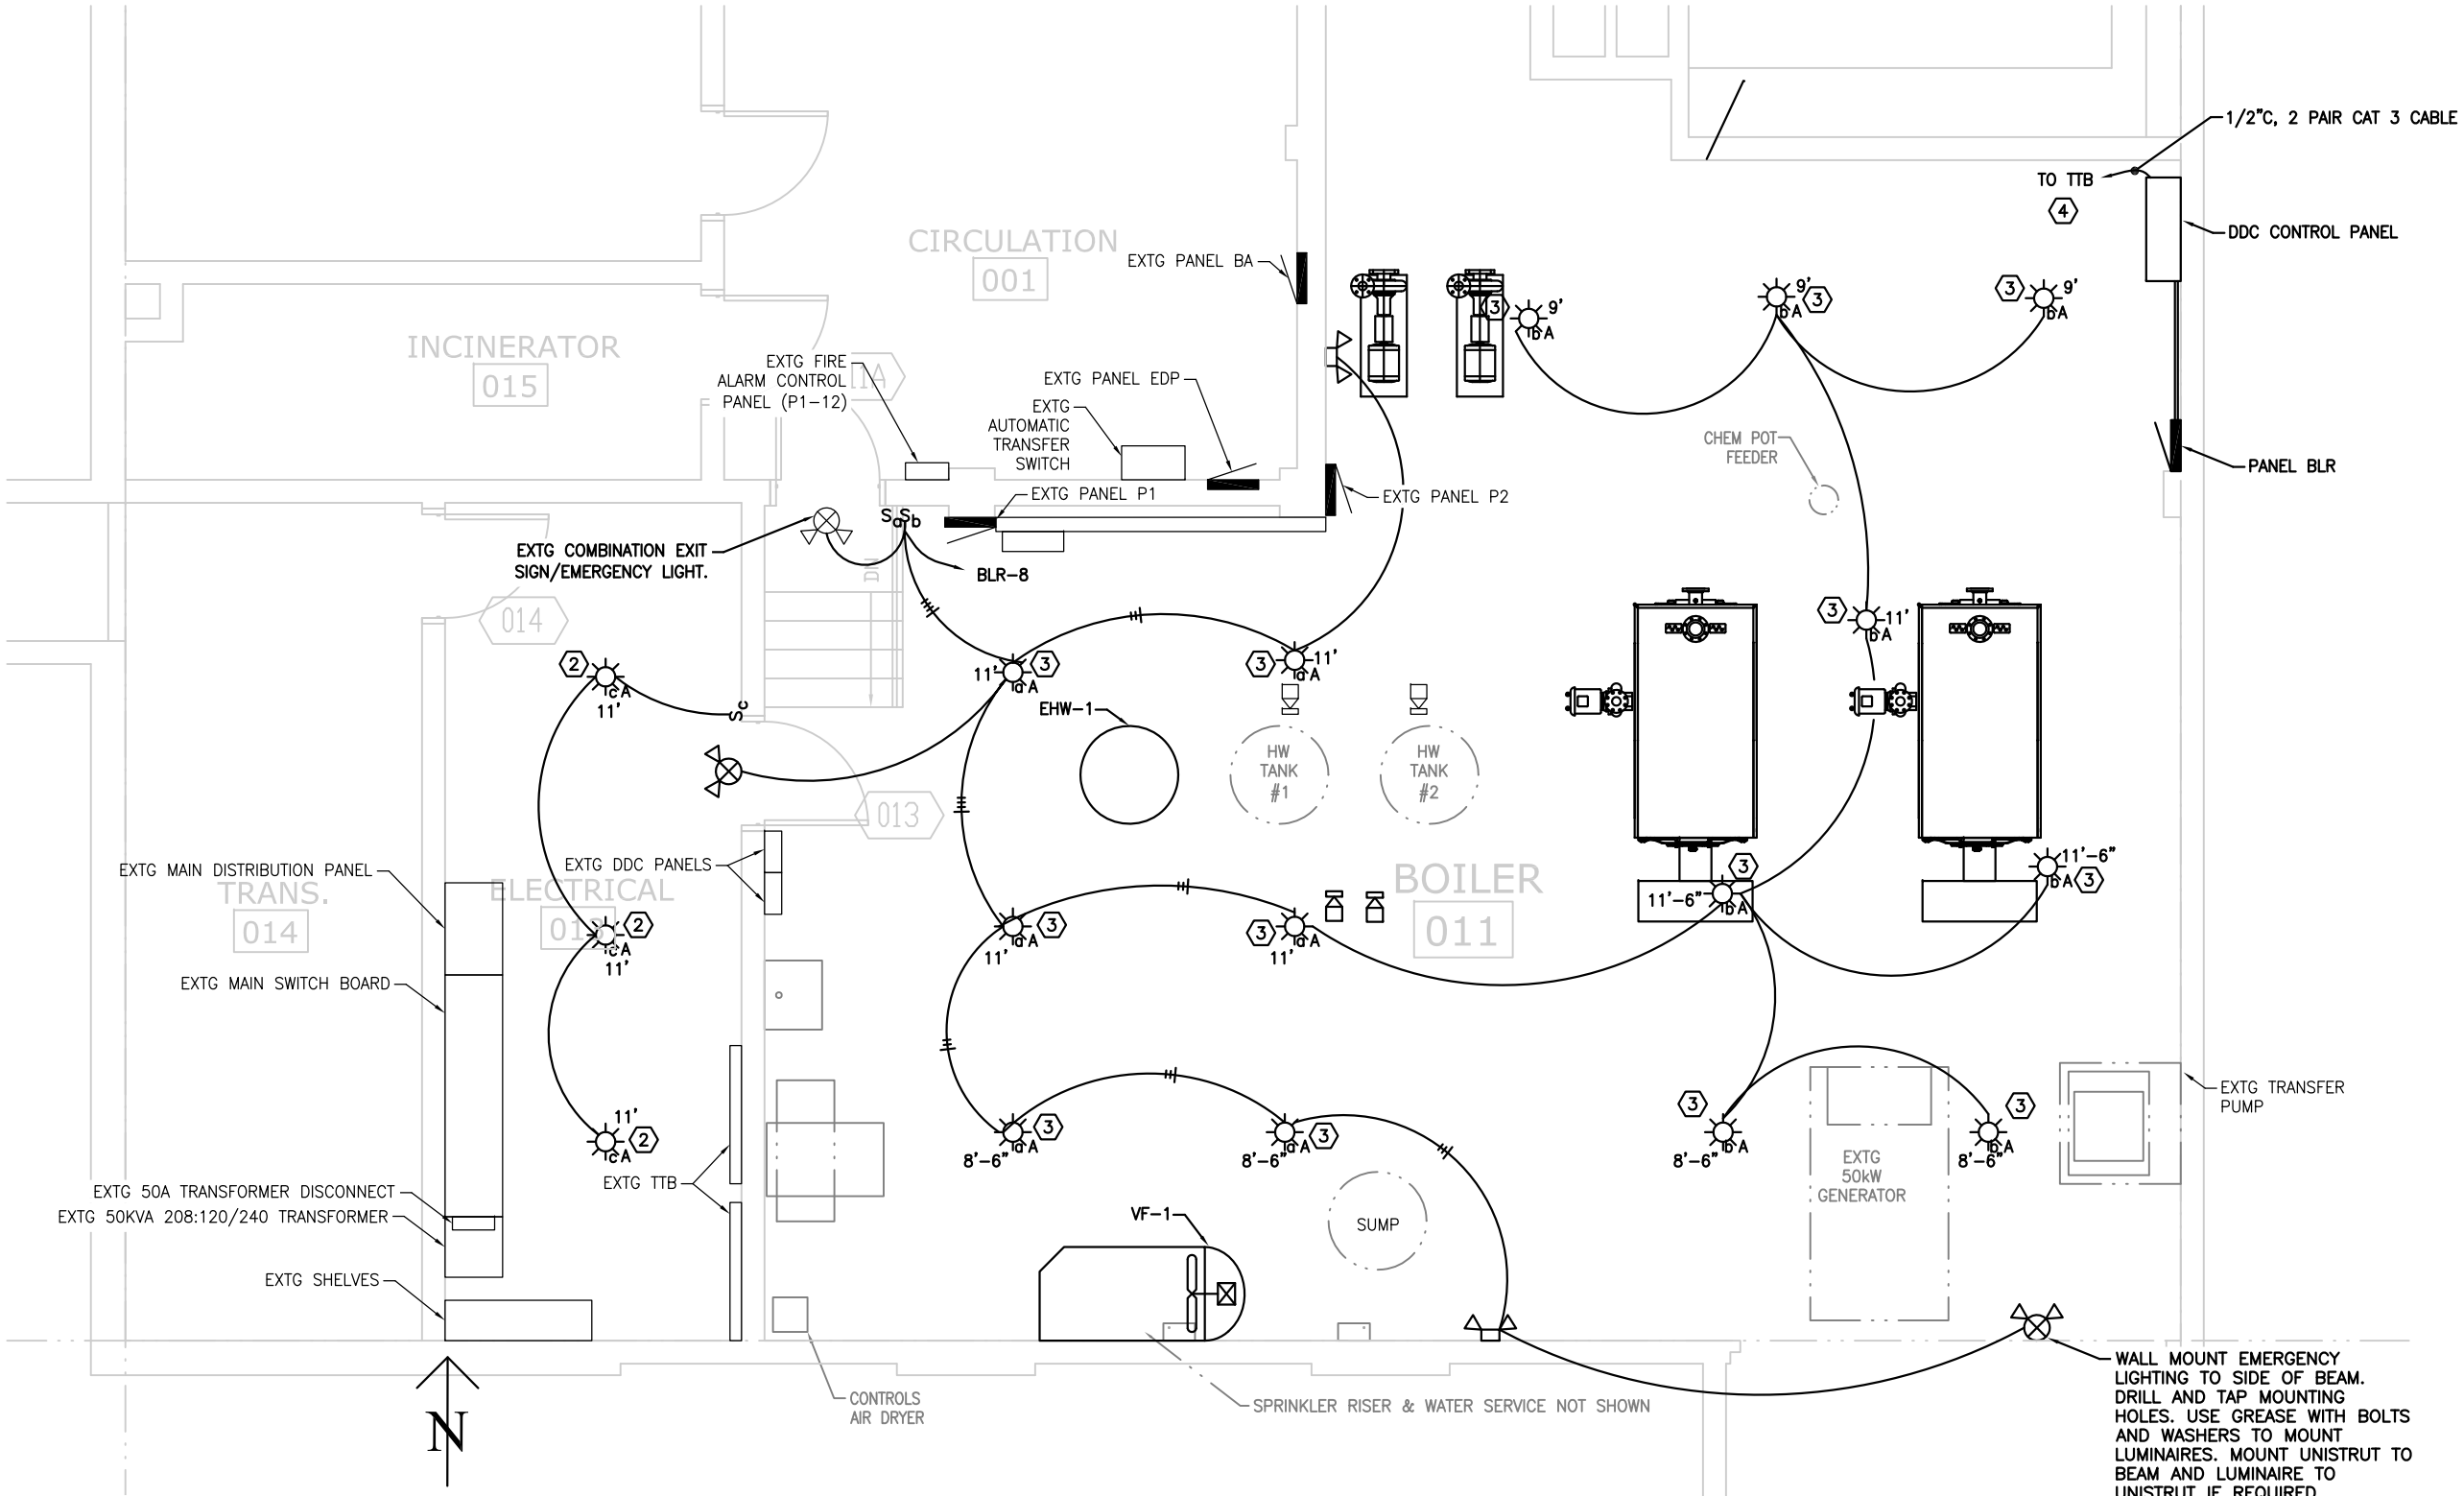

NOTES:

1. THERE IS A LOT OF EXISTING PIPING BELOW THE CEILING. WHERE ACCESS TO CEILING IS BLOCKED, PROVIDE UNISTRUT RACKS BELOW PIPING TO SECURE CONDUIT FROM SUPPORT RACKS ON ALL THREAD ROD SECURED TO CEILING.

(2) PROVIDE NEW TYPE A LUMINAIRES. POWER FROM EXISTING LIGHTING CIRCUIT.

(3) PROVIDE NEW TYPE A LUMINAIRE. PENDANT MOUNT AT HEIGHT SHOWN TO TOP OF LUMINAIRE. ADJUST LOCATION TO AVOID EXISTING AND NEW PIPING, MECHANICAL EQUIPMENT, CONDUIT, ETC. PROVIDE NEW CONDUIT AND WIRING. CEILING HEIGHT IS 12'-8" NOMINAL.

(4) PROVIDE A DEDICATED TELEPHONE LINE TO THE DDC PANEL. COORDINATE WITH TELEPHONE UTILITY ACS AS REQUIRED TO ESTABLISH A TELEPHONE NUMBER AND DIAL TONE. COORDINATE WITH CONTROL CONTRACTOR TO TERMINATE IPR IN DDC PANEL. PROVIDE RJ11 RECEPTACLE IN J-BOX IF NECESSARY.

LIGHTING & SIGNAL PLAN

SCALE: 0 2' 4' 8'
SCALE = 3/16"=1' ON 11" X 17" PAPER

MORRIS ENGINEERING GROUP, LLC
8429 LIVINGSTON WAY
JUNEAU, ALASKA 99801
phone 907-789-3350
fax 907-789-3360

STATE OF ALASKA 49TH
Mark G. Morris
Feb 15, 2010
No. EE 8613
REGISTERED PROFESSIONAL ENGINEER

MARIE DRAKE SCHOOL
BOILER ROOM UPGRADES
CBJ Contract No. E10-203
JUNEAU, ALASKA

SHEET TITLE: LIGHTING & SIGNAL PLAN

DATE: FEB. 15, 2010
REVISION: ---
CHECKED BY: MGM
DRAWN: MHW

SHEET # E3.1