


DETAIL 2 - DRAIN PIPE

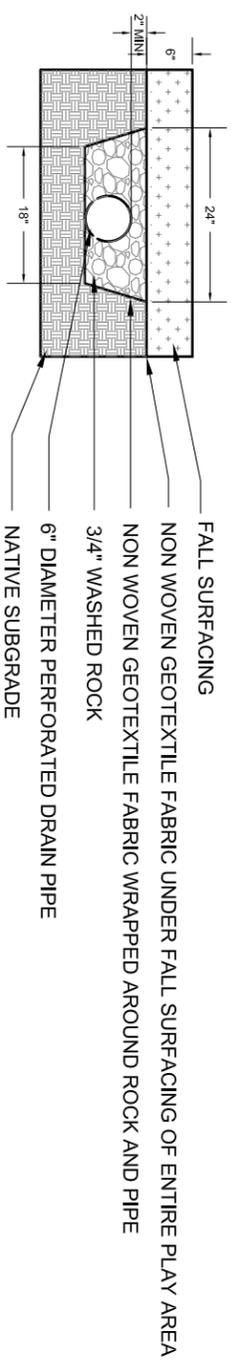


- FALL SURFACING
- NON WOVEN GEOTEXTILE FABRIC UNDER FALL SURFACING OF ENTIRE PLAY AREA
- NON WOVEN GEOTEXTILE FABRIC WRAPPED AROUND ROCK AND PIPE
- 3/4" WASHED ROCK
- 6" DIAMETER PERFORATED DRAIN PIPE
- NATIVE SUBGRADE

NTS

- NOTE:
1. ALL NON WOVEN GEOTEXTILE FABRIC SHALL BE SECURED AROUND ENTIRE PERIMETER OF PLAYGROUND AS SHOWN WITH 2X4 LEDGER. ALL SEAMS (INCLUDING SEAMS FOR POST CUTS) SHALL OVERLAP A MINIMUM OF 6" AND BE ADHERED WITH NON TOXIC CARPET TAPE AND HOT GLUE METHOD.
 2. ALL EDGES AND SURFACES IN PLAY AREA SHALL BE SMOOTH AND FREE FROM SHARP EDGES.
 3. THE FENCE PICKETS AND POST SHALL HAVE NO SPACING GREATER THAN 4" BETWEEN ANY PART OF THE TIMBERS.
 4. FENCE MEMBERS SHALL BE PAINTED WITH BEHR PREMIUM PLUS ULTRA EXTERIOR SEMI GLOSS WHITE OR APPROVED EQUAL. CUT ENDS OF PICKETS SHALL BE PAINTED. APPLY A MINIMUM OF 2 APPLICATIONS AND MORE AS NEEDED TO MATCH THE COLOR OF THE PAINTED PICKETS.
 5. COUNTERSINK ALL FASTENERS IN FENCE, FILL HOLE AND PAINT.


DETAIL 3 - FENCE POST

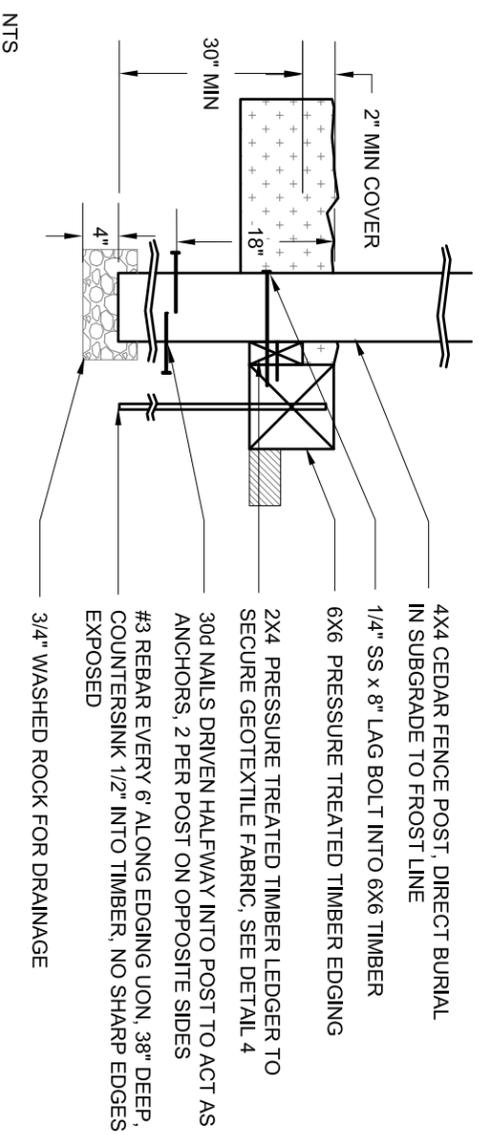

- 4X4 CEDAR FENCE POST, DIRECT BURIAL IN SUBGRADE TO FROST LINE
- 1/4" SS x 8" LAG BOLT INTO 6X6 TIMBER
- 6X6 PRESSURE TREATED TIMBER EDGING
- 2X4 PRESSURE TREATED TIMBER LEDGER TO SECURE GEOTEXTILE FABRIC, SEE DETAIL 4
- 30d NAILS DRIVEN HALFWAY INTO POST TO ACT AS ANCHORS, 2 PER POST ON OPPOSITE SIDES
- #3 REBAR EVERY 6" ALONG EDGING UN, 38" DEEP, COUNTERSINK 1/2" INTO TIMBER, NO SHARP EDGES EXPOSED
- 3/4" WASHED ROCK FOR DRAINAGE

NTS


DETAIL 5 - ADDITIVE ALTERNATE - FENCE CONSTRUCTION

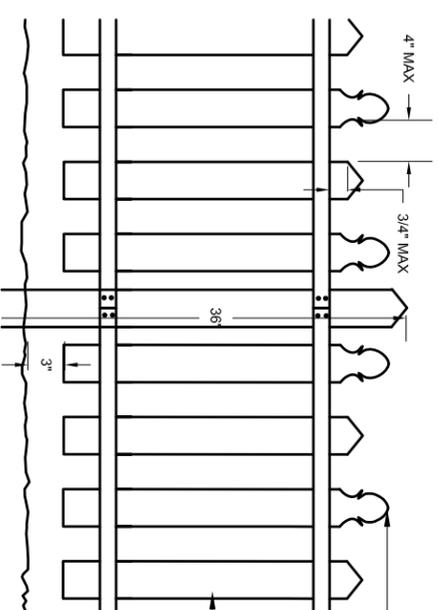

- PICKETS NOT DRAWN TO SCALE. ALTERNATE STYLES WITH BULB STYLE ADJACENT TO EACH POST, MAINTAIN RELATIVE HEIGHTS WITH BOTTOM OF PICKETS CONSISTENT AT 3" ABOVE FALL SURFACING
- 2X4 CLEAR CEDAR RAILS FASTENED TO POSTS WITH SS SCREWS
- CEDAR PICKETS FASTENED TO RAILS WITH SS SCREWS, 2 PER EACH RAIL CONNECTION

NTS

DETAIL 4- GEOTEXTILE FABRIC

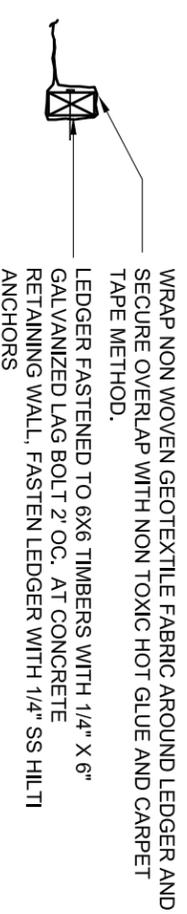

- WRAP NON WOVEN GEOTEXTILE FABRIC AROUND LEDGER AND SECURE OVERLAP WITH NON TOXIC HOT GLUE AND CARPET TAPE METHOD.
- LEDGER FASTENED TO 6X6 TIMBERS WITH 1/4" X 6" GALVANIZED LAG BOLT 2' OC. AT CONCRETE RETAINING WALL, FASTEN LEDGER WITH 1/4" SS HILTI ANCHORS

NTS

CAPITOL PLAYGROUND TOT AREA

CITY/BOROUGH OF JUNEAU Alaska's Capital City

Sheet Title:

Details

Project Manager: M. Eifers

Date:
November 12, 2010

Do not scale from this drawing, use dimensions

Sheet #:

2 of 2