



## ADDENDUM TO THE CONTRACT

for the

### Second Street Reconstruction Contract No. E11-152

**ADDENDUM NO.:** ONE

**CURRENT DEADLINE FOR BIDS:**  
February 23, 2011

**PREVIOUS ADDENDA:** NONE

**ISSUED BY:** City and Borough of Juneau  
ENGINEERING DEPARTMENT  
155 South Seward Street  
Juneau, Alaska 99801

**PREVIOUS DEADLINE FOR BIDS:**  
February 22, 2011

**DATE ADDENDUM ISSUED:** February 17, 2011

The following items of the contract are modified as herein indicated. All other items remain the same. This addendum has been issued and is posted online. Please refer to the CBJ Engineering Contracts Division webpage at: <http://www.juneau.org/engineering ftp/contracts/Contracts.php>

### **PROJECT MANUAL:**

Item No. 1 SECTION 00030 - NOTICE INVITING BIDS. DEADLINE FOR BIDS.

**Change** the date of the Deadline for Bids **from** February 22, 2011 **to** February 23, 2011. The time remains the same.


### **SPECIAL PROVISIONS:**

Item No. 1 SECTION 01025 – MEASUREMENT AND PAYMENT, Article 2.25 (-)Inch Water Services, **delete** paragraph D, and **replace** with the following:

D. No measurement for payment will be made for the work required to remove the existing insulated water pipe, installing new insulated water pipe including connecting to the existing water service, sealing and insulating at the connection point, coordinating with the 1106 Second Street property owner for the installation of the heat trace wire, supporting the insulated water pipe and other WORK as shown in the Addendum No. 1 drawing dated February 17, 2011. This WORK shall be incidental.


**DRAWINGS:**

Item No. 2      Add the attached Addendum No. 1 Drawing titled "2-Inch Water Service @ 1106 2<sup>nd</sup> Street" dated February 17, 2011, Sheet 1 of 1.

By:   
Jennifer Mannix,  
Contract Administrator

Date: February 17, 2011

Total number of pages contained within this Addendum: 3

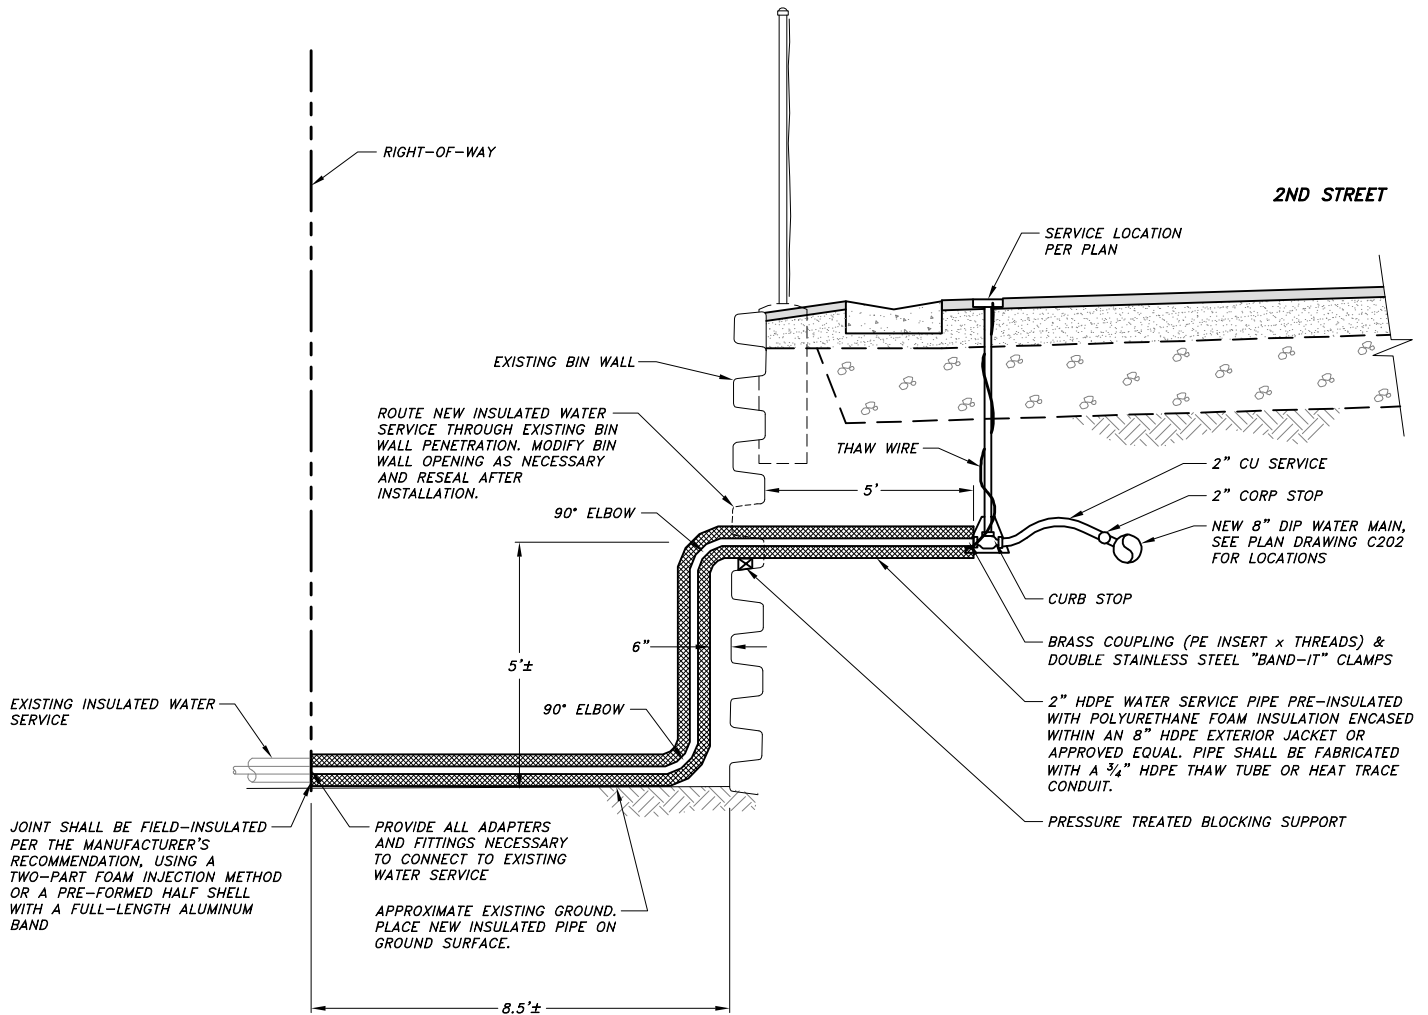

**NOTES:**

1. ALIGN NEW SERVICE SO THAT HORIZONTAL OFFSET BEND IS NOT REQUIRED.
2. ALL FIELD PIPE JOINTS SHALL BE CONNECTED AND INSULATED BY A METHOD APPROVED BY THE PIPE MANUFACTURER.
3. REMOVE AND DISPOSE OF EXISTING INSULATED PIPE FROM THE PROPERTY LINE TO THE NEW WATER MAIN.
4. CONTRACTOR SHALL COORDINATE WITH THE OWNER OF 1106 2ND STREET ON CONNECTION OF THE EXISTING HEAT TRACE WIRE TO THE NEW INSULATED PIPE HEAT TRACE SYSTEM.

1 2-INCH WATER SERVICE @ 1106 2ND STREET  
N.T.S.

SECOND STREET DOUGLAS RECONSTRUCTION  
CBJ CONTRACT No. E11-152  
ADDENDUM No. 1  
FEBRUARY 17, 2011