



## ADDENDUM TO THE CONTRACT

for the

**Eagles Edge Subdivision  
Water System Improvements  
Phase III  
Contract No. E16-148**

**ADDENDUM NO.:** ONE

**CURRENT DEADLINE FOR BIDS:**  
May 17, 2016

**PREVIOUS ADDENDA:** NONE

**ISSUED BY:** City and Borough of Juneau  
ENGINEERING DEPARTMENT  
155 South Seward Street  
Juneau, Alaska 99801

**DATE ADDENDUM ISSUED:** April 27, 2016

The following items of the contract are modified as herein indicated. All other items remain the same. This addendum has been issued and is posted online. Please refer to the CBJ Engineering Contracts Division webpage at: <http://www.juneau.org/engineering ftp/contracts/Contracts.php>

### **PROJECT MANUAL:**

Item No. 1 SECTIONS 00030 NOTICE INVITING BIDS, COMPLETION OF WORK, and SECTION 00500 AGREEMENTS, ARTICLE 2. CONTRACT COMPLETION TIME., **Change** the completion time to read:

"All work except for decommissioning the existing water meter vault shall be done by September 15, 2016. Work on the decommissioning shall be completed by July 1<sup>st</sup>, 2017."

### **DRAWINGS:**

Item No. 2 Sheet 20 PLAN – BELARDI DRIVE STA "BD" 15+25 TO STA "BD" 18+25, **Delete** and **replace** with the attached Sheet 20A PLAN – BELARDI DRIVE STA "BD" 15+25 TO STA "BD" 18+25, labeled Addendum No. 1, dated April 19, 2016.

By:   
Greg Smith,  
Contract Administrator

C:\Civil\_3D\Projects\22\70809-01\Civil\MCI4-CT-BA-70809.dwg 2016-4-19 11:02:19

MATCHLINE STA "BD" 15+25

MATCHLINE STA "BD" 18+25

MH-5 EXISTING TYPE I*	
N: 5183.57 E: 5490.40	
FG	EL=27.10
EXISTING COVER	EL=26.87
TOP OF EXISTING FLAT TOP	EL=25.07
INV 8"PVC (OUT)	EL=17.31
INV 8"PVC (IN) WEST	EL=17.29
INV 10"PVC (IN) SOUTH	EL=17.37
*ADJUST TO GRADE	

MH-7 EXISTING TYPE I*	
N: 5242.27 E: 5641.84	
FG	EL=26.84
EXISTING COVER	EL=26.88
TOP OF EXISTING CONE/FLAT TOP***	EL=**
INV 8"PVC (OUT)	EL=**
INV 8"PVC (IN)	EL=**
*ADJUST TO GRADE	
**VERIFY INVERT ELEVATIONS OF PIPES PRIOR TO INSTALLING OF THE NEW 12"HDPE WATER MAIN	
***VERIFY IF THIS MANHOLE HAS A CONE OR FLAT TOP.	

MH-6 EXISTING TYPE I	
N: 5261.43 E: 5614.97	
EXISTING COVER	EL=26.37
TOP OF EXISTING CONE	EL=25.14
INV 8"PVC (OUT)	EL=17.54
INV 8"PVC (IN) WEST	EL=17.51
INV 8"PVC (IN) SOUTH	EL=18.02


PIPE SUMMARY - STORM DRAINAGE				
PIPE	SIZE	LENGTH	TYPE	SLOPE
S-20	12"	23.3	CPP	0.003
SEE NOTE 2				

#### NOTES

1. PROVIDE ALL ADAPTERS, ELBOWS AND OTHER FITTINGS NECESSARY TO CONNECT TO DISSIMILAR PIPE SIZES, MATERIALS AND DEPTHS. CONNECT TO EXISTING.
2. PIPE LENGTHS ARE TO CENTER OF STRUCTURES, PIPE SLOPES ARE TO ENDS OF PIPES.
3. ALL ASPHALT DRIVEWAYS SHALL BE REPLACED WITH AC ASPHALT TO SAWCUT LINE.
4. WATER CONNECTIONS TO HOMES FROM THE VALVE BOXES WILL BE INSTALLED UNDER A PRIVATE CONTRACT AND ARE NOT INCLUDED IN THIS CONTRACT.
5. WORK ON THE VAULT REMOVAL, WATER METER BOX AND DISCONNECTION OF EXISTING WATER SYSTEM TO BE DONE AFTER ALL HOMES ARE CONNECTED TO THE NEW SYSTEM.
6. INSTALL A NEW FIRE HYDRANT, HYDRANT LEG, VALVE, VALVE BOX, GUARD POSTS, STORZ COUPLING, AND HYDRANT PAD IN ACCORDANCE WITH CURRENT CBJ STANDARD DETAILS AND SPECIFICATIONS.
7. 4" GATE VALVE WILL BE CONNECTED TO WATER SYSTEM AFTER PRESSURE TESTING. AFTER PRIVATE WORK TO CONNECT ALL RESIDENCES IS FINISHED 4" GATE VALVE WILL BE REMOVED AND WATER LINE CAPPED.
8. WATER CONNECTIONS TO HOMES FROM THE VALVE BOXES IS A PRIVATE CONTRACT AND ARE NOT INCLUDED IN THIS CONTRACT.
9. FILL VAULT WITH PEA GRAVEL TO WITHIN 6" OF THE TOP OF THE VAULT AND A CONCRETE SLURRY POURED INTO VAULT UNTIL FULL. USE EXTREME CAUTION DUE TO POOR VENTILATION IN VAULT. REMOVE VAULT FRAME AND LID, PAVE OVER AFTER ALL PRIVATE WATER SYSTEM WORK IS COMPLETE. CONTACT WATER DEPARTMENT TO SALVAGE ANY ITEMS INSIDE THE VAULT PRIOR TO FILLING.

REVISED 4-19-16


10 0 10 20  
SCALE IN FEET



Consulting Engineers • Land Surveyors • Construction Administration

JOB NO: J70809.01 DRAWN BY: STAFF DESIGNED BY: J. KANOUSE CHECKED BY: N. HOBBS DATE: APRIL 2016

5368 Commercial Blvd.  
Juneau, Alaska 99801  
(907) 780-3533 Office  
(907) 780-3535 Fax

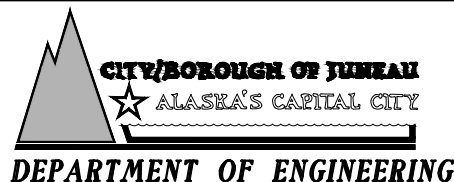

EAGLE'S EDGE SUBDIVISION  
WATER SYSTEM IMPROVEMENTS,  
PHASE III  
CONTRACT NO. E16-148

Addendum No. 1  
PLAN - BELARDI DRIVE  
STA "BD" 15+25 TO STA "BD" 18+25

SHEET NO.

20A  
of  
26