



ADDENDUM TO THE CONTRACT

for the

Juneau-Douglas High School Bleacher Replacement Contract No. BE17-253

ADDENDUM NO.: ONE

CURRENT DEADLINE FOR BIDS:
June 14, 2017

PREVIOUS ADDENDA: NONE

ISSUED BY: City and Borough of Juneau
ENGINEERING DEPARTMENT
155 South Seward Street
Juneau, Alaska 99801

PREVIOUS DEADLINE FOR BIDS:
May 30, 2017

DATE ADDENDUM ISSUED: May 24, 2017

The following items of the contract are modified as herein indicated. All other items remain the same. This addendum has been issued and is posted online. Please refer to the CBJ Engineering Contracts Division webpage at: <http://www.juneau.org/engineeringftp/contracts/Contracts.php>

INFORMATION ITEMS:

1. Question: The print shows End Rails on both sides of the gym. The North side bleachers run wall to wall. Are rails needed against a full height wall?
Answer: There is a gap of about 8" on either end so that the bleachers do not scrape against the wall as they have in the past. This will make the rails a requirement.

PROJECT MANUAL:

Item No. 1 SECTION 00030 - NOTICE INVITING BIDS. DEADLINE FOR BIDS.

Change the date of the Deadline for Bids **from** May, 30, 2017 **to** June 14, 2017.
Change the Bid Opening place **to** 230 South Franklin Street, Marine View Building, the Engineering Department, Third Floor Conference Room. The time remains the same.

Item No. 2 SECTION 00030 – NOTICE INVITING BIDS, COMPLETION OF WORK AND SECTION 00500 – AGREEMENT, ARTICLE 2. CONTRACT COMPLETION TIME, **Delete** the completion time and **replace** with the following:

<u>Work Description</u>	<u>Completion Date</u>
JDHS Gym available to Contractor for the Work	May 30, 2018
Substantial Completion	June 30, 2018
Final Completion, including operation and maintenance training with the Owner	July 10, 2018


Item No. 3 SECTION 12660 TELESCOPING STANDS, 2.3 COMPONENTS,
Add: I. Under Bleacher Access: At bleachers without a side curtain access,
manufacturer's standard access hatch to allow under bleacher access for maintenance.
See attached A201 Enlarged Renovation Floor Plan.

By: 
Greg Smith,
Contract Administrator

Total number of pages contained within this Addendum: 3

NOTE:
THESE DRAWINGS ARE BASED ON A LIMITED AMOUNT
OF INFORMATION ABOUT AN EXISTING BUILDING.
THE CONTRACTOR MUST FIELD VERIFY ALL INFORMATION
SHOWN AND NOTIFY THE ARCHITECT OF ANY
DISCREPANCIES PRIOR TO MODIFICATION

- NOTES:
- 1. ELECTRICAL EQUIPMENT AND BRANCH CIRCUITS INDICATED ARE EXISTING. WIRING HARNESS FOR NEW BLEACHERS SHALL CONNECT TO EXISTING ELECTRICAL DISCONNECT SWITCHES.
 - 2. CONTRACTOR VERIFY REQUIRED BLEACHER CLEARANCES WITH EXISTING COURT MARKINGS.

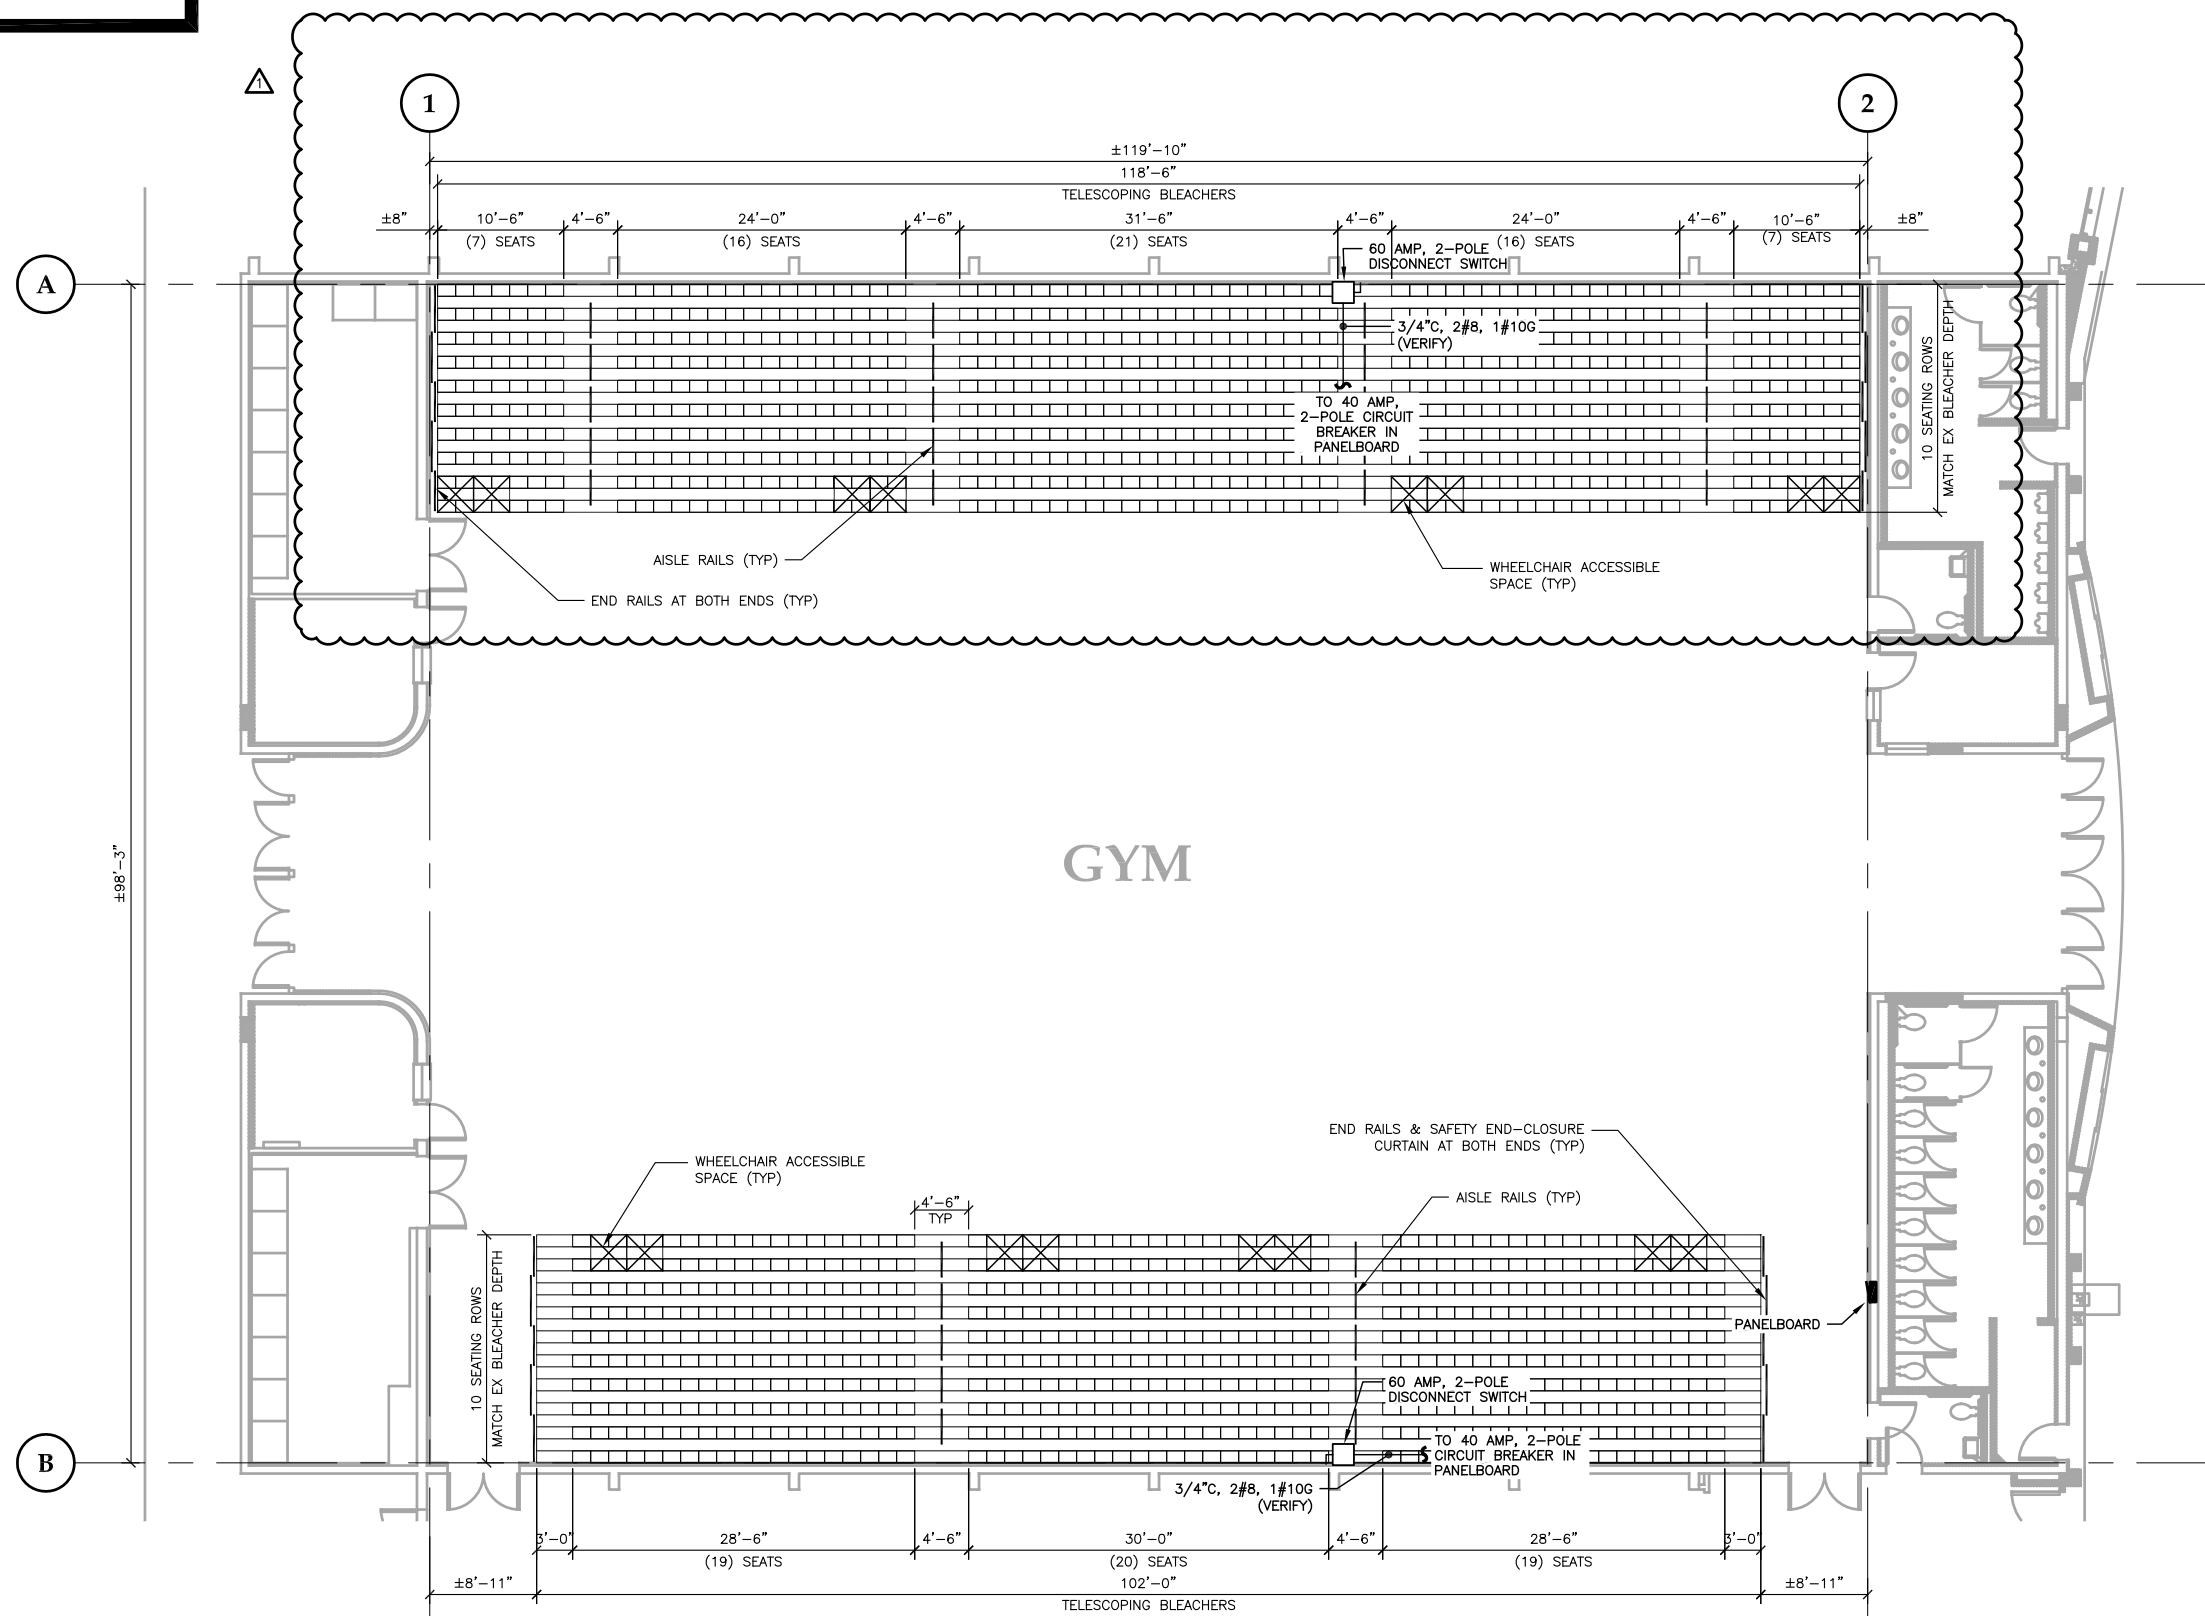


1 ENLARGED RENOVATION FLOOR PLAN

SCALE: 0 4' 8' 16'

Jensen Yorba Lott Inc.

522 West 10th Street
Juneau, Alaska 99801
phone 907-586-1070
fax 907-586-3959
jensenyorbalott.com



Juneau School District
Juneau Douglas High School
BLEACHER REPLACEMENT
Juneau, Alaska
CBJ Contract No. BE17-253

REVISIONS	
1	ADDENDUM 1
2	
3	
SHEET TITLE	
ENLARGED RENOVATION FLOOR PLAN	
DATE: April 11, 2017	
FILE: 17008	