



ADDENDUM TO THE CONTRACT
for the
D&H STREETS RECONSTRUCTION

Contract No. BE18-247

ADDENDUM NO.: ONE

CURRENT DEADLINE FOR BIDS:
May 9, 2018

PREVIOUS ADDENDA: NONE

ISSUED BY: City and Borough of Juneau
ENGINEERING DEPARTMENT
155 South Seward Street
Juneau, Alaska 99801

PREVIOUS DEADLINE FOR BIDS:
May 7, 2018

DATE ADDENDUM ISSUED: May 4, 2018

The following items of the contract are modified as herein indicated. All other items remain the same. This is a faxed addendum. A confirming copy will not be mailed to you. This addendum has been issued and is posted online. Please refer to the CBJ Engineering Contracts Division webpage at:

<http://www.juneau.org/engineering ftp/contracts/Contracts.php>

CLARIFICATION: The information changed per this addendum on the Drawing Sheets shall be reflected to the plan and grading sheets.

PROJECT MANUAL:

Item No. 1 SECTION 00030 - NOTICE INVITING BIDS. DEADLINE FOR BIDS.

Change the date of the Deadline for Bids **from** May 7 **to** May 9. The time remains the same.

Item No. 2 SECTION 00310 – BID SCHEDULE, **Delete** and **replace** with the attached SECTION 00310 BID SCHEDULE, labeled Addendum No. 1, dated May 4, 2018.

DRAWINGS:

Item No. 3. **Replace** Drawing 14 H & 3RD STREET INTERSECTION, **with** attached Drawing 14A H& 3RD STREET INTERSECTION, labeled ADDENDUM NO. 1.

Item No. 4 **Replace** Drawing 15 D & 3RD STREET INTERSECTION, **with** attached Drawing 15A D & 3RD STREET INTERSECTION, labeled ADDENDUM NO. 1.

By: Greg Smith
Greg Smith,
Contract Administrator

Total number of pages contained within this Addendum: 5

SECTION 00310 - BID SCHEDULE

PAY ITEM NO.	PAY ITEM DESCRIPTION	PAY UNIT	APPROX. QUANTITY	UNIT PRICE		AMOUNT	
				DOLLARS	CENTS	DOLLARS	CENTS
1505.1	Mobilization	Lump Sum	All Req'd	Lump	Sum		
1570.1	Erosion and Sediment Control	Lump Sum	All Req'd	Lump	Sum		
2201.1	Clearing and Grubbing	Lump Sum	All Req'd	Lump	Sum		
2202.1	Excavation	CY	1,919				
2202.2	Shot Rock Borrow	CY	1,318				
2202.5	Mining Area Restoration & Road Cleaning Guarantee	Contingent Sum	All Req'd	\$5,000.00	00	\$5,000.00	00
2204.1	2-Inch Minus Shot Rock w/Base Course	CY	541				
2204.2	Base Course, Grading D-1 For Driveways and Shouldering	Ton	287				
2401.1	Sanitary Sewer Pipe, 6-Inch PVC	LF	117				
2401.2	Sanitary Sewer Pipe, 8-Inch PVC	LF	150				
2401.3	Service Connections and Laterals	EA	5				
2401.4	Locate Sanitary Sewer Services	Lump Sum	All Req'd	Lump	Sum		
2402.1	Sanitary Sewer Manhole, Type I	EA	2				
2402.2	Connect to and Modify Existing Sanitary Sewer Manhole	EA	1				
2402.3	Adjust Sanitary Sewer Manhole to Grade	EA	6				
2501.1	4 & 6-Inch PVC Pipe Culvert	LF	280				
2501.2	12-Inch CPP Pipe Culvert	LF	320				
2501.3	18-Inch CPP Pipe Culvert	LF	694				
2501.4	6-Inch Underdrain	LF	257				
2501.5	CPP Saddle Tee	EA	5				
2502.1	Storm Drain Manhole, Type I	EA	5				
2502.2	Oil/Water Separator Storm Drain Manhole, Type I	EA	1				
2502.3	Catch Basin, Type III	EA	6				
2502.4	Catch Basin, Type IV	EA	14				
2502.5	Connect to and Modify Existing Storm Drain Manhole	EA	1				
2502.6	Connect to Existing Valley Gutter Trench Drain	EA	2				
2601.1	10-Inch HDPE Water Pipe	LF	567				
2601.2	Connect to Existing Water Pipe	EA	6				
2601.3	Temporary Water System	Lump Sum	All Req'd	Lump	Sum		
2602.1	Replace Valve Box	EA	10				
2602.2	10-Inch Gate Valve	EA	2				
2603.1	Fire Hydrant Assembly with Access Pad	EA	1				

COMPANY NAME: _____

SECTION 00310 - BID SCHEDULE

PAY ITEM NO.	PAY ITEM DESCRIPTION	PAY UNIT	APPROX. QUANTITY	UNIT PRICE		AMOUNT	
				DOLLARS	CENTS	DOLLARS	CENTS
2605.1	1-Inch Poly Water Service	EA	8				
2605.2	8-Inch HDPE Water Service	EA	1				
2605.3	Locate Water Services	Lump Sum	All Req'd	Lump	Sum		
2607.1	Pipe Insulation	Board	168				
2609.1	Corrosion Protection	EA	9				
2702.1	Construction Surveying	Lump Sum	All Req'd	Lump	Sum		
2709.1	Topsoil	CY	55				
2709.2	Topsoil Finish Grading	MH	40				
2710.1	Seeding, Hydraulic Method, Type III	SU	1				
2716.1	Remove and Dispose of Existing Storm Drainage System	Lump Sum	All Req'd	Lump	Sum		
2717.1	Remove and Dispose of Existing Sanitary Sewer and Water Pipe	Lump Sum	All Req'd	Lump	Sum		
2718.1	Sign Assembly	EA	2				
2719.1	Reconstruct Mailbox	EA	4				
2801.1	A.C. Pavement, Type II-A, Class B	Ton	465				
2801.2	A.C. Pavement for Driveways and Hydrant Pads	Ton	36				
2806.1	Remove Existing Asphalt Surfacing	SY	3,124				
3302.1	Concrete Area Drain	EA	4				
3303.1	Concrete Sidewalk, 4-Inches Thick	SY	172				
3303.2	Detectable Tile	SF	73				
3303.3	Curb and Gutter, Type I	LF	288				
3303.4	Valley Gutter, Type III	LF	1,713				
3304.1	Removal of Concrete Sidewalks and Slabs	SY	108				
3304.2	Removal of Curb and Gutter	LF	266				
3304.3	Removal of Valley Gutter	LF	1,715				

TOTAL BID _____

COMPANY NAME: _____

GENERAL NOTES:

- 1. SEE GRADING SHEETS FOR ADDITIONAL GRADING INFORMATION.
- 2. INSTALL ADA CURB RAMPS AND DETAILS PER ALASKA DOT&PF STD. DWG.'S I-20.20, I-21.10 & I-22.10.
- 3. CONTRACTION JOINTS SHALL BE CONSTRUCTED ALONG ALL GRADE BREAKS.
- 4. RAMPS HAVE BEEN DRAFTED TO SCALE. ADJUST TOP OF RAMP LOCATION AS NECESSARY TO MEET RAMP SLOPE AND LAYOUT REQUIREMENTS. MATCH TO EXISTING CURB & GUTTER AND SIDEWALK AT TOP OF RAMP.

SHEET NOTES:

- A CONSTRUCT RAMP SLOPES AT 7.70% NOMINAL GRADE, OR FLATTER. RAMP SLOPES MAY BE INCREASED TO A MAXIMUM 8.33% WHEN SITE CONDITIONS WARRANT IT. RAMP LENGTHS SHOULD BE INCREASED TO KEEP GRADES UNDER THE 8.33% MAXIMUM, BUT ARE NOT REQUIRED TO EXCEED 15.0'. THE RESULTING RAMP GRADE AT A 15.0' LENGTH IS ACCEPTABLE EVEN IF IT EXCEEDS 8.33%.
- B LANDING AREA - 4'x4' MIN. DIMENSIONS AND MAX 2.00% SLOPE IN ALL DIRECTIONS. GRADE TO DRAIN TOWARD GUTTER FLOW LINE.
- C IF THE DISTANCE FROM THE BACK OF CURB TO THE BOTTOM OF RAMP RUN GRADE BREAK IS LESS THAN 5' DETECTABLE WARNING TILE SHALL BE PLACE ON THE RAMP RUN.
- D SAWCUT AND REMOVE EXISTING SIDEWALK AS NECESSARY TO PROVIDE A SMOOTH TRANSITION TO PROPOSED CURB RAMP.
- E PRESERVE AND PROTECT EXISTING RETAINING WALL AND HANDRAIL.

CONTROL POINTS				
POINT #	NORTHING	EASTING	ELEV.	REMARKS
1	2354708.86	2545035.97	102.04	PC CURB RETURN
2	2354707.98	2545036.92	102.01	0" CURB HEIGHT BTM RAMP
3	2354707.24	2545048.51	101.76	0" CURB HEIGHT
4	2354708.43	2545050.06	101.72	PT CURB RETURN
5	2354711.84	2545053.71	101.33	BEGIN CURB & GUTTER TO VALLEY GUTTER TRANSITION
6	2354715.26	2545057.36	100.94	END CURB & GUTTER TO VALLEY GUTTER TRANSITION
7	2354715.73	2545043.23	0.00	RP
8	2354677.45	2545066.99	100.33	PC CURB RETURN
9	2354678.48	2545066.12	100.34	0" CURB HEIGHT BTM RAMP
10	2354690.10	2545065.94	100.59	0" CURB HEIGHT
11	2354691.73	2545067.34	100.64	PT CURB RETURN
12	2354695.14	2545070.99	100.45	BEGIN CURB & GUTTER TO VALLEY GUTTER TRANSITION
13	2354698.55	2545074.64	100.25	END CURB & GUTTER TO VALLEY GUTTER TRANSITION
14	2354684.42	2545074.17	0.00	RP


ADDENDUM NO.1



RECORD OF REVISIONS			
No.	DATE	DESCRIPTION	BY
1	04/18/2018	MODIFIED ADA RAMP LAYOUT. REPLACE ENTIRE SHEET.	LC



DRAWN BY:	L. CHAMBERS
DESIGNED BY:	L. CHAMBERS
CHECKED BY:	G. GLADSJO
DATE:	April 2018
P.O. BOX 33322 JUNEAU, AK 99803	
solutions@proHNS.com www.proHNS.com	

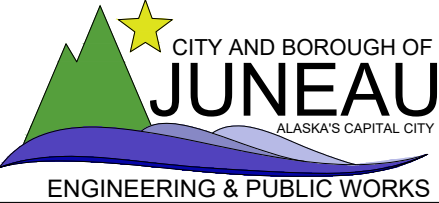


D & H STREETS
RECONSTRUCTION

CBJ CONTRACT NO. BE18-247



H & 3RD STREET
INTERSECTION

SHEET NUMBER
14A
OF
22

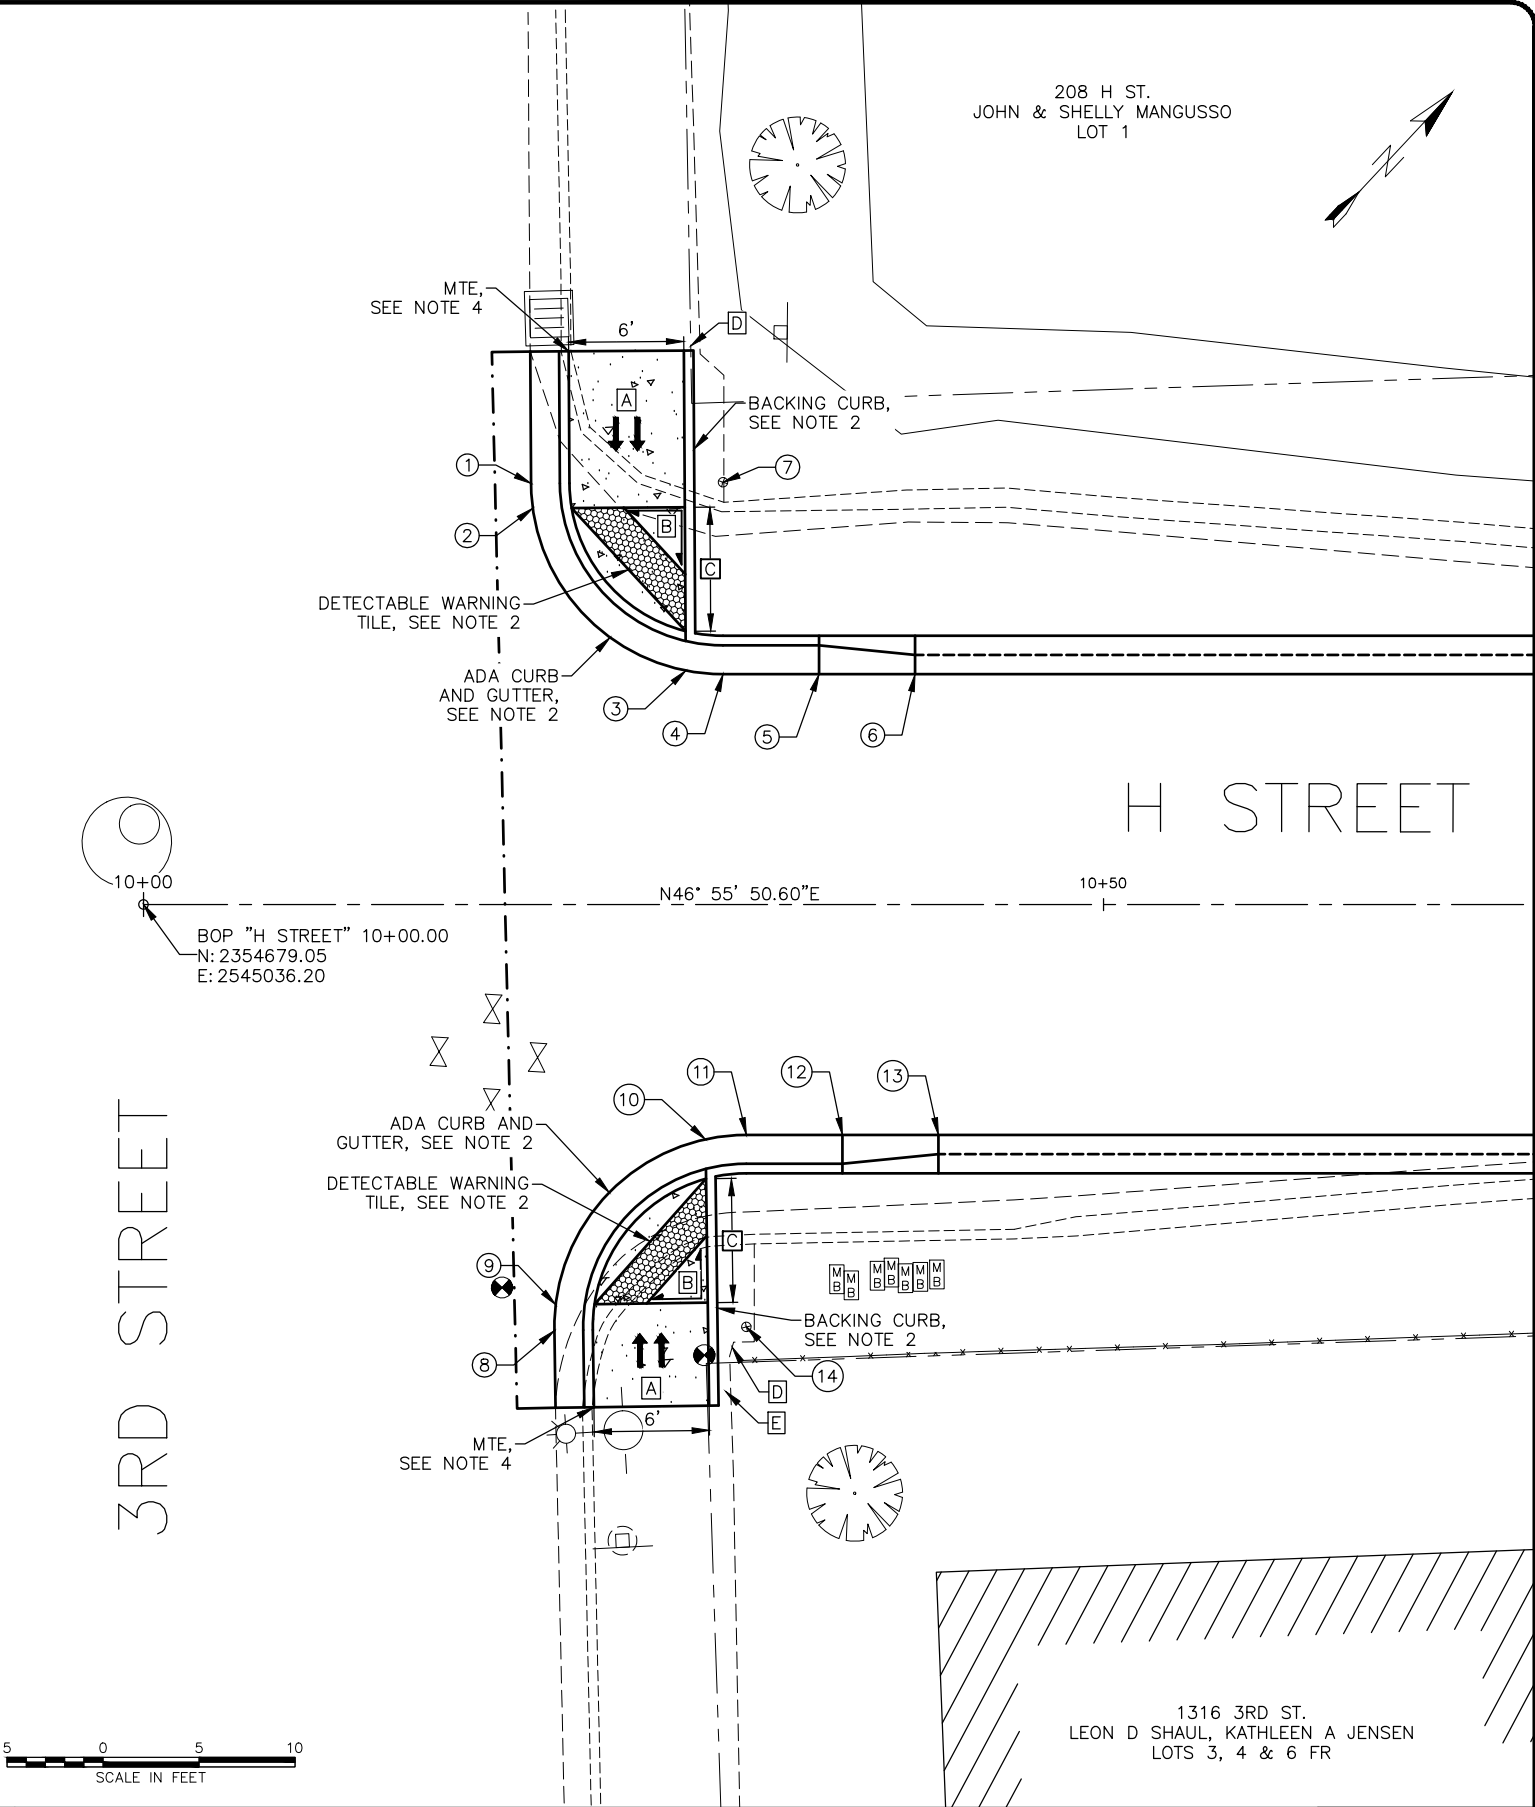

C:\Users\lucas\Dropbox (proHNS)\Projects\Juneau\DESIGN & PERMITTING\CBJ D&H Streets\Sheets\C3D D&H Streets\GRADING_INTERSECTIONS.dwg

April 19, 2018

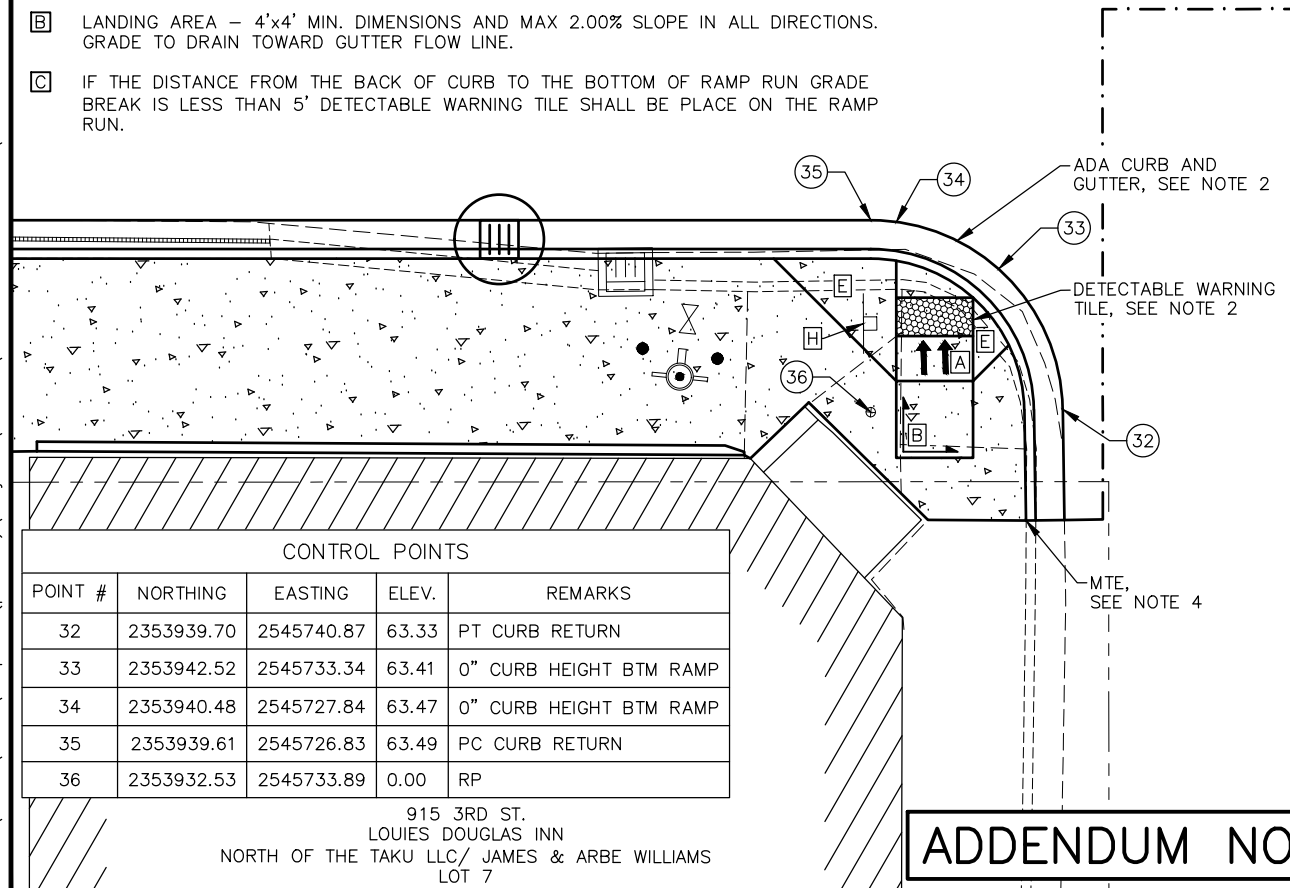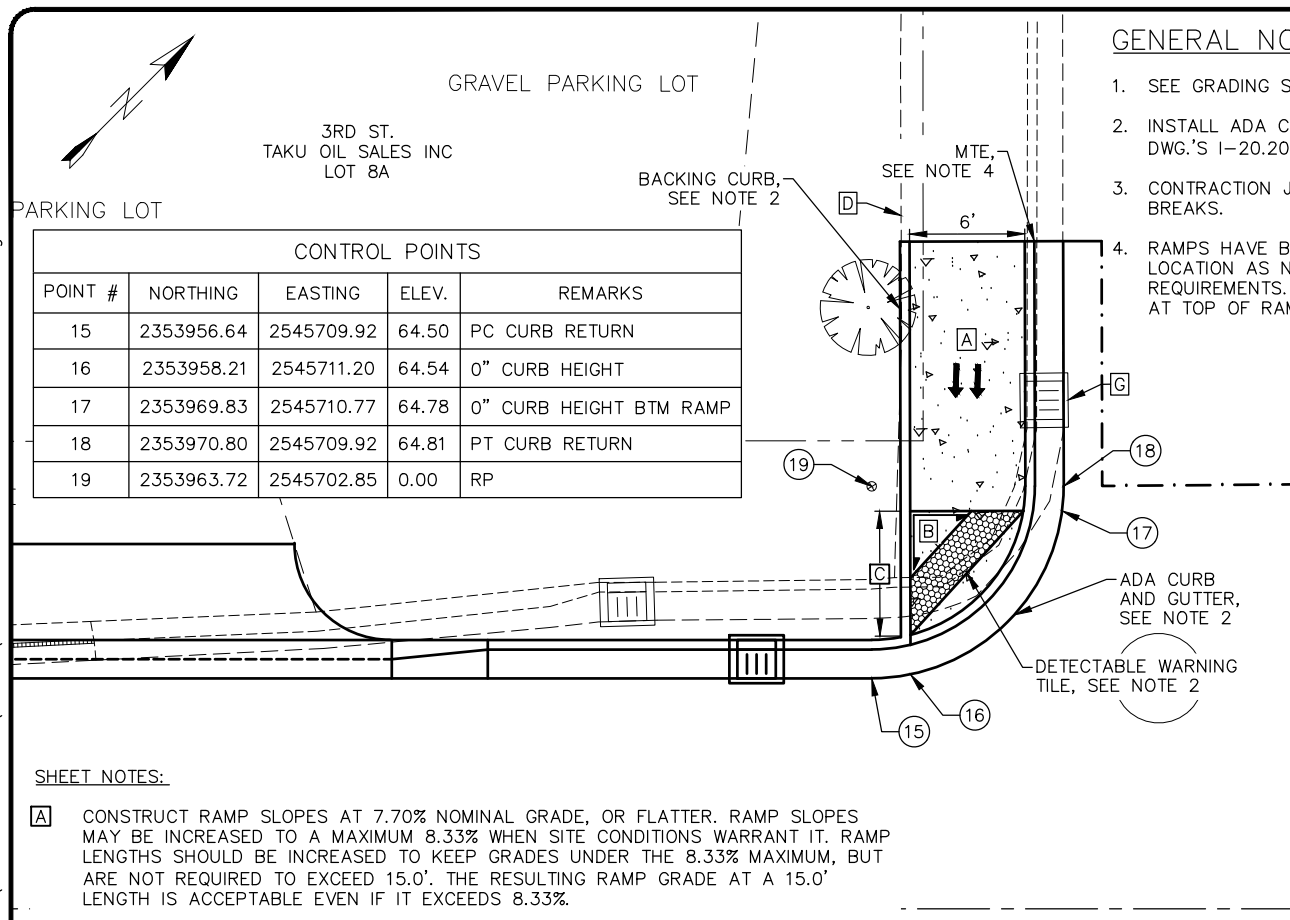



STATE OF ALASKA
49TH
GARRET K. GLADYS
04/18/2018
CE 14469
REGISTERED PROFESSIONAL ENGINEER

RECORD OF REVISIONS			
No.	DATE	DESCRIPTION	BY
1	04/18/2018	MODIFIED ADA RAMP LAYOUT. REPLACE ENTIRE SHEET.	LC



proHNS LLC
CERTIFICATE OF AUTHORIZATION
#100662

DRAWN BY: L. CHAMBERS
DESIGNED BY: L. CHAMBERS
CHECKED BY: G. GLADYSJO
DATE: April 2018

P.O. BOX 33322
JUNEAU, AK 99803
solutions@proHNS.com
www.proHNS.com





CITY AND BOROUGH OF
JUNEAU
ALASKA'S CAPITAL CITY
ENGINEERING & PUBLIC WORKS

**D & H STREETS
RECONSTRUCTION**

CBJ CONTRACT NO. BE18-247

**D & 3RD STREET
INTERSECTION**

SHEET NUMBER	
15A	OF
22	

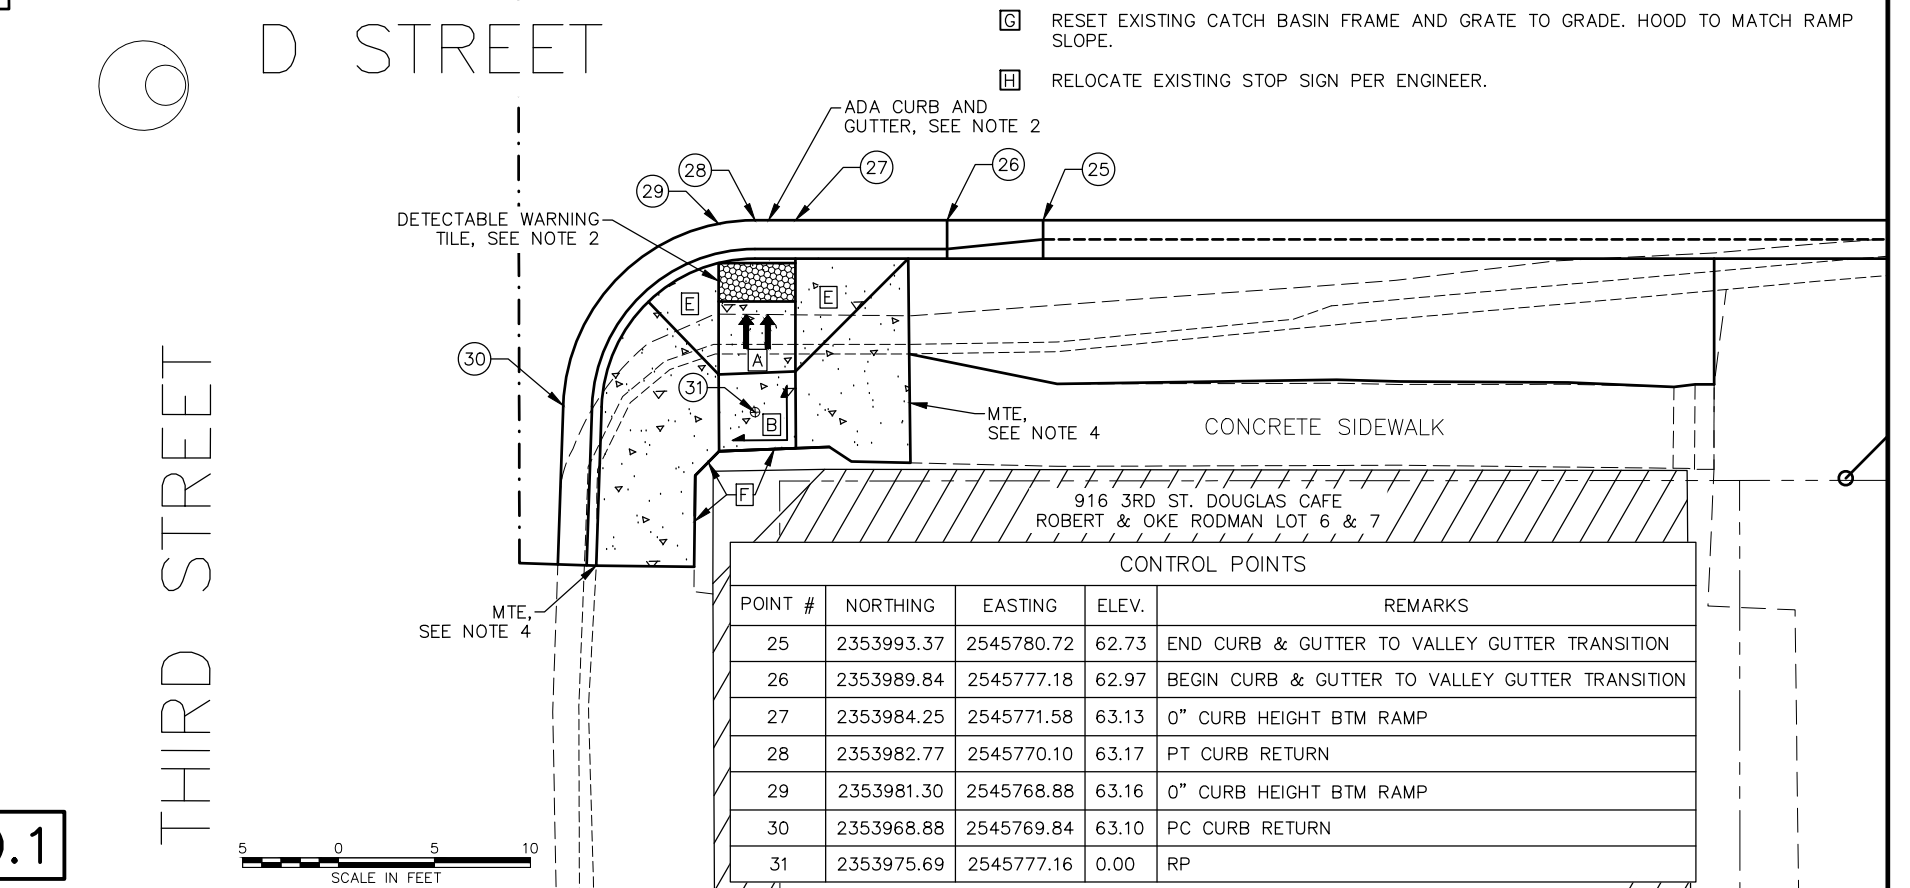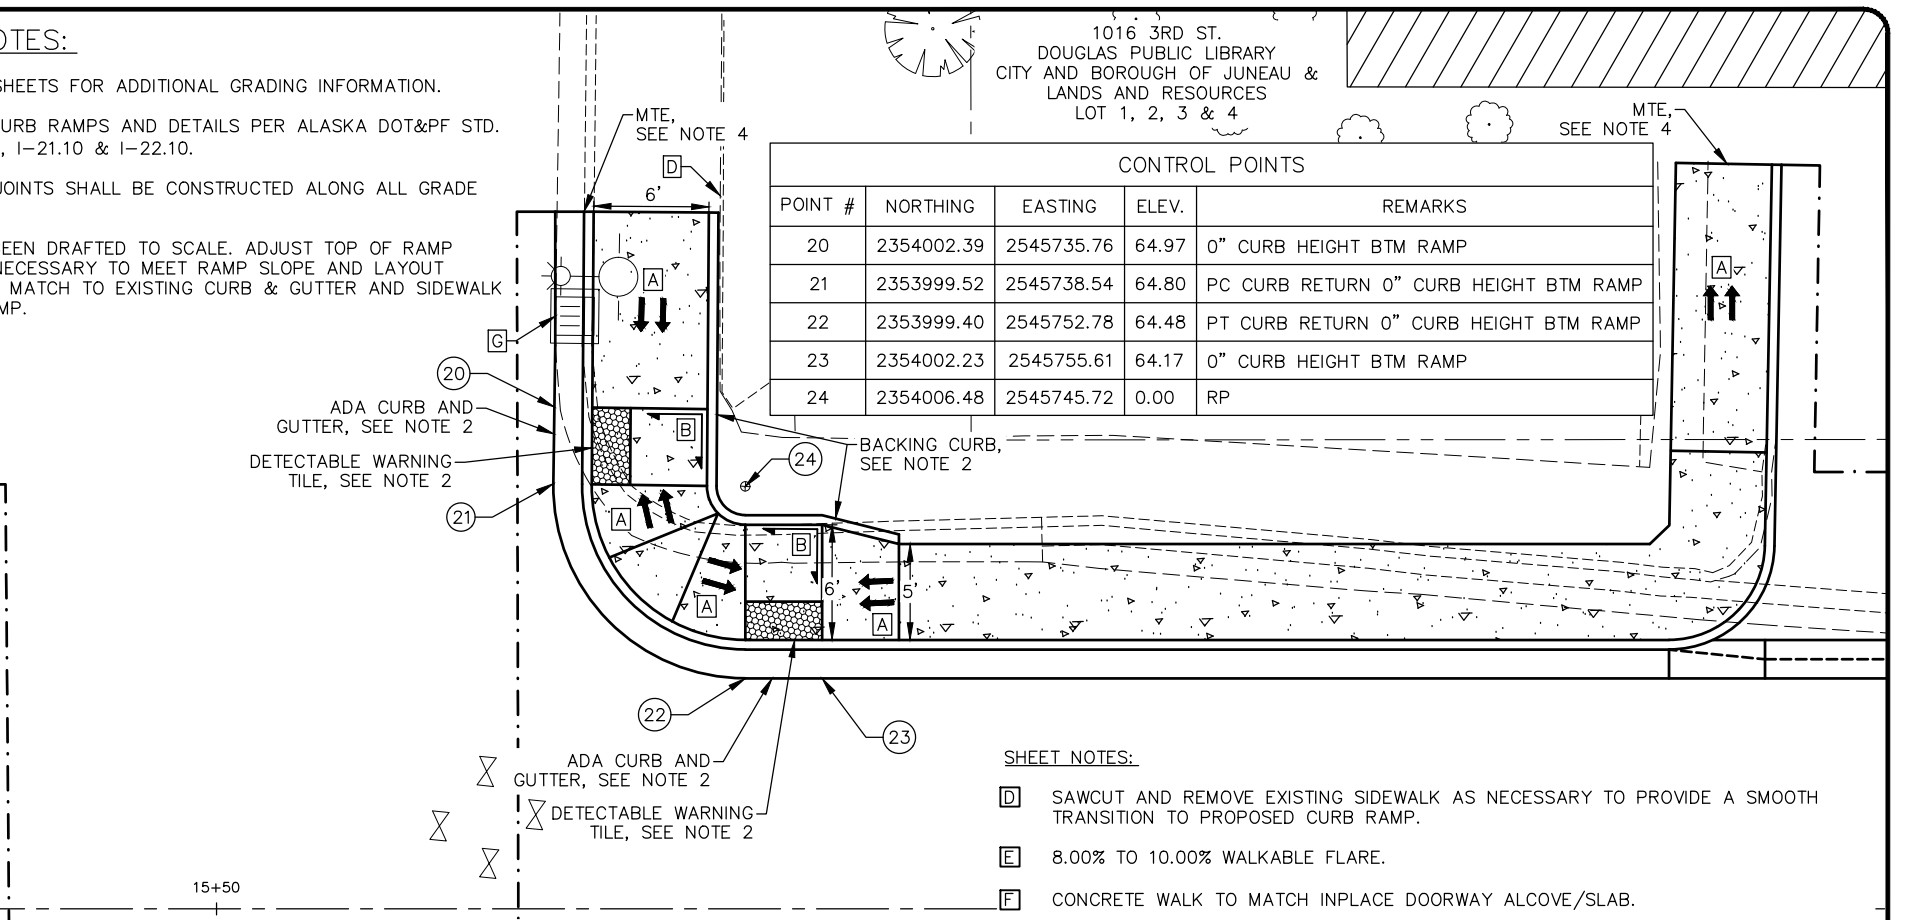



STATE OF ALASKA
49TH
GARRET K. GLADYS
04/18/2018
CE 14469
REGISTERED PROFESSIONAL ENGINEER

RECORD OF REVISIONS			
No.	DATE	DESCRIPTION	BY
1	04/18/2018	MODIFIED ADA RAMP LAYOUT. REPLACE ENTIRE SHEET.	LC



proHNS LLC
CERTIFICATE OF AUTHORIZATION
#100662

DRAWN BY: L. CHAMBERS
DESIGNED BY: L. CHAMBERS
CHECKED BY: G. GLADYSJO
DATE: April 2018

P.O. BOX 33322
JUNEAU, AK 99803
solutions@proHNS.com
www.proHNS.com



CITY AND BOROUGH OF
JUNEAU
ALASKA'S CAPITAL CITY
ENGINEERING & PUBLIC WORKS

**D & H STREETS
RECONSTRUCTION**

CBJ CONTRACT NO. BE18-247

**D & 3RD STREET
INTERSECTION**

SHEET NUMBER	
15A	OF
22	

GENERAL NOTES:

1. SEE GRADING SHEETS FOR ADDITIONAL GRADING INFORMATION.
2. INSTALL ADA CURB RAMPS AND DETAILS PER ALASKA DOT&PF STD. DWG.'S I-20.20, I-21.10 & I-22.10.
3. CONTRACTION JOINTS SHALL BE CONSTRUCTED ALONG ALL GRADE BREAKS.
4. RAMPS HAVE BEEN DRAFTED TO SCALE. ADJUST TOP OF RAMP LOCATION AS NECESSARY TO MEET RAMP SLOPE AND LAYOUT REQUIREMENTS. MATCH TO EXISTING CURB & GUTTER AND SIDEWALK AT TOP OF RAMP.

1016 3RD ST.
DOUGLAS PUBLIC LIBRARY
CITY AND BOROUGH OF JUNEAU &
LANDS AND RESOURCES
LOT 1, 2, 3 & 4

CONTROL POINTS				
POINT #	NORTHING	EASTING	ELEV.	REMARKS
20	2354002.39	2545735.76	64.97	0" CURB HEIGHT BTM RAMP
21	2353999.52	2545738.54	64.80	PC CURB RETURN 0" CURB HEIGHT BTM RAMP
22	2353999.40	2545752.78	64.48	PT CURB RETURN 0" CURB HEIGHT BTM RAMP
23	2354002.23	2545755.61	64.17	0" CURB HEIGHT BTM RAMP
24	2354006.48	2545745.72	0.00	RP

SHEET NOTES:

- [D] SAWCUT AND REMOVE EXISTING SIDEWALK AS NECESSARY TO PROVIDE A SMOOTH TRANSITION TO PROPOSED CURB RAMP.
- [E] 8.00% TO 10.00% WALKABLE FLARE.
- [F] CONCRETE WALK TO MATCH INPLACE DOORWAY ALCOVE/SLAB.
- [G] RESET EXISTING CATCH BASIN FRAME AND GRATE TO GRADE. HOOD TO MATCH RAMP SLOPE.
- [H] RELOCATE EXISTING STOP SIGN PER ENGINEER.

ADDENDUM NO.1

