

PLANNING COMMISSION NOTICE OF DECISION

Date: May 15, 2024 File No.: USE2024 0006

William & Michael Huemann PO Box 34024 Juneau AK, 99803 <u>chilkatvistas@gmail.com</u> Planning Commission

(907) 586-0715

PC_Comments@juneau.gov www.juneau.org/community-development/planning-commission 155 Heritage Way • Juneau, AK 99801

Proposal: A proposal for three, 16-unit apartment buildings for a total of 48 single-room

occupancies with private facilities in the D15 zoning district.

Property Address: Hillcrest Avenue

Legal Description: CHILKAT VISTAS TR A3

Parcel Code No.: 7B1001160014

Hearing Date: May 14, 2024

The Planning Commission, at its regular public meeting, adopted the analysis and findings listed in the attached memorandum dated April 19, 2024, and approved the three, 16-unit apartment buildings for a total of 48 single-room occupancies with private facilities in the D15 zoning district, to be conducted as described in the project description and project drawings submitted with the application and with the following conditions:

- 1. Prior to Temporary Certificate of Occupancy, Hooter Lane must be accepted by the CBJ for maintenance.
- 2. Prior to TCO, a new plat of Chilkat Vistas Tract A3 must be recorded.
- 3. Prior to issuance of a building permit, the applicant shall submit a lighting plan illustrating the location and type of exterior lighting proposed for the development. Exterior lighting shall be designed and located to minimize offsite glare. Approval of the plan shall at the discretion of the Community Development Department, according to the requirements at CBJ 49.40.230(d)

William & Michael Huemann File No: USE2024 0006

May 15, 2024 Page 2 of 2

Attachments: April 19, 2024, memorandum from Joseph Meyers, Community Development, to the

CBJ Planning Commission regarding USE2024 0006.

This Notice of Decision does not authorize construction activity. Prior to starting any project, it is the applicant's responsibility to obtain the required building permits.

This Notice of Decision constitutes a final decision of the CBJ Planning Commission. Appeals must be brought to the CBJ Assembly in accordance with CBJ 01.50.030. Appeals must be filed by 4:30 P.M. on the day twenty days from the date the decision is filed with the City Clerk, pursuant to CBJ 01.50.030(c). Any action by the applicant in reliance on the decision of the Planning Commission shall be at the risk that the decision may be reversed on appeal (CBJ 49.20.120).

Effective Date: The permit is effective upon approval by the Commission, May 14, 2024

Expiration Date: The permit will expire 18 months after the effective date, or November 14, 2025, if

no Building Permit has been issued and substantial construction progress has not been made in accordance with the plans for which the development permit was authorized. Application for permit extension must be submitted thirty days prior to

the expiration date.

| mandy cole | 5/21/24 | |
|--|---------|--|
| Mandy Cole, Chair | Date | |
| Planning Commission | | |
| Nicolette Chappell Filed With City Clerk | 5/22/24 | |
| Filed With City Clerk | Date | |

cc: Plan Review

NOTE: The Americans with Disabilities Act (ADA) is a federal civil rights law that may affect this development project. ADA regulations have access requirements above and beyond CBJ-adopted regulations. Owners and designers are responsible for compliance with ADA. Contact an ADA - trained architect or other ADA trained personnel with questions about the ADA: Department of Justice (202) 272-5434, or fax (202) 272-5447, NW Disability Business Technical Center (800) 949-4232, or fax (360) 438-3208.



PLANNING COMMISSION STAFF REPORT CONDITIONAL USE PERMIT USE2024 0006 HEARING DATE: APRIL 23, 2024

(907) 586-0715 CDD_Admin@juneau.gov www.juneau.org/community-development 155 Heritage Way • Juneau, AK 99801

DATE: April 19, 2024TO: Mandy Cole, Chair, Planning

Commission

BY: Joseph Meyers, Senior Planner

THROUGH: Jill Lawhorne, Director, AICP

PROPOSAL: A proposal for three, 16-unit apartment buildings for a total of 48 single-room occupancies with private facilities in the D15 zoning district.

STAFF RECOMMENDATION: Approval with conditions

KEY CONSIDERATIONS FOR REVIEW:

- Units are less than 400 square feet and meet the criteria for single-room occupancies with private facilities (SROs w/PF)
- SROs with private facilities count as ½ of a dwelling unit
- Hooter Lane must be accepted for maintenance by the CBJ prior to TCO
- Received funding from the Affordable Housing Fund
- Undergoing lot line adjustment to qualify for tax abatement

| GENERAL INFORMATION | | |
|--------------------------------|---|--|
| Property Owner | William & Michael Heumann | |
| Applicant | William Heumann | |
| Property Address | Hillcrest Avenue | |
| Legal Description | CHILKAT VISTAS TR A3 | |
| Parcel Number | 7B1001160014 | |
| Zoning | D15 | |
| Land Use Designation | Medium Density Residential (MDR; Map H) | |
| Lot Size | 100,730 square feet | |
| Water/Sewer | СВЈ | |
| Access | СВЈ | |
| Existing Land Use | Vacant | |
| Associated Applications | PAC2022 0005; SMF2022 0003 | |

ALTERNATIVE ACTIONS:

- Amend: require additional conditions or delete or modify the recommended conditions.
- Deny: deny the permit and adopt new findings for items
 1-6 below that support the denial.
- Continue: to a future
 meeting date if determined
 that additional information
 or analysis is needed to
 make a decision, or if
 additional testimony is
 warranted.

ASSEMBLY ACTION REQUIRED:

Assembly action is not required for this permit.

STANDARD OF REVIEW:

- Quasi-judicial decision
- Requires five (5) affirmative votes for approval
- Code Provisions:
 - 0 49.15.330
 - o 49.25.510(j)(2)
 - 0 49.80

William Heumann File No: USE2024 0006

April 19, 2024 Page 2 of 10

The Commission shall hear and decide the case per 49.15.330(a) Conditional Use Permit. A conditional use is a use that may or may not be appropriate in a particular zoning district according to the character, intensity, or size of that or surrounding uses. The conditional use permit procedures are intended to afford the commission the flexibility necessary to make determinations appropriate to individual sites. The commission may attach to the permit those conditions listed in subsection (g) of this section as well as any further conditions necessary to mitigate external adverse impacts. If the commission determines that these impacts cannot be satisfactorily overcome, the permit shall be denied.

SITE FEATURES AND ZONING



| SURROUNDING ZONING AND LAND USES | | | |
|----------------------------------|-----|--|--|
| North (ROW) Hooter Lane | | | |
| East (single-family) D15 | | | |
| South (single-family) D5 | | | |
| West (single-family) | D15 | | |

| SITE FEATURES | | |
|--------------------------|---------------|--|
| Anadromous | None | |
| Flood Zone | Zone X; Panel | |
| | 02110C1551E | |
| Hazard | No known | |
| Hillside | Yes | |
| Wetlands | No known | |
| Parking District | N/A | |
| Historic District | N/A | |
| Overlay Districts | N/A | |

BACKGROUND INFORMATION

Project Description – The applicant is requesting a Conditional Use Permit to construct three, 16-unit, two-story, apartment buildings containing a total of 48 single-room occupancy units (SROs) with private facilities. SROs with private facilities count as one-half dwelling unit [CBJ 49.25.510(j)(2)]. For comparison, under the existing zoning (D15), up to 35 standard units could be constructed. An SRO with private facilities is defined as a dwelling unit composed of a private bathroom and a combined kitchen, living, and sleeping area, designed for occupancy by a single person. (CBJ 49.80).

Background – The lot was platted in its current form in 2023 through Plat 2023-7, Juneau Recording District.

| Item | Summary |
|------------------------------|---|
| 2020 Traffic Impact Analysis | Traffic impact analysis for full buildout of subdivision. |
| 2022 Drainage Plan | Approved drainage plan from SMF2022 0003 which platted Tract A3 |
| Plat 2023-7 | Lot A3 was created through plat 2023-7 in the Juneau Recording |
| | District. |

William Heumann File No: USE2024 0006

April 19, 2024 Page 3 of 10


| ORD2023-14(b)(V) | Appropriation of funds by the Assembly from the Juneau Affordable |
|------------------|---|
| | Housing Fund for Chilkat Vistas apartment complex |

ZONING REQUIREMENTS

| Standard (D15) | | Requirement Existing | | Code Reference |
|----------------------------------|-------------|------------------------|---------------------|----------------|
| Lot | Size | 5,000 square feet | 100,730 square feet | 49.25.400 |
| | Width | 50 feet | 58 feet | 49.25.400 |
| Setbacks | Front (N) | 20 feet | N/A | 49.25.400 |
| | Rear (S) | 20 feet* | N/A | 49.25.400 |
| | Side (E)(W) | 5 feet | N/A | 49.25.400 |
| Street Side | | 13 feet | N/A | 49.25.400 |
| Lot Coverage Maximum | | 50% | 0% | 49.25.400 |
| | | | | |
| Vegetative Cover Minimum | | 30% | 100% | 49.50.300 |
| Height | Permissible | 35 feet | N/A | 49.25.400 |
| Accessory | | 25 feet | N/A | 49.25.400 |
| Maximum Dwelling Units (15/Acre) | | 35 dwelling units None | | 49.25.500 |
| Use | | Residential | Vacant 49.25.30 | |

^{*}Lot is zoned D15 and borders a D5 zoning district. The greater setback of 20 feet applies on shared property line per CBJ 49.25.400 (Note 3).

SITE PLAN

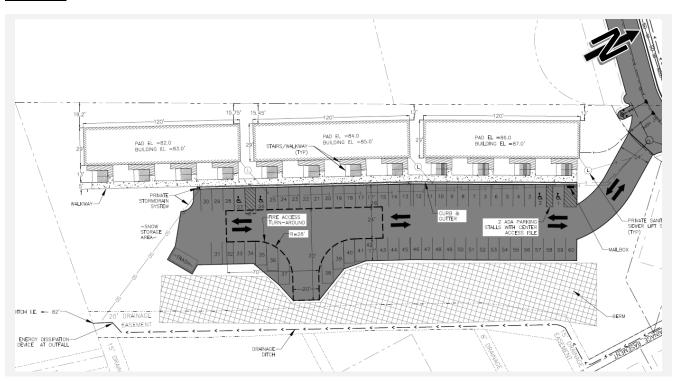

ANALYSIS

William Heumann File No: USE2024 0006 April 19, 2024 Page 4 of 10

Project Site – The lot was platted in 2023 with the creation of the Chilkat Vistas Phase 2 subdivision through Plat 2023-7. The subdivision and adjacent land uses consist of condominiums, single-family dwellings, and bungalow dwellings. The lot is located between the Lemon Creek and Twin Lakes geographical areas and due north of the Mountainside Estates neighborhood. The lot is 2.31 acres in size with an average slope of approximately 9.5% that descends toward Glacier Highway in the west.

Access to the lot is through Hooter Lane by way of Glacier Highway. Hooter Lane, as of the writing of this report, has not been accepted for maintenance by the City & Borough of Juneau (CBJ). Prior to issuance of a Temporary Certificate of Occupancy (TCO), Hooter Lane must be accepted for maintenance by the CBJ. The subdivision is connected to CBJ public water and sewer.

Condition: Prior to Temporary Certificate of Occupancy, Hooter Lane must be accepted by CBJ.

Project Design – The applicant is proposing construction of three, two-story, 16-unit apartment buildings containing a total of 48 SROs with private facilities. Each proposed unit is 399 square feet in size. The site is designed to include a two-lane driveway with a hammerhead turnaround for emergency access and 60 parking spaces including four (4) ADA compliant spaces, two (2) of which are van accessible per CBJ 49.40.225(b)(2). Required fire access and signage will be reviewed through the building permit process.

Condition: None

Traffic – The applicant submitted a Traffic Impact Analysis under Phase I (Attachment F). That analysis considered the impact of an eventual 47 single-family structures and 356 multi-family units. The trip generation numbers below were estimated by CDD staff using the ITE Trip Generation Manual, 9th Edition for low-rise multi-family buildings on an average weekday. This estimate assumes full occupancy.

| Use | Dwelling units | Trips Generated | Total Trips |
|--------------------------|----------------|-----------------|-------------|
| Multi-family residential | 48 | 6.59 | 316.32 |
| | | Total ADTs: | 316.32 |

Condition: None

Vehicle Parking & Circulation – SROs with private facilities require one (1) parking space each plus one (1) additional space for every four SROs with private facilities. Three (3) ADA spaces are required, however the submitted site plan shows four (4) dedicated ADA spaces. Two (2) of the dedicated ADA spaces are van accessible.

| Use | Unit/Total Sq. Ft. | Unit/Total Sq. Ft. Spaces Required | |
|---------------------------------------|--------------------|------------------------------------|----|
| Multi-family residential | 48 SRO units 60 | | 60 |
| Total Parking Requirement: | | | 60 |
| Off-Street Loading Spaces Required: 0 | | | 0 |
| ADA Accessible Spaces Required: | | 3 | |

Condition: None

Noise – Noise is not expected to be out of character with the existing neighborhood.

William Heumann File No: USE2024 0006 April 19, 2024

Page 5 of 10

Condition: None

Lighting – Per CBJ 49.40.235(d), parking areas must be suitably lit, and lighting fixtures must be "full cutoff" styles that direct light only onto the project site to minimize impacts to adjacent neighbors. Exterior lighting should also be provided along pedestrian pathways and immediately adjacent to the building. Submitted lighting specifications show full-cutoff lighting. Lighting will be reviewed with a building permit application.

Condition: Prior to issuance of a building permit, the applicant shall submit a lighting plan illustrating the location and type of exterior lighting proposed for the development. Exterior lighting shall be designed and located to minimize offsite glare. Approval of the plan shall at the discretion of the Community Development Department, according to the requirements at CBJ 49.40.230(d)


Vegetative Cover & Landscaping – Minimum vegetative cover in the D15 zoning district is 30%. The applicants' proposal indicates that the total vegetative cover retained is approximately 62% of the total lot area.

Condition: None

Habitat – No known habitat regulated by Title 49 will be affected by this proposal.

Condition: None


Drainage – The submitted site plan identifies a 20-foot-wide drainage easement across the eastern edge of Tract A3. This is consistent with the approved drainage plan submitted with SMF2022-0003 (Attachment E). Drainage will be assessed through the building permit process.

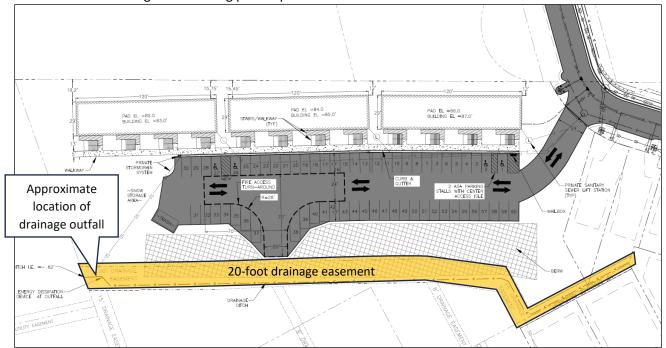

William Heumann File No: USE2024 0006

April 19, 2024 Page 6 of 10

Snow Storage – The proposed snow storage area is at the southern end of the parking lot (circled in red). Snow storage will be addressed through the building permit.

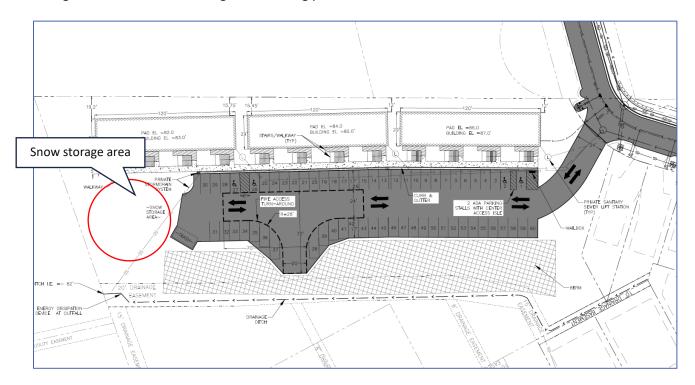

Condition: None

Historic District – The proposed development is not within the Downtown Juneau Historic District.

Condition: None

Hazard Zones – The lot is not within a mapped hazard zone.

Condition: None

Public Health, Safety, and Welfare – No information has been submitted that suggests the proposed development will materially endanger public health, safety, and welfare.

Condition: None

Property Value or Neighborhood Harmony – The proposed use is within the D15 zoning district. Multi-family residential use is consistent with the description of the zoning district. No information has been submitted that suggests the proposed use will negatively affect property values or neighborhood harmony.

The lot for this project is lower in elevation than the residential development to the east and may be obscured by a variable height berm that averages approximately 15 feet in height. The berm is intended to mitigate impacts to the single-family neighborhood immediately east of the proposed development.

William Heumann File No: USE2024 0006 April 19, 2024

Page 7 of 10

Mitigating impacts to existing neighbors could be further addressed through a landscaping plan, which the commission may require under CBJ 49.15.330(g)(18).

AGENCY REVIEW

CDD conducted an agency review comment period between February 26, 2024, and March 4, 2024, and received the following responses. Full responses are available in Attachment C.

| Agency | Summary |
|--------------------------|--|
| CBJ Assessors Office | No comments as of the writing of this report. |
| Capital City Fire Rescue | No issues with the development, signage will be required for the hammerhead turnaround through the building permit. |
| CBJ Buildings | No comments as of the writing of this report. |
| CBJ General Engineering | Drainage, sewer, water will be addressed through a building permit. |
| DOT/PF | The Traffic Impact Analysis conducted for the development of Richland Manor in 2020 included analysis of future development for up to 47 single family homes (detached) and approximately 356 multifamily homes in the vicinity of Hooter Lane and Craig Street. The conclusion of the TIA at that time was that at full build out, no major mitigation past the development of Hooter Lane and some pedestrian facility improvements at Vanderbilt and Glacier Highway would be necessary. Approach Road permit 30955 was issued for the development of Hooter Lane by DOT&PF and the subject TIA was reviewed by the Department at that time with no comment. The TIA and its findings that no additional mitigation to that previously mentioned was accepted by the Department. At this time, no additional analysis is required as the proposed multifamily development is within the original TIA's scope of work. |

PUBLIC COMMENTS

CDD conducted a public comment period between March 12, 2024, and April 19, 2024. Public notice was mailed to property owners within 500 feet of the proposed development. A public notice sign was also posted on-site two weeks prior to the scheduled hearing. Public comments submitted at time of writing this staff report can be found in Attachment D.

No comments were received at the time of writing of this report.

CONFORMITY WITH ADOPTED PLANS

The proposed development is in general conformity with the 2013 Comprehensive Plan, and the 2015 Juneau Economic Development Plan.

William Heumann File No: USE2024 0006

April 19, 2024 Page 8 of 10

| PLAN | Chapter | Page No. | Item | Summary |
|--------------------------------|---------|-------------|-------|---|
| 2013 Comprehensive Plan | 11 | 158 | Мар Н | According to the Land Use Maps outlined in the 2013 Juneau Comprehensive Plan, the designation of this lot is MDR (medium density residential). The MDR land use designation is described as follows: These lands are characterized by urban residential lands for multifamily dwelling units at densities ranging from 5 to 20 units per acre. Any commercial development should be of a scale consistent with a residential neighborhood, as regulated in the Table of Permissible Uses (CBJ 49.25.300). |
| | 3 | 20 | 3.2 | To promote compact urban development within the designated urban service area to ensure efficient utilization of land resources and to facilitate cost effective provision of community services and facilities while balancing protection of natural resources, fish and wildlife habitat and scenic corridors. |
| | 4 | 36 | 4.1 | To facilitate the provision and maintenance of safe, sanitary and affordable housing for Juneau residents. |
| | 4 | 37 | 4.2 | To facilitate the provision of an adequate supply of various housing types and sizes to accommodate present and future housing needs for all economic groups. |
| | 10 | 131 | 10.3 | To facilitate residential developments of various types and densities that are appropriately located in relation to site conditions, surrounding land uses, and capacity of public facilities and transportation systems. |
| 2015 Economic Development Plan | 5 | 94 | - | The proposal is consistent with the following initiative from the Juneau Economic Development Plan: Initiative: Promote Housing Affordability and Availability |

William Heumann File No: USE2024 0006

April 19, 2024 Page 9 of 10

FINDINGS

Conditional Use Permit Criteria – Per CBJ 49.15. 330 (e) & (f), Review of Director's & Commission's Determinations, the Director makes the following findings on the proposed development:

1. Is the application for the requested Conditional Use Permit complete?

Analysis: No further analysis needed.

Finding: Yes. The application contains the information necessary to conduct a full review of the proposed development. The application submittal by the applicant substantially conforms to the requirements of CBJ 49.15.

2. Is the proposed use appropriate according to the Table of Permissible Uses?

Analysis: The application is for 48 SROs with private facilities. The use is listed at CBJ 49.25.300, Section 1.610.

Finding: Yes. The requested permit is appropriate according to the Table of Permissible Uses.

3. Will the proposed development comply with the other requirements of this chapter?

Analysis: No further analysis needed.

Finding: Yes. With the recommended conditions, the proposed development will comply with Title 49, including parking, lighting, vegetative cover, and habitat.

4. Will the proposed development materially endanger the public health, safety, or welfare?

Analysis: No further analysis needed.

Finding: No. There is no evidence to suggest that with appropriate conditions, the requested single-room occupancy units with private facilities in a D15 zoning district will materially endanger the public health or safety.

5. Will the proposed development substantially decrease the value of or be out of harmony with property in the neighboring area?

Analysis: No further analysis needed.

Finding: No. There is no evidence to suggest that with appropriate conditions, the requested single-room occupancies with private facilities in a D15 zoning district will substantially decrease the value or be out of harmony with the property in the neighboring area.

6. Will the proposed development be in general conformity with the Land Use Plan, Thoroughfare Plan, or other officially adopted plans?

Analysis: No further analysis needed.

Finding: Yes. The proposed SROs with private facilities with the recommended conditions, will be in general conformity with the 2013 Comprehensive Plan, the 2015 Economic Development Plan, and the 2016 Housing

William Heumann File No: USE2024 0006 April 19, 2024 Page 10 of 10

Action Plan.

RECOMMENDATION

Staff recommends the Planning Commission adopt the Director's analysis and findings and APPROVE the requested Conditional Use Permit. The permit would allow the development of three, 16-unit, two-story apartment buildings containing a total of 48 single-room occupancy units with private facilities.

The approval is subject to the following conditions:

- 1. Prior to Temporary Certificate of Occupancy, Hooter Lane must be accepted by the CBJ for maintenance.
- 2. Prior to TCO, a new plat of Chilkat Vistas Tract A3 must be recorded.

STAFF REPORT ATTACHMENTS

| Item | Description | |
|--------------|--|--|
| Attachment A | Application Packet | |
| Attachment B | Abutters Notice and Public Notice Sign Photo | |
| Attachment C | Agency Comments | |
| Attachment D | Public Comments | |
| Attachment E | Approved drainage plan | |
| Attachment F | Traffic Impact Analysis | |



DEVELOPMENT PERMIT APPLICATION

NOTE: Development Permit Application forms must accompany all other Community Development Department land use applications. This form and all documents associated with it are public record once submitted.

| | PROPERTY LOCATION | | | | | | | | | | | | |
|------------------------------|--|----------------------------|------------------------------|--|--|--|--|--|--|--|--|--|--|
| | Physical Address Hillcrest Avenue | | | | | | | | | | | | |
| | Legal Description(s) (Subdivision, Survey, Block, Tract, Lot) Chilkat V | istas Tract A3 | 3 | | | | | | | | | | |
| | Parcel Number(s) 7B1001160014 | | | | | | | | | | | | |
| | This property is located in the downtown historic district This property is located in a mapped hazard area, if so, which | | | | | | | | | | | | |
| | LANDOWNER/ LESSEE | | | | | | | | | | | | |
| | Property Owner William and Michael Heumann | Contact Person Micha | ael Heumann | | | | | | | | | | |
| | Mailing Address P.O. Box 34024 Juneau, Ak. 9 | 9803 | Phone Number(s) 971-261-8014 | | | | | | | | | | |
| | E-mail Address chilkatvistas@gmail.com | | | | | | | | | | | | |
| ant | LANDOWNER/ LESSEE CONSENT Required for Planning Permits, not needed on Building/ Engineering Permits. Consent is required of all landowners/ lessees. If submitted with the application, alternative written approval may be sufficient. Written approval must include the property location, landowner/ lessee's printed name, signature, and the applicant's name. | | | | | | | | | | | | |
| To be completed by Applicant | A. This application for a land use or activity review for development on my B. I (we) grant permission for the City and Borough of Juneau officials/emp William Heumann Landowner/Lessee (Printed Name) Ti Landowner/Lessee (Signature) Michael Heumann | | | | | | | | | | | | |
| | | itle (e.g.: Landowner, Les | see) | | | | | | | | | | |
| | 1000 | | 2-13-24 | | | | | | | | | | |
| | XLandowner/Lessee (Signature) | | Date | | | | | | | | | | |
| | NOTICE: The City and Borough of Juneau staff may need access to the subject property during regular business hours. We will make every effort to contact you in advance, but may need to access the property in your absence and in accordance with the consent above. Also, members of the Planning Commission may visit the property before a scheduled public hearing date. | | | | | | | | | | | | |
| | APPLICANT If same as LANDOWNER | | | | | | | | | | | | |
| | Applicant (Printed Name) Chilkat Vistas LLC | Contact Person | | | | | | | | | | | |
| | Mailing Address | | Phone Number(s) | | | | | | | | | | |
| | ^{E-mail Address} chilkatvistas@gmail.com | | | | | | | | | | | | |
| | X | | 2/13/24 | | | | | | | | | | |
| | Applicant's Signature | | Date of Application | | | | | | | | | | |
| | DEPARTMENT USE ON | LY BELOW THIS LINE | | | | | | | | | | | |

INCOMPLETE APPLICATIONS WILL NOT BE ACCEPTED

For assistance filling out this form, contact the Permit Center at 586-0770.

Case Number Date Received 2/14/2024

Updated 6/2022-Page 1 of 1

Intake Initials



ALLOWABLE/CONDITIONAL USE PERMIT APPLICATION

See reverse side for more information regarding the permitting process and the materials required for a complete application.

NOTE: Must be accompanied by a DEVELOPMENT PERMIT APPLICATION form.

| | PROJECT SUMMARY | | | | | | | | | | | | |
|------------------------------|---|--|--|--|--|--|--|--|--|--|--|--|--|
| | 3-16 UNIT APARTMENT BUILDINGS | | | | | | | | | | | | |
| | TYPE OF ALLOWABLE OR CONDITIONAL USE PERMIT REQUESTED | | | | | | | | | | | | |
| | Accessory Apartment – Accessory Apartment Application (AAP) | | | | | | | | | | | | |
| | Use Listed in 49.25.300 – Table of Permissible Uses (USE) | | | | | | | | | | | | |
| | Table of Permissible Uses Category: | | | | | | | | | | | | |
| | IS THIS A MODIFICATION OF EXTENSION OF AN EXISTING APPROVAL? YES - Case # | | | | | | | | | | | | |
| | UTILITIES PROPOSED WATER: Public On Site SEWER: Public On Site | | | | | | | | | | | | |
| | SITE AND BUILDING SPECIFICS | | | | | | | | | | | | |
| nt | Total Area of Lot 100,730 square feet Total Area of Existing Structure(s) square feet | | | | | | | | | | | | |
| To be completed by Applicant | Total Area of Proposed Structure(s) 18,726 square feet | | | | | | | | | | | | |
| App | EXTERNAL LIGHTING | | | | | | | | | | | | |
| d by | Existing to remain | | | | | | | | | | | | |
| etec | Proposed O No Yes – Provide fixture information, cutoff sheets, and location of lighting fixtures | | | | | | | | | | | | |
| lduu | ALL REQUIRED DOCUMENTS ATTACHED If this is a modification or extension include: | | | | | | | | | | | | |
| o | ■ Narrative including: ■ Notice of Decision and case number | | | | | | | | | | | | |
| q o. | Justification for the modification or | | | | | | | | | | | | |
| | Description of project, project site, circulation, traffic etc. extension | | | | | | | | | | | | |
| | Proposed use of land or building(s) Application submitted at least 30 days | | | | | | | | | | | | |
| | How the proposed use complies with the Comprehensive Plan before expiration date | | | | | | | | | | | | |
| 103 | Plans including: | | | | | | | | | | | | |
| | 1 Site plan | | | | | | | | | | | | |
| | 1 Floor plan(s) | | | | | | | | | | | | |
| | Elevation view of existing and proposed buildings | | | | | | | | | | | | |
| | 1 Proposed vegetative cover | | | | | | | | | | | | |
| | Existing and proposed parking areas and proposed traffic circulation | | | | | | | | | | | | |
| | Existing physical features of the site (e.g.: drainage, habitat, and hazard areas) | | | | | | | | | | | | |
| | | | | | | | | | | | | | |
| | DEPARTMENT USE ONLY BELOW THIS LINE | | | | | | | | | | | | |
| | ALLOWABLE/CONDITIONAL USE FEES Fees Check No. Receipt Date | | | | | | | | | | | | |
| | Application Fees \$1,000 00 Class TV | | | | | | | | | | | | |
| | Admin. of Guarantee \$ | | | | | | | | | | | | |
| | Adjustment \$_ | | | | | | | | | | | | |
| | Pub. Not. Sign Fee \$ 30 | | | | | | | | | | | | |
| | Pub. Not. Sign Deposit \$ 100 | | | | | | | | | | | | |
| | Total Fee \$_1130_ | | | | | | | | | | | | |

This form and all documents associated with it are public record once submitted.

INCOMPLETE APPLICATIONS WILL NOT BE ACCEPTED

For assistance filling out this form, contact the Permit Center at 586-0770.

| Case Number | Date Received |
|-------------|---------------|
| USE 24-DO6 | 2/14/2024 |

Tract A3 in Chilkat Vistas Subdivision is currently used as vacant land. This application is for a project to construct 48 efficiency apartment units. The site gently slopes towards the southwest and the building itself will face west, ensuring ample sunlight and offering picturesque views of the channel, Mendenhall wetlands, and Chilkat mountain range. 61 parking spaces, including 4 ADA, will be provided by a two-lane driveway with a hammerhead turnaround for fire access. A berm will be used to separate the project from the adjacent single-family development. The comprehensive plan designates this as medium density residential with a maximum density of 20 units per acre which our project satisfies. The project's strategic location offers central access to public transportation and is situated in a beautiful and desirable area.


Juneau faces a well-documented housing problem characterized by a limited housing supply, restricted housing options, and high-cost burdens, forcing many residents to spend significantly more than 30% of their income for housing (see CBJ Housing Action Plan). This project will have a significant impact on the Juneau housing crisis, and has received \$2.25M in subsidized loans from the Juneau Affordable Housing Fund as it will provide housing for potentially cost burdened residents.

FRONT ELEVATION




16 UNIT APARTMENT BUILDING

CHILKAT VISTAS LLC

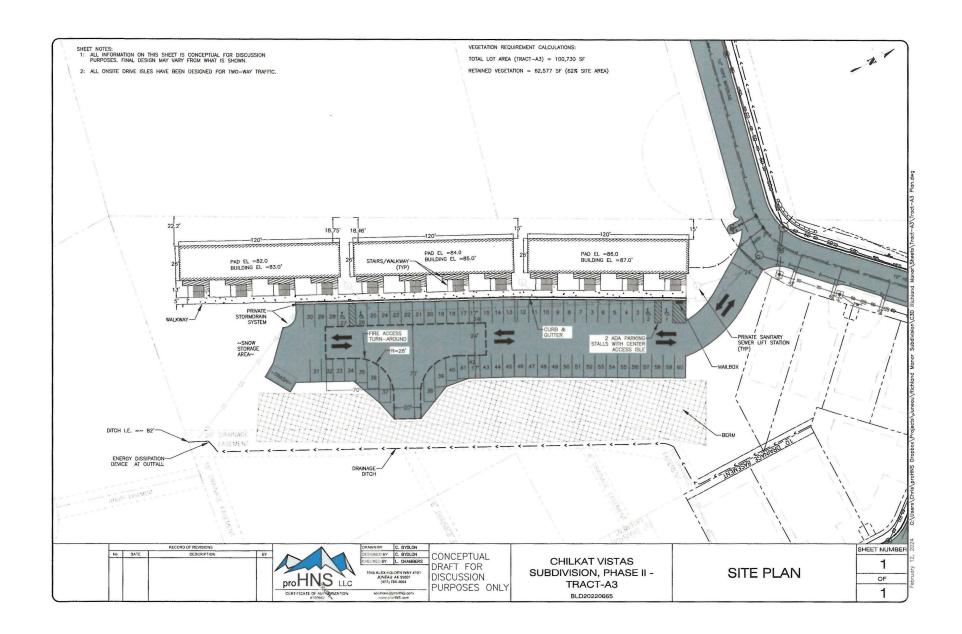


FIRST FLOOR

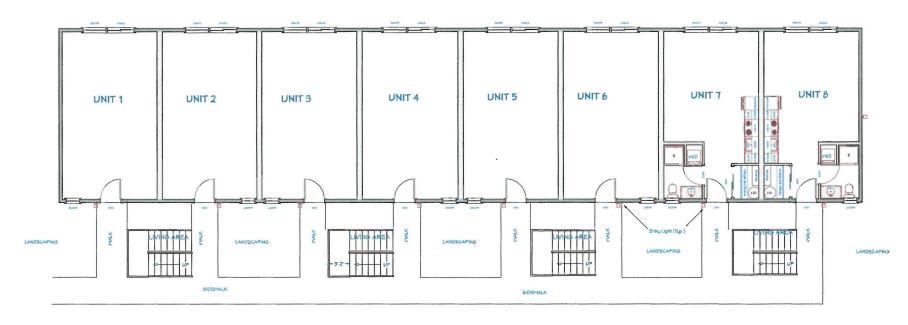

16 UNIT APARTMENT BUILDING

CHILKAT VISTAS LLC


SECOND FLOOR

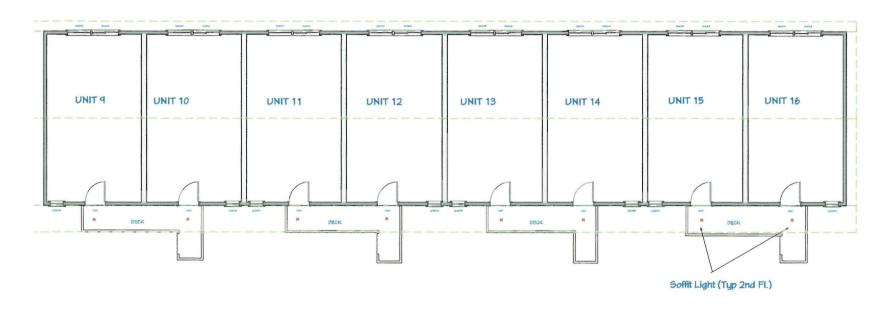

16 UNIT APARTMENT BUILDING

CHILKAT VISTAS LLC

6 in. White Flush Round Wet Rated LED Integrated Recessed Lighting Kit (6-Pack)

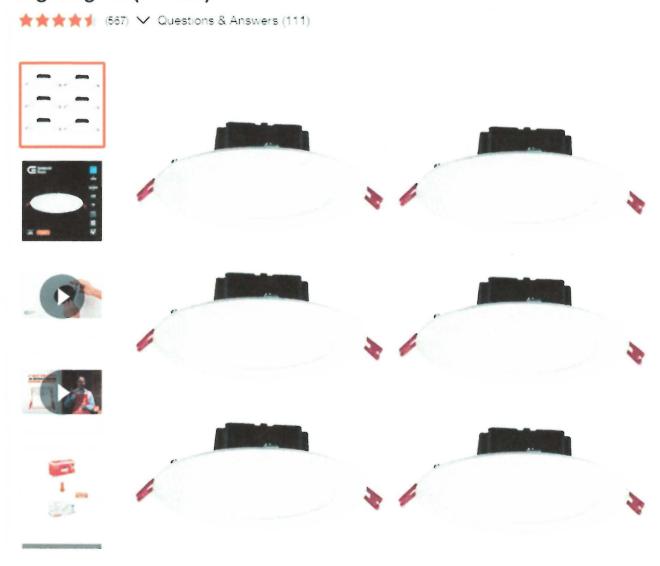



Attachment A - Application Packet



(907) 586-0715 CDD_Admin@juneau.org www.juneau.org/community-development 155 S. Seward Street • Juneau, AK 99801

Raven's Perch Apartments

Case Number:

PAC2022 0005

Applicant:

William Heumann

Property Owner:

William Heumann

Property Address:

N/A

Parcel Code Number:

TBD

Site Size:

100,730 square feet, 2.31 acres

Zoning:

D15 Multifamily

Existing Land Use:

Vacant

Conference Date:

March 22, 2023

Report Issued:

June 26, 2023

DISCLAIMER: Pre-application conferences are conducted for the purpose of providing applicants with a preliminary review of a project and timeline. Pre-application conferences are not based on a complete application and are not a guarantee of final project approval.

List of Attendees

Note: Copies of the Pre-Application Conference Report will be emailed, instead of mailed, to participants who have provided their email address below.

| Name | Title | Email address |
|-----------------|---------------------|---------------------------|
| William Huemann | Applicant | WHeumann@msn.com |
| David Peterson | Planning | David.Peterson@juneau.gov |
| David Sevdy | Building | David.Sevdy@juneau.gov |
| Eric Vogel | General Engineering | Eric.Vogel@juneau.gov |

Revised 5/07/2021


Conference Summary

Questions/issues/agreements identified at the conference that weren't identified in the attached reports. The following is a list of issues, comments and proposed actions, and requested technical submittal items that were discussed at the pre-application conference.

- Consideration for trash removal. Will need to be discussed with Alaska Waste.
- Mail delivery location. Will need to be discussed with USPS. Pamela.J.Nicholson@usps.gov
- Snow storage
- Routing sewer to not be under the driveway.
- Building Height


Project Overview

This project will include 18 efficiency (<400 ft.) and 24 1-bedroom units. The project will be located on Chilkat Vistas Subdivision Tract A3. Tract A3 is 2.31 Acres and the project will cover 1.13 acres with the rest left as green space. The project includes 65 parking spaces, 4 of which are ADA. The parking plan has provided for a fire-truck turnaround. The project will be surrounded by green space of varying widths. Access will be provided by Hooter Lane. The project is entirely surrounded by D-15, other than its southern border which is D-5 and over 40' from the building and even further from the parking area.

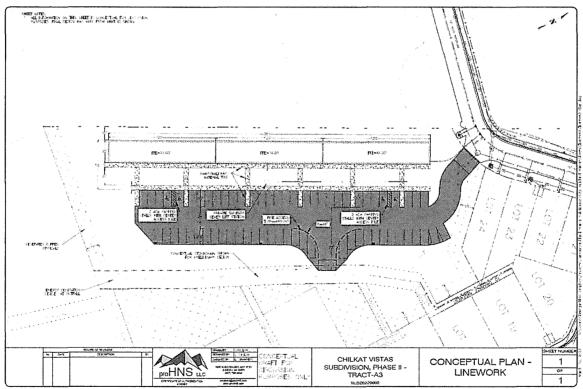

RAVEN'S PERCH APARTMENTS

Tupical Floor Plan

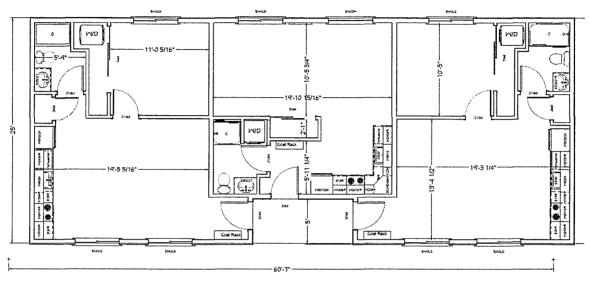

Chilkat Vistas Subdivision Phase 2

This project is major development and will require a Conditional Use Permit [CBJ 49.25.300(c)(3)(C)].

Planning Division

1. **Zoning** – D15 zone. 15 units per acre. Minimum lot size is 5,000 square feet, 3,000 square feet for a bungalow lot, and 3,500 square feet for a common wall dwelling.

<u>Minimum lot width</u> = 50'. Bungalow Lot Width = 25'. Common Wall Dwelling = 30'. Ref US Survey 4807 Tract A Chilkat Vista, C1 arc that denotes the front of the proposed multifamily housing development is 52.17' in length.

<u>Maximum number of dwelling units</u> allowable on 2.31 acres is (2.31 acres * 15 allowable units/acre = 34.65 = 35 units).

Per 49.25.510(j)(2) – Each single-room occupancy with private facilities shall count as one-half of a dwelling unit for purposes of calculating density, permitting requirements, and land use permit application fees.

(24 single bedroom units) + (18 efficiency units) = 24+9 = 33 total units.

- 2. **Subdivision** Chilkat Vistas Subdivision, Phase II Tract A3.
- 3. Setbacks
 - a. Front = 20 ft. (north, onto Hooter Lane);
 - b. Rear = 25 ft. (south abuts D5 so must use D5 setback);
 - c. Side = 5 ft. (east and west);

- d. Street side = 13 ft. (not apparently applicable to this development)
- 4. Height Maximum = 35 ft.; Accessory/Bungalow = 25 ft. (Reference 49.25.420)
- 5. Access Subdivision will have direct and practical access through the frontage on to Hooter Lane.
- 6. **Parking & Circulation**—Per 49.40.210, Multi-family units require 1 parking space per bedroom unit. 24 + 18 = 42 spaces. The proposed parking plan shows 65 parking spaces. ADA Parking:

26-50 spaces = 2 ADA Compliant spaces;

51-75 spaces = 3 ADA Compliant Spaces

Prelim plat shows (4) ADA compliant spaces.

7. Lot Coverage – Lot Coverage means the percentage of horizontal lot area that is occupied by all buildings on the lot, each measured at the outside of those exterior walls of the floor having the greatest horizontal dimensions. Maximum/Permissible/Conditional Lot Coverage = 50%.

Proposed building footprint = $25' \times 360' = 9,000$ square feet building footprint.

Tract A3 = 2.31 acres x 43,560suare feet/acre = 100,623.6 total square feet.

9,000/100,623.6 = .089 = 8.9% coverage.

- 8. Vegetative Coverage 49.50.300 Percentage of required vegetative coverage is 30% in D15 zoning.
- 9. Lighting Must be in compliance with 04 CBJAC 080.530.
- 10. Noise Community Development has no zoning related code to contest noise. Per 42.20.095(c), It is unlawful to operate any pile driver, power shovel, pneumatic hammer, derrick, power hoist, or similar heavy construction equipment, before 7:00 a.m. or after 10:00 p.m., Monday through Friday, or before 9:00 a.m. or after 10:00 p.m., Saturday and Sunday, unless a permit shall first be obtained from the City and Borough building official. Such a permit shall be issued by the building official only upon a determination that such operation during hours not otherwise permitted under this section is necessary and will not result in unreasonable disturbance to surrounding residents. The building official may revoke any noise permit after making written findings that the construction activity has resulted in unreasonable disturbance to surrounding residents or that operation during hours not otherwise permitted is not necessary.
- 11. Flood Per CBJ Flood maps, site is not located in a mapped flood zone.
- 12. Hazard/Mass Wasting/Avalanche/Hillside Endorsement
 - a. Hazard/Mas Wasting/Avalanche- No recorded hazards present on the site.
 - b. Hillside Endorsement 49.70.210, Excavation or creation of any slope in excess of 18%, will require a Hillside Endorsement. All hillside endorsement applications shall be reviewed by the planning commission, accept minor development (ref 49.70.210(b)(1-8). Note that the hillside endorsement must be completed before this project goes before the Planning Commission.
- 13. **Wetlands** No recorded wetlands present in CBJ records. If wetlands are discovered on parts of the proposed development, special regulations may apply.
 - **NOTE:** SMP2021 0004, Condition 1. Provide a wetlands fill permit from the United States Army Corps of Engineers.
- 14. **Habitat** Check with the U.S. Fish and Wildlife on the presence of eagle nests in the area. The presence of eagle nests may impact construction scheduling. No anadromous waterbodies are on the subject parcel, or within 50 feet.

- 15. Plat or Covenant Restrictions None apply. The Applicant has a Stipulated Settlement Agreement with the Mountainside Estates Neighborhood Association (MENA). Under the agreement, the CBJ's responsibility is limited to access development requirements. While other elements of the agreement are between the Applicant and MENA, a cursory review does not indicate this development would conflict with that agreement. Contact your attorney for confirmation.
- 16. Traffic Applicants have submitted a Traffic Impact Analysis for a build-out of 403 dwelling units. This was reviewed with the major subdivision applications SMP2021 0004 and SMP2019 0004. The analysis included 47 single-family homes and 356 multifamily homes. To date, 27 single-family lots have been platted, with 18 additional proposed under Phase 3. This development would be the first multi-family development.
- 17. Nonconforming situations N/A

Building Division

- 18. **Building** Show sound and fire protection on architectural plans. Full submittal requirements will be determined during the permitting process.
- 19. Outstanding Permits N/A

General Engineering/Public Works

- 20. Engineering -
- Grading: Slopes and retaining structures shall be shown on the Grading Plan. The heights and slope ratios
 must be quantified.
 - a. Easements: Site plan (plat) shall include all existing (and proposed) easements for drainage, utility lines, plumbing lines, access, snow storage, trash (dumpster) storage, or any other shared use that requires crossing the property line
- 2. **Drainage** Drainage must be directed to pre-approved drainage ways and cannot be directed at neighbors or otherwise cause a nuisance. Drainage shall be shown in the Grading Plan with arrows. Any drainage structures shall be identified, and sizes called out.
- 21. **Utilities** (water, power, sewer, etc.) Water service will need to be provided. A CBJ ROW Permit and Utility Permit will be required. The plans shall include a Utility Plan that shows the location of buried sewer and water utilities including valve, unions, cleanouts, and system components. Sizes and materials must be called out. Power by others.
- a. CBJ right-of-way (ROW) permit Once the construction plan for the utilities is approved, CBJ will create the ROW permit. The permit will cover the tapping of the water main and road restoration within the right-of-way (if required). Inspection fees, refundable bond amount, and conditions will be determined after review of the proposed construction plan. The extension of the utilities within the property will require further permitting and fee assessments. This process is done separately from the subdivision and typically in conjunction with the building permit application. Utility as-builts shall be submitted to GE prior to return of Bond and closure of permits.
- b. Water Utility permit for the water/fire line to be installed to the new structure. The line sizing shall be determined by the engineer. The meter is required to be installed prior to any branches in the plumbing line. The meter location and sizing shall be shown on the mechanical plans. The meter installation and conduit installation is the responsibility of the applicant. A water assessment will need to be paid and will be determined after sizing of meter and domestic line are identified.
- c. Sewer Utility permit for the sewer line to be installed to the new structure. The line sizing is determined by the engineer. The mechanical plans shall include a drainage fixture unit (DFU) count. A

sewer assessment and inspection fees will need to be paid and will be determined after review of the DFU's and the configuration of the underground sewer line.

Fire Marshal

3. Fire Items/Access - No comments at this time.

Other Applicable Agency Review

4. DOT&PF / Alcohol Beverage Control Board / Army Corps / DEC (wastewater) / DNR / USF&W / F&G / FAA / Corrections...

List of required applications

Based upon the information submitted for pre-application review, the following list of applications must be submitted in order for the project to receive a thorough and speedy review. Materials can be submitted electronically to the Permit Center via email to Permits@juneau.gov.

- 1. Conditional Use permit application (see attached)
- 2. Building permit application (see attached)
- 3. Development Permit application (required with both forms)

Additional Submittal Requirements

Submittal of additional information, given the specifics of the development proposal and site, are listed below. These items will be required in order for the application to be determined Counter Complete.

- 1. A copy of this pre-application conference report.
- 2. Site Plan (PDF)
- 3. Architectural Plans (PDF)

Exceptions to Submittal Requirements

Submittal requirements that staff has determined **not** to be applicable or **not** required, given the specifics of the development proposal, are listed below. These items will **not** be required in order for the application to be reviewed.

1. N/A

Fee Estimates

The preliminary plan review fees listed below can be found in the CBJ code section 49.85.

Based upon the project plan submitted for pre-application review, staff has attempted to provide an accurate estimate for the permits and permit fees which will be triggered by your proposal.

1. The building permit cost will be determined during the submittal process by square footage.

For informational handouts with submittal requirements for development applications, please visit our website at www.juneau.org/community-development.

Submit your Completed Application

You may submit your application(s) online via email to permits@juneau.gov
OR in person with payment made to:

City & Borough of Juneau, Permit Center 230 South Franklin Street Fourth Floor Marine View Center Juneau, AK 99801

Phone:

(907) 586-0715

Web:

www.juneau.org/community-development

Attachments:

49.15.330 - Conditional Use Permit

49.25.300 - Table of permissible uses

49.25.400 - Dimensional Standards

49.25.420 - Measuring building height

49.25.510 - Special Density Consideration

49.35.250 - Access

49.49.200 - Parking

49.40.210b - ADA Parking

Article II - Hillside Development

Article III - Traffic

Chapter 49.85 - Fees

69.10.023 - https://juneau.org/community-development/grants-cbj-tax-abatement-programs

Development Permit Application

Conditional Use Permit Application

Building Permit Application

49.15.330 Conditional use permit.

- (a) Purpose. A conditional use is a use that may or may not be appropriate in a particular zoning district according to the character, intensity, or size of that or surrounding uses. The conditional use permit procedure is intended to afford the commission the flexibility necessary to make determinations appropriate to individual sites. The commission may attach to the permit those conditions listed in subsection (g) of this section as well as any further conditions necessary to mitigate external adverse impacts. If the commission determines that these impacts cannot be satisfactorily overcome, the permit shall be denied.
- (b) Preapplication conference. Prior to submission of an application, the developer shall meet with the director for the purpose of discussing the site, the proposed development activity, and the conditional use permit procedure. The director shall discuss with the developer, regulation which may limit the proposed development as well as standards or bonus regulations which may create opportunities for the developer. It is the intent of this section to provide for an exchange of general and preliminary information only and no statement by either the developer or the director shall be regarded as binding or authoritative for purposes of this code. A copy of this subsection shall be provided to the developer at the conference.
- (c) Submission. The developer shall submit to the director one copy of the completed permit application together with all supporting materials and the permit fee.
- (d) Director's review procedure.
 - (1) The director shall endeavor to determine whether the application accurately reflects the developer intentions, shall advise the applicant whether or not the application is acceptable and, if it is not, what corrective action may be taken.
 - (2) After accepting the application, the director shall schedule it for a hearing before the commission and shall give notice to the developer and the public in accordance with section 49.15.230.
 - (3) The director shall forward the application to the planning commission together with a report setting forth the director's recommendation for approval or denial, with or without conditions together with the reasons therefor. The director shall make those determinations specified in subsections (1)(A)—(1)(C) of subsection (e) of this section.
 - (4) Copies of the application or the relevant portions thereof shall be transmitted to interested agencies as specified on a list maintained by the director for that purpose. Referral agencies shall be invited to respond within 15 days unless an extension is requested and granted in writing for good cause by the director.
 - (5) Even if the proposed development complies with all the requirements of this title and all recommended conditions of approval, the director may nonetheless recommend denial of the application if it is found that the development:
 - (A) Will materially endanger the public health or safety;
 - (B) Will substantially decrease the value of or be out of harmony with property in the neighboring area; or
 - (C) Will not be in general conformity with the land use plan, thoroughfare plan, or other officially adopted plans.
- (e) Review of director's determinations.
 - (1) At the hearing on the conditional use permit, the planning commission shall review the director's report to consider:
 - (A) Whether the proposed use is appropriate according to the table of permissible uses;

Created: 2023-03-21 12:41:13 [EST]

- (B) Whether the application is complete; and
- (C) Whether the development as proposed will comply with the other requirements of this title.
- (2) The commission shall adopt the director's determination on each item set forth in paragraph (1) of this subsection (e) unless it finds, by a preponderance of the evidence, that the director's determination was in error, and states its reasoning for each finding with particularity.
- (f) Commission determinations; standards. Even if the commission adopts the director's determinations pursuant to subsection (e) of this section, it may nonetheless deny or condition the permit if it concludes, based upon its own independent review of the information submitted at the hearing, that the development will more probably than not:
 - (1) Materially endanger the public health or safety;
 - (2) Substantially decrease the value of or be out of harmony with property in the neighboring area; or
 - (3) Lack general conformity with the comprehensive plan, thoroughfare plan, or other officially adopted plans.
- (g) Specific conditions. The commission may alter the director's proposed permit conditions, impose its own, or both. Conditions may include one or more of the following:
 - (1) Development schedule. A reasonable time limit may be imposed on construction activity associated with the development, or any portion thereof, to minimize construction-related disruption to traffic and neighborhood, to ensure that development is not used or occupied prior to substantial completion of required public or quasi-public improvements, or to implement other requirements.
 - (2) Use. Use of the development may be restricted to that indicated in the application.
 - (3) Owners' association. The formation of an association or other agreement among developers, homeowners or merchants, or the creation of a special district may be required for the purpose of holding or maintaining common property.
 - (4) Dedications. Conveyance of title, easements, licenses, or other property interests to government entities, private or public utilities, owners' associations, or other common entities may be required.
 - (5) Performance bonds. The commission may require the posting of a bond or other surety or collateral approved as to form by the city attorney to guarantee the satisfactory completion of all improvements required by the commission. The instrument posted may provide for partial releases.
 - (6) Commitment letter. The commission may require a letter from a public utility or public agency legally committing it to serve the development if such service is required by the commission.
 - (7) Covenants. The commission may require the execution and recording of covenants, servitudes, or other instruments satisfactory in form to the city attorney as necessary to ensure permit compliance by future owners or occupants.
 - (8) Revocation of permits. The permit may be automatically revoked upon the occurrence of specified events. In such case, it shall be the sole responsibility of the owner to apply for a new permit. In other cases, any order revoking a permit shall state with particularity the grounds therefor and the requirements for reissuance. Compliance with such requirements shall be the sole criterion for reissuance.
 - (9) Landslide and avalanche areas. Development in landslide and avalanche areas, designated on the landslide and avalanche area maps dated September 9, 1987, consisting of sheets 1—8, as the same may be amended from time to time by assembly ordinance, shall minimize the risk to life and property.
 - (10) Habitat. Development in the following areas may be required to minimize environmental impact:

Created: 2023-03-21 12:41:13 [EST]

- (A) Developments in wetlands and intertidal areas.
- (11) Sound. Conditions may be imposed to discourage production of more than 65 dBa at the property line during the day or 55 dBa at night.
- (12) Traffic mitigation. Conditions may be imposed on development to mitigate existing or potential traffic problems on arterial or collector streets.
- (13) Water access. Conditions may be imposed to require dedication of public access easements to streams, lake shores and tidewater.
- (14) Screening. The commission may require construction of fencing or plantings to screen the development or portions thereof from public view.
- (15) Lot size or development size. Conditions may be imposed to limit lot size, the acreage to be developed or the total size of the development.
- (16) Drainage. Conditions may be imposed to improve on and off-site drainage over and above the minimum requirements of this title.
- (17) Lighting. Conditions may be imposed to control the type and extent of illumination.
- (18) Other conditions. Such other conditions as may be reasonably necessary pursuant to the standards listed in subsection (f) of this section.

(Serial No. 87-49, \S 2, 1987; Serial No. 2006-15, \S 2, 6-5-2006; Serial No. 2015-03(c)(am), \S 9, 8-31-2015; Serial No. 2017-29, \S 3, 1-8-2018, eff. 2-8-2018)

Created: 2023-03-21 12:41:13 [EST]

49.25.300 Determining uses.

- (a) (1) Listed uses. There is adopted the table of permissible uses, table 49.25.300. The uses permitted in a zoning area shall be determined through the table of permissible uses by locating the intersection of a horizontal, or use axis and a vertical, or zone axis. The conditions and procedures applicable to the use in the zone thus located shall be as indicated thereat by the digits "1," "2," or "3" as more fully set out in this section and by letters of the alphabet as more fully set out by footnotes in the table. The absence of a digit at the intersection of use and zone axes means that the identified use is not permitted in the identified zone.
 - (2) Unlisted uses. The permissibility of a use not listed shall be determined pursuant to section 49.20.320.
 - (3) Uses listed more than once. Where a use might be classified under more than one category, the more specific shall control. If equally specific, the more restrictive shall control.
 - (4) Accessory uses. Uses constituting an incidental or insubstantial part of a permissible use and commonly associated with the permissible use may be allowed as an accessory use.
 - (5) Nonconforming uses. Nonconforming uses, including nonconforming residential densities, are subject to chapter 49.30.
- (b) (1) When used in conjunction with a particular use in the table of permissible uses, the number "1" indicates that the use requires department approval pursuant to chapter 49.15, article III, in conjunction with the issuance of a building permit. The use is allowed in the district, but limited conditions may be attached to the approval.
 - (2) The number "2" indicates the use requires an allowable use permit from the planning commission. Such uses are allowed in the district, but specified conditions may be attached to the allowable use permit by the commission. The permit procedure is outlined in chapter 49.15, article I.
 - (3) The number "3" indicates the use requires a conditional use permit from the commission. The use may or may not be allowed at a particular location, depending on a determination of its compatibility with surrounding or proposed land uses. The planning commission may attach any condition to ensure the compatibility of the proposed use. The conditional use permit procedure is outlined in chapter 49.15, article I.
- (c) A combination of digits such as "1, 3" or "2, 3" indicates that the approval procedure for the identified use in the identified zone will vary depending on whether the project is a major or minor development.
 - If the project is a minor development the first number of the combination shall indicate the applicable procedure.
 - (2) If the project is a major development the second number shall indicate the applicable procedure.
 - (3) Minor development means development which is classified by zoning district as follows:
 - (A) Rural reserve district: A residential development containing two or fewer dwelling units, two or fewer bedrooms leased on a daily or weekly basis, or a nonresidential building totaling less than 10,000 square feet or using less than one acre of land in total.
 - (B) Single-family residential districts: A residential development containing two or fewer dwelling units, two or fewer bedrooms leased on a daily or weekly basis, or a nonresidential building totaling less than 5,000 square feet or using less than 10,000 square feet of land in total.
 - (C) Multifamily residential districts: A residential development containing eight or fewer dwelling units, eight or fewer bedrooms leased on a daily or weekly basis, or a nonresidential building totaling less than 5,000 square feet or using less than 10,000 square feet of land in total.

Created: 2022-10-12 14:40:39 [EST]

- (D) Commercial and mixed use districts: A residential development containing 12 or fewer dwelling units, 12 or fewer bedrooms leased on a daily or weekly basis, or a nonresidential building totaling less than 10,000 square feet or using less than one-half acre of land in total.
- (E) Industrial districts: Non-residential buildings totaling 15,000 square feet or using less than one acre of land in total.
- (4) Major development means all development activity that is not a minor development.
- (5) Exceptions. Exceptions to the use of minor and major development classifications as a method of determining the applicable approval procedure shall be as noted in the table of permissible uses.

(Serial No. 87-49, § 2, 1987; Serial No. 89-01, § 2, 1989; Serial No. 89-14, § 2, 1989; Serial No. 89-16, § 2, 1989; Serial No. 89-20, § 2, 1989; Serial No. 89-20, § 2, 1989; Serial No. 89-20, § 2, 1989; Serial No. 89-31, § 2, 1989; Serial No. 90-21, § 2, 1990; Serial No. 90-52, § 3, 1990; Serial No. 90-54, §§ 2, 3, 1991; Serial No. 91-01, § 3, 1991; Serial No. 91-36, § 2, 1991; Serial No. 92-09, § 3, 1992; Serial No. 93-05, § 2, 1993; Serial No. 93-46, §§ 2—4(Exh. A) and (Exh. B), 1993; Serial No. 94-07, §§ 2, 3(Exh. A) and (Exh. B), 1994; Serial No. 94-40, § 2(Exh. A), 1994; Serial No. 95-09, §§ 2, 3(Exh. A) and (Exh. B), 1995; Serial No. 97-10, § 2(Exh. A), 1997; Serial No. 97-19, § 2(Exh. A), 1997; Serial No. 97-19, § 2(Exh. A), 1998; Serial No. 98-39, §§ 2—4(Exh. A), 1998; Serial No. 98-40, § 2(Exh. A), 1999; Serial No. 99-22, § 7, 1999; Serial No. 2000-46, § 2(Exh. A), 11-20-2000; Serial No. 2001-12, § 2(Exh. A), 4-02-2001; Serial No. 2010-22, §§ 2, 3(Exh. A), 7-19-2010; Serial No. 2015-07(b)(am), § 2, 2-23-2015, eff. 3-26-2015; Serial No. 2015-03(c)(am), § 18, 8-31-2015; Serial No. 2019-37, § 2, 3-16-2020, eff. 4-16-2020)

Created: 2022-10-12 14:40:39 [EST]

TABLE OF PERMISSIBLE USES - CBJ 49.25.300

| | 1 | | Zones | | | | | | | | | | | | | | | | |
|-------|--------------------------|--|---------|---------|---------|---------|----------------|----------|----------|----------|---------|---------|------|------|------|---------|---------|----|----|
| | Use Des | cription | RR | D-1 | D-3 | D-5 | D- 10 SF | D- 10 | D- 15 | D- 18 | LC | GC | MU | MU2 | MU3 | NC | WC | WI | 1 |
| 1.000 | Residential | | | | | | | | | | | | | | | | | | |
| · | 1.100 | Single-family dwellings | | | | | | | | | | | | | | | | | |
| | 1.110 | Single-family detached, one dwelling per lot | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | | | 1 | 1A | 1A |
| | 1.120 | Single-family detached, two dwellings per lot | 1 | 1 | 1 | | | | | | | | | | | | | | |
| | 1.130 | Single-family detached, accessory apartment ^x | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | 1, 3 | | |
| | 1.140 | Single-family detached, two dwellings per lot, accessory apartments ^x | 1, 3 | 1, | 1, 3 | | | | | | | | | | | | | | |
| 1.200 | Duplex | | 1 | 1 | 1 | 1 | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | | | 1 | | |
| 1.300 | Multifan | nily dwellings | | | | | | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1,3 | 1,3 | 1, 3 | 1, 3 | 3 | | |
| 1.500 | Child and Day care homes | | | | | | | | | | | | | | | | | | |
| | 1.510 | Child; 12 or fewer children under the age of 12 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | | | |
| | 1.520 | Reserved | | | | | | | | | | | | | | | | | |
| | 1.530 | Adult; 12 or fewer people, 12 years and older | 1 | 1 | 1 | 1 | 1, | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | | | |
| | 1.540 | Reserved | | | | | | | | | | | | | | | | | |
| | 1.550 | Child care residence, 6 to 9 children under 18 years of age | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | |
| 1.600 | Miscella situation | neous, rooms for rent ns | | | | | | | | | | | | | | | | | |
| | 1.610 | Rooming, boarding houses, bed and breakfasts, single room occupancies with shared facilities, transitional housing, and temporary residences. | 3 | 3 | 3 | 3 | 3 | 1, 3 | 1, | 1, 3 | 1, | 1, 3 | 1 | 1 | 1,3 | 1, | 3и | | |

Created: 2022-10-12 14:40:39 [EST]

(Supp. No. 145)

| | | Owner or manager must live | | I | | | | | Τ | 1 | T | | | | | | | | |
|-------|-------------------------|---|----------------|-------------------|----------------|---------|---------|---------|---------|---------|---------|---------|------|------|------|---------|----------------|----------------|---|
| | | on site. | | <u> </u> | | | | | | | ļ | | | | ļ | | <u> </u> | | |
| | 1.620 | Hotels, motels | 3 | | | | | | : | | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1,3 | 1, 3 | 3 _N | 34 | |
| | 1.630 | Single room occupancies with private facilities | | | | | | 1, 3 | 1, 3 | 1, | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1,3 | | |
| 1.700 | Home of | ccupations | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 1.800 | Mobile h | iomes | | | | | | | | | | | | | | | | | |
| | 1.810 | Residential mobile homes on individual lots ^E | 3 | 3 | -3 | | | | | | | | | | | | | | |
| | 1.815 | Caretakers mobile homes on individual lots ^E | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | 3 | 3 | 3 |
| | 1.820 | Mobile home parks ^E | | | | | 3 | 3 | 3 | 3 | 3 | 3 | | | | | | | |
| | 1.830 | Mobile home subdivision ^E | | | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | | | | | |
| | 1.840 | Recreational vehicle parks ^F | 3 ^F | 3 ^F | 3 ^F | | | | | | | | | | | | | | |
| 1.900 | Common wall development | | | | | | | | | | 1 | | | | | | | | |
| | 1.910 | Two dwelling units | | | | 1 | 1 | 1 | 1 | 1 | | | | | | | | | |
| | 1.911 | Accessory apartments ^x | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1,3 | 1, 3 | 1, 3 | | |
| | 1.920 | Three or more dwelling units | | | | | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | |
| | 1.930 | Two dwelling unit structures allowed under special density considerations, subsections 49.25.510(h) | | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | 3 | | | | | |
| 2.000 | Sales an | d Rental Goods, Merchandise or | Equip | ment ^G | | | | | | | | | | | | | | | |
| 2.100 | less than | s than 5,000 square feet and 20 percent of the gross floor outside merchandising of goods | | | | | | | | | | | | | | | | | |
| | 2.110 | Reserved | | | | | | | | | | | | | | | | | |
| | 2.120 | Miscellaneous | | | | | | | 1 | | 1 | 1 | 1 | 1 | 1 | 1 | 3и | 3N | 3 |
| , | 2.130 | Marine merchandise and equipment | 3т | | | | | | | | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1 | 1 | 1, 3 | 3 _N | 3 |
| 2.200 | | and display of goods with or equal to 5,000 square feet | | | | | | | | | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | 3и | 3и | 3 |

Created: 2022-10-12 14:40:39 [EST]

(Supp. No. 145)

| | , | Opercent of the gross floor utside merchandising of goods | | | | | | | | | | | | | | | | | |
|-------|----------------------|--|-----------------|----------------|----------------|---------|--------------------|---------|--------|----------|---------|---------|------|------|------|---------|------------------------------------|------------------------------------|---------|
| 2.300 | | a retail store | 3 | | | | | | | <u> </u> | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| 3.000 | Profession | nal Office, Clerical, Research, R | eal Esta | ate, Otl | ı 1er Offi | ce Serv | /ices ^G | 1 | 1 | | | | 1 | | | | | | |
| 3.050 | Offices of feet | f not more than 1,000 square | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1 | 1 | 1 | 1 | 1 | 1 | 1 ^N | | |
| 3.100 | , , | reater than 1,000 but not more 00 square feet | | | | | | 3 | 3 | 3 | 1 | 1 | 1 | 1 | 1 | 1 | 3 _N | | |
| 3.200 | Reserved | | | | | | | | | | | | | | | | | | |
| 3.300 | Research | , laboratory uses | 3 ^T | | | | | | | | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | | 1 ^N , 3 ^N | 1 ^N , 3 ^N | 1, 3 |
| 3.400 | Offices g | reater than 2,500 square feet | | | | | | | | | 1, 3 | 1, | 1,3 | 1, 3 | 1, 3 | 1, 3 | 1 ^N , 3 ^N | | 3s |
| 3.500 | Marijuan | a testing facility | 3 | | | | | | | | 3 | 3 | 3 | 3 | | | | | 3 |
| 4.000 | | turing, Processing, Creating, Rep | airing | , Renov | ating, I | Paintin | g, Clea | ning, A | ssembl | ing of G | oods | | | | | | | | |
| 4.050 | Light mai | nufacturing | 3™ | | | | | | 3 | 3 | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1 ^N , 3 ^N | 1 ^N , 3 ^N | 1, |
| 4.070 | Medium | manufacturing | 3 ^т | | | | | | | | | 3 | 3 | 3 | | | Зи | 1 ^N , | 1, |
| 4.100 | Heavy ma | anufacturing | 3 [™] | 30 | | | | | | | | | | | | | | 3N | 3 |
| 4.150 | Rock crus | sher | 31 | 1 ^Q | 1 ^Q | | | | | | | | | | | | | 3N | 3 |
| 4.200 | Storage o | of explosives and ammunition | 3 | | | | | | | | | | | | | | | 3и | 3 |
| 4.210 | Seafood | processing | 3 ^T | | | | | | | | | | | | | | 3 | 1, 3 | 1, 3 |
| 4.220 | Marijuan facility | a product manufacturing | 3 ^{AC} | | | | | | | | | 3 | 3 | | | | | | 3 |
| 5.000 | Educatio | nal, Cultural, Religious, Philanth | ropic, | Social, | Fratern | al Uses | ; | | | | | | | | | | | | |
| 5.100 | Schools | | | | | | | | | | | | | | | | | | |
| | 5.110 | Elementary and secondary schools including associated grounds and other facilities | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | |
| | 5.120 | Trade, vocational schools, commercial schools | 3т | | | | | | | | 3 | 3 | 3 | 3 | 3 | | 3и | 3 _N | 3 |
| | 5.130 | Colleges, universities | 3 [™] | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3и | .3N | 3 |
| 5.200 | Churches | , synagogues, temples | 3 ^т | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, 3 | 1, 3 | 1,3 | 1,3 | 3 | 3 | 1 ^N , 3 ^N | 3и | 1, 3 |

Created: 2022-10-12 14:40:39 [EST]

(Supp. No. 145)

| 5.300 | Libraries | , museums, art galleries | 3т | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 3и | | |
|-------|--------------------------|--|----------------|---|---|---|---|----|---|---|---------|---------|------|------|------|---------|------------------------------------|----|---------|
| 5.400 | Social, fr halls, yad | aternal clubs, lodges, union tht clubs | 3T | | | | | | | | 1, 3 | 1, 3 | 1,3 | 1, 3 | 1, 3 | 1, 3 | 1 ^N , 3 ^N | 3и | 1, 3 |
| 6.000 | Recreati | on, Amusement, Entertainment | | | | | | | | | | | | | | | | | |
| 6.100 | | ctivity conducted entirely uilding or substantial structure | | | | | | | | | | | | | | | | | |
| | 6.110 | Bowling alleys, billiard, pool halls | | | | | | | | | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | 3 |
| | 6.120 | Tennis, racquetball, squash courts, skating rinks, exercise facilities, swimming pools, archery ranges | | | | 3 | 3 | 3 | 3 | 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | 3 |
| | 6.130 | Theaters seating for 200 or fewer | 3 [™] | | | | | | 3 | 3 | 1 | 1 | 1 | 1 | 1, 3 | 1, 3 | 3 ^N | | 3 |
| | 6.135 | Theaters seating from 201 to 1,000 | | | | | | | | | 3 | 1 | 1 | 1 | 1, 3 | 1, 3 | 3 ^N | | 3 |
| | 6.140 | Coliseums, stadiums, and other facilities in the 6.100 classification seating more than 1,000 people | | | | | | : | | 5 | | 3 | 3 | 3 | | | 3и | | |
| | 6.150 | Indoor shooting range | 1, 3 | | | | | | | | | 3 | | | | | | | 3 |
| 6.200 | | activity conducted outside buildings or structures | | | | | | | | | | | | | | | | | |
| | 6.210 | Recreational facilities such as golf, country clubs, swimming, tennis courts not constructed pursuant to a permit authorizing the construction of a school | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, | | | 1, 3 | 1, 3 | 3м | | ന |
| | 6.220 | Miniature golf courses, skateboard parks, water slides, batting cages | 3 | 3 | 3 | 3 | 3 | 3. | 3 | 3 | 3 | 1, 3 | 3 | 3 | 1, 3 | 1, 3 | 34 | | 3 |
| | 6.240 | Automobile, motorcycle racing tracks; off-highway vehicle parks | 3 | | | | | | | | | 3 | | | | | | | 3 |
| | 6.250 | Reserved | | | | | | | | | | | | | | | | | |

| | 6.260 | Open space | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
|-------|------------------------|---|----------------|----------|----------|---------|---------|----------|---|---|---------|---------|------|------|------|---------|------------------------------------|----------------|---|
| | 6.262 | Parks with improved facilities, not approved in conjunction with a major subdivision | | | | | | - | | | | | | | | | | | |
| | 6.264 | Capacity for up to 20 people ^w | 1 ^T | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 3 ^N | |
| | 6.266 | Capacity for more than 20 people ^w | 3 [⊤] | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3и | 3и | |
| | 6.270 | Aerial conveyances and appurtenant facilities | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3и | 3и | 3 |
| | 6.280 | Shooting ranges | 3 | | | | | | | | | | | | | | | | 3 |
| 7.000 | Institutio | nal Day or Residential Care, Hea | alth Ca | re Facil | ities, C | orrecti | onal Fa | cilities | | | | | | | | | | | |
| 7.100 | Hospital | | | | | | | | | | 3 | 3 | 3 | 3 | | | | | |
| 7.150 | | re clinics, other medical at facilities providing out- are | | | | | | | 3 | 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | |
| 7.200 | Assisted | living | | 3 | 3 | -3 | 3 | 3 | 3 | 3 | 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | |
| 7.300 | Day care | centers | | | | | | 3 | 3 | 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | |
| 7.310 | Child care | e centers | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, | 1, 3 | 1,3 | 1, 3 | 1, 3 | 1, 3 | | | |
| 7.500 | Correctio | nal facilities | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | | | |
| 7.600 | Sobering | centers | | | | | | | | | 3 | 3 | 3 | -3 | | | | | |
| 8.000 | Restaura | nts, Bars, Nightclubs | o electrical | | | | | | | | | | | | | | | | |
| | 8.050 | Small restaurants, less than 1,000 ft ² without drive through service | 3т | | | | | 3 | 3 | 3 | 1 | 1 | 1 | 1 | 1 | 1 | 1 ^N | | 3 |
| 8.100 | Restaura service | nts, bars without drive through | 31 | | | | | | | | 1, 3 | 1 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1 ^N , 3 ^N | 3и | 3 |
| 8.200 | Restaura through s | nts, coffee stands with drive service | | | | | | | | | 1, 3 | 1 | | 3 | | | 1 ^N , 3 ^N | 3и | 3 |
| 8.300 | Seasonal drive thro | open air food service without ough | 3 | | | | | | | | 1, 3 | 1 | 1,3 | 1, 3 | 1, 3 | 1, 3 | 1 ^N , 3 ^N | 3и | |
| 9.000 | Boat or N | Notor Vehicle, Sales and Service | Opera | tions | | | | | | | | | | | | | | | |

| | 9.050 | Motor vehicle, mobile home sale or rental | | | | | | | | | 1, | 1, | 3 | 3 | | | | | 1, |
|--------|-----------------------------------|---|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|----------------|------------------------------------|------------------------|----------------|----------------|------------------------------------|------------------------------------|----|
| 9.100 | | hicle repair and maintenance, body work | | | | | | | | | | 3 | | | | | | | 1 |
| 9.200 | Automot | ive fuel station | 3™ | | | | | | | | 3 | 1 | | | | | | | 1 |
| 9.300 | Car wash | | | | | Ī | | | | | 3 | 1 | | | | | | | 1 |
| 9.400 | Boat sale | s or rental | 3 ^T | | | | | | | | 3 | 1 | | | | | 1 | 1 | 1 |
| 9.450 | Boat rep | airs and maintenance | 3 ^T | | | | | | | | | 3 | | | | | 1 | 1 | 1 |
| 9.500 | Marine f | uel, water sanitation | 31 | | | | | | | | | | | | | | 1, | 1, 3 | 1, |
| 9.600 | 1 | ommercial facilities including support, commercial freight, er traffic | 3 | | | | | | | | | | | | | | 3 | 3 | |
| 10.000 | Storage, | Parking, Moorage | | | | | | | | | | | | | | | | | |
| 10.100 | | ile parking garages or parking elated to a principal use on the | | | | | | | | | 3 | 1 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | | | 1 |
| 10.200 | related to | and handling of goods not o sale or use of those goods on lot on which they are stored | | | | | | | | | | | | | | | | | |
| | 10.210 | All storage within completely enclosed structures | 1, 3 | 3 | | | | | | | 3 | 1 | 1 ^U , 3 ^U | 1 ⁰ , 3U | | | 1 ^N , 3 ^N | 1N | 1 |
| | 10.220 | General storage inside or outside enclosed structures | 1, 3 | 3 | | | | | | | | 1, 3 | | | | | 1 ^N , 3 ^N | 1N | 1 |
| | 10.230 | Snow storage basin | | | | | | | | | | | | | | | | | |
| | 10.232 | Neighborhood, less than ½ acre | 3 | 3 | 3 ^z | 1 | | | 3 ^z | 3 ^z | 3 ^z | 1 | 1 |
| | 10.235 | Regional, ½ to 1 acre | 3 | 3 | 3 ^z | | | | | | 3 ^z | 3 | | | | | 3 ^z | 1 | 1 |
| | 10.237 | Area wide, over 1 acre | 3 | 3 ^z | 3 ^z | | 1 | | | | | 3 ^z | | | | | | 3 | 3 |
| 10.300 | equipme where th user of th | of vehicles or storage of int outside enclosed structures ey are owned and used by the ne lot and parking and storage than a minor and incidental use | 1, | 3 | | | | | | | | 1, 3 | | | | | 1 ^N , 3 ^N | 1 ^N , 3 ^N | 1 |

| 10.400 | connecte | ry contractor's storage d with construction project or a specified period of time | 1, 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, 3 | 3 | 3 | 3 | 3 | 3 | 1N | 1 |
|--------|------------------------|---|-----------------------|----------------------|------------------|-----------------------|------------------|------------------|------------------|-----------------------|------------------------------------|------------------------------------|----------------|----------------|----------------|----------------|------------------------------------|------------------------------------|----------------|
| 10.500 | Moorage | | | | | | | | | | | | | | | | | 1 | |
| | 10.510 | Public, commercial | 3 | 3 | 3 | | | | | | 3 | 3 | 3 | 3 | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 |
| | 10.520 | Private | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 |
| 10.600 | | structures supporting seasonal, sial recreation | 3 | 3 | 3 | | | | | | | | | | 3 | 3 | 3 | 3 | |
| 11.000 | Material | s Salvage Yards, Waste Manage | ment | | | | | | | | | | | | | | | | |
| 11.100 | Recycling | operations | | | | | | | | | | | | | | | | | |
| | 11.110 | Enclosed collection structures ^o of less than 80 square feet total and less than six feet in height | 1 ^p | 1 ^P | 1 ^P | 1 ^p | 1 ^p | 1 ^P | 1 ^P | 1 ^p | 1 | 1 | 1 ^p | 1 ^p | 1 ^p | 1 ^p | 1 | 1 | 1 |
| | 11.120 | Enclosed structures for recyclable materials collection | 1 ^p , 3 | 1 ^P ,3 | 1 ^P , | 1 ^p , 3 | 1 ^p , | 1 ^p , | 1 ^p , | 1 ^p , 3 | 1 ^p , 3 ^p | 1 ^p , 3 ^p | 3 | 3 | 3 ^p | 3 ^p | 1 | 1 | 1 ^p |
| | 11.130 | Sorting, storage, preparation for shipment occurring outside an enclosed structure | | | | | | | | | | | | | | | | 1 ^N | 1 |
| 11.200 | Reclamat a specific | tion landfill not associated with use | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1,3 | 1, 3 | | | 3 _N | 3 ^N | 1, 3 |
| 11.300 | Sanitary | landfill | 3 | | | | | | | | | | | | | | | | 3 |
| 12.000 | Services | and Enterprises Related to Anim | nals | | | | | | | | | | | | | | | | |
| 12.100 | Veterina | ry clinic | 3 | 3 | 3 | | | | | | 3 | 1, 3 | 3 | 3 | 3 | 3 | 1 ^N , 3 ^N | 1 ^N , 3 ^N | 1 |
| 12.200 | Kennel | | 3 | 3 | | | | | | | 3 | 3 | | | | | | | 1, |
| 12.250 | Day anim day care | nal services, grooming, walking, | 3 | 3 | 3 | 3 | 3 | | | | 3 | 3 | 3 | 3 | 1, 3 | 1, 3 | | | 1, 3 |
| 12.300 | | uaria, or wild animal ation facilities with a visitor ent | 3 | 3 | | | | | | | 3 | 3 | | 3 | | | 3и | | 3 |
| 12.310 | | nal rehabilitation facilities a visitor component | 3 | 3 | 3 | 3 | | | | | 3 | 3 | | | | | 34 | | 3 |

| 12.400 | Horsebac yards | k riding stables, dog team | 3 | 3 | | | | | | | 3 | 3 | | | | | | | 3 |
|--------|-----------------------|--|----------------------|-----------------|---------|----------|---------|---------|----------|---------|---------|---------|------|------|------|---------|----|----------------|---------|
| 13.000 | Emergen | cy Services | | | | | | | | | | | | | | | | | |
| 13.100 | Fire, poli | ce, ambulance | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3и | 3и | 1, 3 |
| 14.000 | Aquacult | ure, Agriculture, Silviculture, M | lining, (| Quarryi | ng Ope | erations | , Sprin | g Wate | r Bottli | ng | | | | | | | | | |
| 14.100 | Aquacult | ure | 3 | 3 | 3 | | | | | | 3 | 3 | 3 | 3 | 1, 3 | 1, 3 | 1 | 1 | 3 |
| 14.150 | Weirs, ch enhancer | annels, and other fisheries ment | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1, | 1, | 1, | 1, 3 | 1, 3 | 1, 3 | | | 1 | 1 | 1 |
| 14.200 | Commerc | cial agricultural operations | | | | | | | | | | | | | | | | | |
| | 14.210 | Excluding farm animals | 1, 3 | 1, | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | 3 | 3 | | | 1, 3 |
| | 14.220 | Including farm animals ^M | 1, 3 | 3 | | | | | | | | | | | | | | | 1, 3 |
| | 14.230 | Stabling of farm animals ^M | 3 | 3 | 3 | 3 | | | | | 3 | 3 | | | | | | | 1, 3 |
| | 14.240 | Marijuana cultivation (500 square feet or more under cultivation) | 3 | | | | | | | | .3 | 3 | | | | | | | 3 |
| | 14.245 | Marijuana cultivation (fewer than 500 square feet under cultivation) | 3 | 3 ^{AB} | | | | | | | 3 | 3 | | | | | | | 3 |
| 14.250 | Personal | use agriculture | | | | | | | | | | | | | | | | | |
| | 14.253 | Hens, 6 maximum | 1 | 1 | 1 | 1 | 1 | 1 | 3 | 3 | 1 | 1 | 3 | 3 | 1 | 1 | 1 | 1 | 1 |
| 14.300 | Silvicultu | re and timber harvesting ^J | 3 | 3 | | | | | <u> </u> | | | | | | | | | | 3 |
| 14.400 | Mining o | perations | 2, 3 ^K | 3 | 3 | | | | | | | | | | | | 3и | 3 _N | 2 |
| 14.500 | Sand and | gravel operations ¹ | 3 | 3 | 3 | | | | | | 3 | 3 | | | | | 3и | 3и | 3 |
| 14.800 | Spring wa | ater bottling | 3 | 3 | | | 3 | 3 | 3 | 3 | 3 | 3 | | | | 3 | | | 1, 3 |
| 15.000 | Miscellar | neous Public and Semipublic Fa | cilities | | | | | | | | | | | | | | | | |
| 15.100 | Post offi | ce | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, 3 | 1, 3 | 1, | 1, 3 | 1,3 | 1, 3 | 1, 3 | 3и | 3и | 1, 3 |
| 15.200 | Airport | | 3 | | | | | | | | | | | | | | | | 1, 3 |

| 15.400 | Military r | eserve, National Guard | 3 | 3 | 3 | | | | | | 3 | 3 | | | | | 3и | Зи | 3 |
|----------------------|---------------------|--|---------|---------|----|-----|---------|---------|---------|---------|----------|----------|----------------|----------------|------|---------|------------------------------------|------------------------------------|---------|
| 15.500 | Heliports | , helipads | 3 | | | | | | | | | 3 | | | | | 3 ^N | 3и | 3 |
| 15.600 | Transit fa | acilities | | | | | | | | | | | | | | | | | |
| | 15.610 | Transit center | | | 3 | 3 | 3 | 3 | 3 | 3 | 1, | 1, | 1,3 | 1, 3 | 1, 3 | 1, 3 | 3 | | 1, 3 |
| | 15.620 | Transit station | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 15.630 | Park and ride not associated with transit station | 3 | 3 | .3 | 3 | 3 | 3 | 3 | 3 | 1 | 1 | 3 | 3 | | 3 | | | 1 |
| 15.700 | Public wo | orks facility | 3 | 3 | 3 | 3 | | | | | 3 | 3 | | | | | | | 1, |
| 16.000 | | ner, Laundromat | | | | | | | | | | | | | | | | | |
| 16.100 | | and pickup only, no onsite or dry cleaning process | | | | | | | | 1, 3 | 1, 3 | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1 ^N , 3 ^N | 1 ^N , 3 ^N | 1, |
| 16.200 | Full servi | ce onsite laundry and/or dry | | | | | | | | | 3 | 1, | 3 | 3 | 1, 3 | 1,3 | 3и | 1 ^N , 3 ^N | 1, 3 |
| 17.000 | Utility Fa | cilities | | | | | | | | | | | | | | | | | |
| 17.100 | Minor | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 17.150 | Intermed | liate | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, 3 | 3 | 3 | 3 | 3 | 1, 3 | 1 | 1 |
| 17.200 | Major | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | 3 | 3 | 3 | 3 | 3 |
| 17.300 | Driveway | s and private roads | | | | | | | | | | | | | | | | | |
| 18.000 | Towers a | ind Related Structures | | | | | | | | | | | | | | | | | |
| 18.100 ^{AA} | Towers a | nd antennas 35 feet or less | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 18.200 ^{AA} | Towers a | nd antennas 35 to 50 feet | 1 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1 | 1 | 1 | 1 | 3 | 3 | 1 | 1 | 1 |
| 18.300 ^{AA} | Towers a feet in he | nd antennas more than 50 eight | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | 3 | 3 | 1 |
| 18.400 | | (ham) radio towers and more than 35 feet in height ^R | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 18.500 | Wireless | Communication Facilities | | | | See | CBJ 49. | 65, Wir | eless C | ommur | nication | Faciliti | es | • | • | | • | • | |
| 19.000 | Open Air | Markets, Nurseries, Greenhous | ses | | | | | | | | | | | | | | | | |
| 19.100 | | markets (farm, craft, flea, and | 1, 3 | 1, 3 | | | | | | | 1, 3 | 1 | 1,3 | 1, 3 | 1, 3 | 1, 3 | 1 ^N , | 1 ^N , | 1, 3 |
| 19.200 | Nurserie | s, commercial greenhouses | | | | | | | | | | | | | | | | | |
| | 19.210 | Retail sales | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 1, 3 | 1 | 1 ^v | 1 ^v | 1, 3 | 1, 3 | | | 1 |

| | 19.220 Nonretail sales | 1 | 1, | 1, 3 | 1, 3 | 1, | 1, | 1, 3 | 1, 3 | 1, 3 | 1, 3 | 1 | 1 ^v | 1 ^v | | | | | 1 |
|--------|--|-------------------|--------|-----------------|---------|----|----|---------|---------|---------|---------|---|----------------|----------------|------|---------|----|---|---------|
| | 19.230 Marijuana culti square feet or cultivation) | | 3 | | | | | | | | 3 | 3 | | | | | | | 3 |
| | 19.240 Marijuana culti than 500 squar cultivation) | | 3 | 3 ^{AB} | | | | | | | 3 | 3 | | | | | | | 3 |
| 20.000 | Cemetery, Crematorium, | Mortuary | | | | | | | | | | | | | | | | | |
| 20.100 | Cemetery | 1 3 | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | | | | | |
| 20.200 | Crematorium | 3 | 3 | | | | | | | | | | | | | | | | 1, 3 |
| 20.300 | Funeral home | 3 | 3 | 3 | 3 | 3 | 3 | 3 | | | 1, 3 | 1 | 3 | 3 | 1, 3 | 1, 3 | | | |
| 21.000 | Visitor-Oriented, Recreat | ional Facilities | | | | | | | | | | | | | | | | | |
| 21.100 | Resort, lodge | 3 | 3 | 3 | | | | | | | | | | | | | | | |
| 21.200 | Campgrounds | 1 3 | 1, | 3 | | | | | | | | | | | | | | | |
| 21.300 | Visitor, cultural facilities r features of the site | elated to 3 | 3 | 3 | | | | | | | 3 | 3 | 3 | 3 | 3 | 3 | 3и | | |
| 22.000 | Temporary Structures As | sociated With Ons | site C | onstru | ction | | | | | | | | | | | | | | |
| 22.100 | Temporary structures use connection with construction | | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |

Key:

- 1. Department approval requires the department of community development approval only.
- 1,3. Department approval required if minor development, conditional use permit required if major development.
- 2. Allowable use permit requires planning commission approval.
- 3. Conditional use permit requires planning commission approval.
- 2, 3. Allowable use permit required if minor development, conditional use permit required if major development.

Notes:

- A. A single-family residence is allowed as an owner or caretaker residence that is accessory to an existing permitted use in the industrial zone.
- B. Reserved.

Created: 2022-10-12 14:40:39 [EST]

- C. Reserved.
- D. Reserved.
- E. See special use regulations for mobile homes, chapter 49.65, article III.
- F. See special use regulations for recreational vehicles, chapter 49.65, article IV. This use allowed by service area designation not zoning district.
- G. All uses subject to additional performance standards, chapter 49.65, article VIII.
- H. Reserved.
- Reserved.
- Applies to over 2 acres of harvest area.
- K. See special use regulations, chapter 49.65, article I. Mining operations are a conditional use in the urban mining district and an allowable use in the rural mining district.
- L. See special use regulations, chapter 49.65.200, article II.
- M. Only applicable to the commercial or private stabling of more than three farm animals, or where the running or stabling area is closer than 100 feet to the nearest residence other than the owner for any number of farm animals.
- N. Use must be water-dependent, water-related, or water-oriented.
- O. Standards for collection structures: containers must be well maintained and allow no spillage of contents; a specific person or group must be responsible for maintenance of the structure and that person or group shall have a contact telephone number posted on the collection structure; collection structure must be situated so as to not affect traffic or parking; directional signs shall be limited to six square feet and identification signs shall be limited to 24 square feet; such signs will not be included in total sign area allowed for a complex; and the structure shall not exceed a height of six feet. Identification is to be in the following format: greater prominence, the City and Borough recycling logo and the recyclable material identification; lesser prominence, the sponsor name and the contact phone number.
- P. Preexisting allowable or conditional use permit: If recycling activity is determined by the director to be an accessory use to a use previously permitted under either an allowable or a conditional use permit, the activity may be approved by the department. Other conditions may be required before recycling activity is permitted.
- Q. Must be in conjunction with an approved state or municipal public road construction project, and must be discontinued at the completion of the project. Road construction by private parties for subdivision development is excluded except as provided in this title. Rock crushed on-site must be used on-site. Crushing shall be limited to 8:00 a.m.—5:00 p.m. unless the director authorizes otherwise.
- R. Towers shall: be for amateur use only; meet the setback requirements of the zoning district; be unlit except as required by the Federal Aviation Administration. Towers shall be installed in conformance with a valid building permit, application for which shall include a copy of the applicant's amateur station license.
- S. Limited to lots directly fronting on Glacier Highway West of Industrial Boulevard.
- T. Must be associated with a unique site specific feature in order to function. Example: Glacier research station Juneau Icefield location.
- U. No storage permitted on the first floor of a building.
- V. Primarily intended for rooftop locations in urban areas.
- W. The capacity of a park shall be determined by the Director of the Community Development Department or designee in consultation with the Director of the Parks and Recreation Department.
- X. Special requirements apply to accessory apartment applications. See CBJ § 49.25.510(k).

- Z. Snow storage may be permitted for a maximum of five years. After five years a new application must be filed.
- AA. Does not apply to wireless communication facilities.
- AB. Use is prohibited in the urban service area but allowed outside the urban service area. An owner or manager must live on site.
- AC. Use is prohibited within 1,000 feet of recognized neighborhood association established in accordance with CBJ chapter 11.35.

(Serial No. 2002-14, § 2, 4-1-5-2002; Serial No. 2002-29, § 2, 11-4-2002; Serial No. 2003-27am, § 5, 6-16-2003; Serial No. 2003-41, § 2, 9-22-2003; Serial No. 2003-41, § 2, 9-8-2003; Serial No. 2004-09, § 2, 4-12-2004; Serial No. 2006-07, § 2, 4-3-2006; Serial No. 2007-39, § 8, 6-25-2007; Serial No. 2009-22(b), § 2, 10-12-2009; Serial No. 2010-22, § 3(Exh. A), 7-19-2010; 2014-32(e)am, § 6—8, 9-29-2014, eff. 10-29-2014; Serial No. 2015-07(b)(am), § 2—4, 2-23-2015, eff. 3-26-2015; Serial No. 2015-34(am), § 2, 7-20-2015, eff. 8-20-2015; Serial No. 2015-03(c)(am), § 19, 8-31-2015; Serial No. 2015-32, § 2, 3, 8-10-2015; Serial No. 2015-38(b)(am), § 6, 5-2-2016, eff. 6-2-2016; Serial No. 2015-39(am), § 2—7, 11-9-2015; Ord. No. 2018-31, § 2, 6-4-2018, eff. 7-5-2018; Serial No. 2021-35(am), § 3(Exh. A), 2-7-2022, eff. 3-10-2022)

Created: 2022-10-12 14:40:39 [EST]

49.25.400 Minimum dimensional standards.

There is adopted the table of minimum dimensional standards, table 49.25.400. Minimum dimensional standards for all zoning districts shall be according to the table of minimum dimensional standards, subject to the limitations of the following sections and as otherwise specifically noted in the special area or use sections, chapters 49.65 and 49.70.

(Serial No. 87-49, § 2, 1987; Serial No. 89-32, § 2, 1989; Serial No. 98-09, § 5(Exh. B), 1998; Serial No. 98-20, § 2(Exh. A), 1998; Serial No. 2004-13, § 2, 9-27-2004; Serial No. 2006-13, § 2, 5-15-2006; Serial No. 2007-13, § 2, 4-2-2007; Serial No. 2012-24, § 3, 5-14-2012, eff. 6-14-2012; Serial No. 2021-28, § 4, 8-23-2021, eff. 9-22-2021)

TABLE 49.25.400

TABLE OF DIMENSIONAL STANDARDS

| 50000000000 | ning | RR | D-1 | D-3 | D-5 | D-10 | D-10 | D-15 | D-18 | MU | MU2 | MU3 | NC | LC | GC | wc | WI | 1 |
|-------------|---|--------|--------|--------|--------|---------------------|-------|-------|-------|-------|-------|-----------------|-------|-------|-------|----------|-------|-------|
| Re | gulations | | | | | SF | | | | | | | | | | | | |
| | linimum Lot ze ¹ | | | | | | | | | | | | | | | | | |
| | Permissible Uses | 36,000 | 36,000 | 12,000 | 7,000 | 3,600 ¹⁰ | 6,000 | 5,000 | 5,000 | 4,000 | 4,000 | 3,000 | 3,000 | 2,000 | 2,000 | 2,000 | 2,000 | 2,000 |
| П | Bungalow ⁹ | | 18,000 | 6,000 | 3,500 | 2,500 | 3,000 | 3,000 | 2,500 | | | | | | | | | |
| П | Duplex | 54,000 | 54,000 | 18,000 | 10,500 | | | | | | | | | | | | | |
| | Common Wall Dwelling | | | | 7,000 | 3,600 ¹⁰ | 5,000 | 3,500 | 2,500 | | 2,500 | | | | | | | |
| | Single- family detached, two dwellings per lot | 72,000 | 72,000 | 24,000 | | | | | | | | | | | | | | |
| | linimum lot dth | 150′ | 150′ | 100′ | 70′ | 40' | 50' | 50' | 50′ | 50′ | 50′ | 40 ¹ | 40' | 20′ | 20' | 20′ | 20' | 20' |
| П | Bungalow ⁹ | | 75' | 50' | 35' | 25' | 25' | 25' | 25' | | | | | | | <u> </u> | | |
| | Common wall dwelling | | | | 60′ | 40' | 40' | 30′ | 20′ | | 20′ | | | | | | | |
| 1 | laximum lot verage | | | | | | | | | | | | | | | | | |
| | Permissible uses | 10% | 10% | 35% | 50% | 50% | 50% | 50% | 50% | None | 80% | 75% | None | None | None | None | None | None |
| | Conditional uses | 20% | 20% | 35% | 50% | 50% | 50% | 50% | 50% | None | 80% | | | None | None | None | None | None |

Created: 2022-10-12 14:40:39 [EST]

| Maximum height permissible | 45′ | 35′ | 35' | 35' | 35' | 35′ | 35' | 35' | None | 45′4 | 35' | 35' | 45' | 55' | 35′4 | 45′4 | None |
|---|-----------------|-----|-----|------|-------|-----------------|-----|-----------------|------|-----------------|-----|------|-----|-----|------|------|------|
| uses | | | | | | | | İ | | | | | | | | | |
| Accessory | 45′ | 25′ | 25′ | 25′ | 25' | 25' | 25′ | 25′ | None | 35′ | 25' | 25' | 35' | 45′ | 35′4 | 45′4 | None |
| Bungalow ⁹ | | 25′ | 25' | 25′ | 25' | 25' | 25' | 25′ | | | | | | | | | |
| Minimum front yard setback ³ | 25′ | 25′ | 25′ | 20′ | 20′¹0 | 20′ | 20' | 20′ | 0' | 5′5,8 | 0' | 0, | 25' | 10' | 10′ | 10′ | 10' |
| Maximum front yard setback | | | | | | | | | | | 20′ | 15′ | | | | | |
| Minimum street side yard setback | 17′ | 17′ | 17' | 13′ | 10′ | 13' | 13′ | 13' | 0' | 5′ | 0' | 0' | 17' | 10' | 10' | 10' | 10' |
| Maximum street side yard setback | | | | | | | | | | | 15′ | 10′ | | | | | |
| Minimum rear yard setback ³ | 25 ² | 25' | 25' | 20' | 10′ | 20′ | 15' | 10′ | 0′ | 5′ | 5' | 0'11 | 10' | 10′ | 10′ | 10′ | 10′ |
| Minimum side yard setback ³ | 15′² | 15′ | 10′ | 5′ | 3' | 5′ | 5′ | 5′ | 0' | 5′ | 0' | 0'11 | 10' | 10′ | 10' | 10' | 0' |
| Common wall dwelling | | | | 10′6 | 3' | 5′ ⁷ | 5′7 | 5′ ⁷ | | 5′ ⁷ | | | | | | | |

Notes:


- 1. Minimum lot size is existing lot or area shown on chart in square feet.
- 2. Sixty feet between nonresidential and designated or actual residential site; 80 feet between industrial, extractive and other uses.
- 3. Where one district abuts another the greater of the two setbacks is required for both uses on the common property line.
- 4. (Height Bonus) Reserved.

Created: 2022-10-12 14:40:39 [EST]

- 5. (Pedestrian Amenities Bonus) Reserved.
- 6. Zero-foot setback for the portion of the dwelling with a common wall, five-foot setback or five-foot wide easement for the portion of the dwelling at the common lot line without a common wall, and ten-foot setback for the remaining side yards of the lot.
- 7. Zero-foot setback for the portion of the dwelling with a common wall, five-foot setback or five-foot wide easement for the portion of the dwelling at the common lot line without a common wall, and five-foot setback for the remaining side yards of the lot.
- 8. On corner lots, buildings shall be set back 15 feet from a street intersection. The area in which buildings shall be prohibited shall be determined by extending the edge of the traveled ways to a point of intersection, then measuring back 15 feet, then connecting the points.
- 9. Special restrictions apply to construction on bungalow lots. See special use provisions 49.65.600.
- 0. For lots adjacent to an alley, the following reductions to the dimensional standards apply:
 - (a) Minimal lot area includes 50% of adjacent alley (see graphic).
 - (b) Reserved.
 - (c) Minimum front yard setback of ten feet.
- 11. Additional setbacks apply when lot abuts a multi-family or single-family residential zoning district.

(Serial No. 2008-04, § 2, 2-25-2008, eff. 3-27-2008; Serial No. 2012-24, § 3, 5-14-2012, eff. 6-14-2012; Serial No. 2021-28, § 4, 8-23-2021, eff. 9-22-2021; Serial No. 2021-35(am), § 4(Exh. B), 2-7-2022, eff. 3-10-2022)

Created: 2022-10-12 14:40:39 [EST]

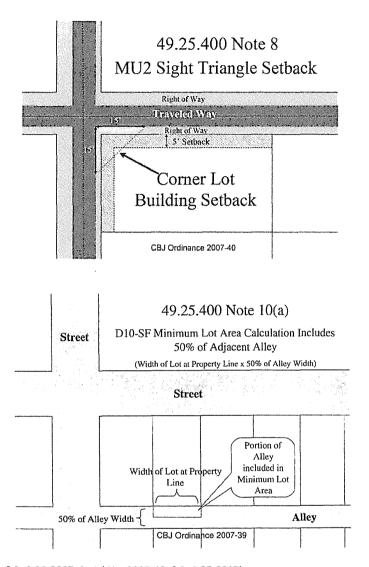


(Serial No. 2007-39, § 9, 6-25-2007; Serial No. 2007-40, § 2, 6-25-2007)

Measuring or Calculating Building Height: CBJ 49.25.420

- (a) The height of a building is the vertical distance above a reference datum measured to the highest point of the coping of a flat roof or to the deck line of a mansard roof or to the average height of the highest gable of a pitched or hipped roof. Roofs with slopes greater than 75 percent shall be regarded as walls. The height of a stepped or terraced building is the height of the highest segment thereof.
- (b) The reference datum shall be whichever of the following yields the greater height of building:
 - (1) The highest point within a horizontal distance of five feet from the exterior wall of the building, when such point is not more than ten feet above the lowest point within said five-foot radius.
 - (2) An elevation ten feet higher than the lowest point, when the highest point described in subsection (b)(1) of this section is more than ten feet above the lowest point.

Note that the complete text of this section is not reproduced here—as always, refer to the full text of the current edition of the Code!

The graphic below is taken from the 1997 UBC Code Applications Manual. It is not adopted as part of CBJ Code, but it does show graphically what the adopted text says:

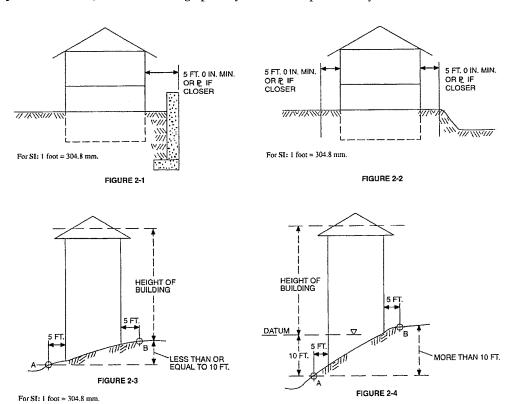

DETERMINATION OF BUILDING HEIGHT IN FEET

49.25.510 Special density considerations.

- (a) Fractions of units. If a density calculation results in fractions of dwelling units allowable, such fractions shall be rounded to the nearest whole number.
- (b) Factors precluding maximum density. The number of units allowed by section 49.25.500 is a maximum, achievement of which may be prevented by other factors, including topography, dimensional standards or dedication requirements.
- (c) Mobile home subdivisions. Mobile home subdivisions shall meet the density requirements of the zoning district in which they are located, regardless of the lot size allowed.
- (d) Two-unit dwellings.
 - (1) Duplexes. The minimum lot size for a duplex dwelling shall be at least 150 percent of the square footage required for a single-family dwelling in the same zoning district, except in multi-family, mixeduse, and commercial zoning districts, where duplexes may be constructed on any lot of sufficient size for two dwelling units.
 - (2) Reserved.
- (e) Detached single-family dwellings. Two detached single-family dwellings located on a single lot within the Rural Reserve D1 and D3 zoning districts shall each meet 100 percent of the applicable square-footage requirement.
 - (f) Reserved.
- (g) Duplex and common wall structures. The commission, through the conditional use permit process, may allow duplex and common wall structures on lots of less than the required size if the applicant can demonstrate that the same number of dwelling units already exist on the lot or may lawfully be created on the lot as a result of the nonconforming development provisions of chapter 49.30. Applications of this provision include the following:
 - (1) Common wall subdivision lots of less than the required size may be created if the original parcel contains a common wall structure that was lawfully built and all other common wall structure requirements can be met.
 - (2) A duplex or a two unit common wall structure may be built on a pair of existing lots of record which together are less than the required size for a duplex or a two unit common wall structure, provided each of the lots could have been developed with a single-family dwelling when the lots were created.
- (h) Building a two unit common wall structure. The commission, through the conditional use permit process, may approve the building of a two unit common wall structure on less than the required lot area if the lot was legally platted prior to November 9, 1987; the subdivision or a portion thereof was designed specifically for two unit common wall structures; and 60 percent or more of the lots in the subdivision or of the portion thereof designed specifically for two unit common wall structures have been developed with two unit common wall structures.
- (i) Subdivision rights-of-way. In calculating the number of dwelling units and thereby the number of lots allowed within a proposed single-family subdivision, any proposed rights-of-way shall be included in the total square footage of the parcel. In multifamily subdivisions, rights-of-way shall not be so included.
- (j) Single-room occupancies with private facilities. A permit to construct single-room occupancies may be issued by the Director or the Planning Commission, as specified in the Table of Permissible Uses, CBJ 49.25.300, if all of the requirements of this subsection are met.
 - (1) Single-room occupancies shall be efficiency units not exceeding 400 square feet in net floor area.

- (A) Areas common to more than one dwelling unit, including entry ways, furnace rooms, laundry rooms, common storage areas, and interior stairways, shall not be included in the computation of net floor area.
- (2) Each single-room occupancy with private facilities shall count as one-half of a dwelling unit for purposes of calculating density, permitting requirements, and land use permit application fees.
- (k) Accessory apartments. No person shall construct or maintain an accessory apartment except in accordance with a permit issued under this section.
 - Application. Accessory apartment applications shall be submitted on a form provided by the director and shall include:
 - (A) A completed application form;
 - (B) The application fee required by chapter 49.85;
 - (C) A site plan drawn to scale or dimensioned indicating all required parking, minimum setbacks, and actual lot size; and
 - (D) A floor plan drawn to scale or dimensioned indicating all dwelling units and including each room labeled as to use:
 - (E) A statement that the property is connected to sewer. If the property is not connected to sewer, a statement from the department of environmental conservation confirming that the existing wastewater disposal system is sufficient for the development, including the proposed accessory apartment, and a statement from a qualified inspector that the existing wastewater disposal system is functioning as designed.
 - (2) Approval standards.
 - (A) Unless otherwise provided, the accessory apartment shall be a one-bedroom or efficiency unit not exceeding 600 square feet in net floor area.
 - (B) Areas common to more than one dwelling unit including entry ways, furnace rooms, laundry rooms, and interior stairways - shall not be included in the computation of the net floor area for the accessory apartment.
 - (C) The minimum lot size as used in this section refers to the minimum lot size for permissible uses listed in the table of dimensional standards, CBJ 49.25.200.
 - (D) A permit under this subsection may be issued if the applicant establishes:
 - (i) The development meets all setback requirements;
 - (ii) The total building footprint does not exceed the maximum lot coverage allowable under section 49.25.400, the table of dimensional standards, or, in the case of nonconforming structures, the total building footprint does not increase with the proposed accessory apartment;
 - (iii) The development does not violate the vegetative cover requirements imposed by section 49.50.300; or, in the case of nonconforming structures, the proposed accessory apartment does not decrease the existing vegetative cover;
 - (iv) The development meets the parking standards required by chapter 49.40; and
 - (v) The development is connected to public sewer or the existing wastewater disposal system has adequate capacity for the development, including the proposed accessory apartment.
 - (E) Single-family detached accessory apartment approval.

- (i) The director may approve a 49.25.300.1.130 accessory apartment application if all of the requirements of this section and the following are met:
 - (a) The application is for an efficiency or one-bedroom unit that does not exceed 600 square feet in net floor area and is on a lot that exceeds the minimum lot size; or
 - (b) The application is for an efficiency, one-bedroom, or two-bedroom unit that has a net floor area equal to or less than 50 percent of the primary dwelling unit's net floor area but not to exceed 1,000 square feet, and is on a lot that exceeds 125 percent of the minimum lot size.
- (ii) The commission may approve, with a conditional use permit, a 49.25.300.1.130 accessory apartment application if all of the requirements of this section and the following are met:
 - (a) The application is for an efficiency or one-bedroom unit that does not exceed 600 square feet in net floor area, and is on a lot that is less than the minimum lot size; or
 - (b) The application is for an efficiency, one-bedroom, or two-bedroom unit that has a net floor area equal to or less than 50 percent of the primary dwelling unit's net floor area but not to exceed 1,000 square feet, and is on a lot that exceeds 125 percent of the minimum lot size.
- (iii) An application for an accessory apartment with a net floor area that exceeds 600 square feet shall not be approved on a lot that is less than 125 percent of the minimum lot size.
- (F) Single-family detached, two dwellings per lot, accessory apartment approval.
 - (i) When a lot has two primary dwelling units, each primary dwelling unit may have up to one accessory apartment that is consistent with the requirements of this section. The lot shall not have more than two accessory apartments.
 - (ii) An application for an accessory apartment with a net floor area that exceeds 600 square feet shall not be approved on a lot that is less than 250 percent of the minimum lot size.
 - (iii) The director may approve a 49.25.300.1.140 accessory apartment application if all of the requirements of this section and the following are met:
 - (a) The application is for an efficiency, or one-bedroom unit that does not exceed 600 square feet in net floor area, is on a double sized lot (two times the minimum lot size), and the lot does not have another accessory apartment in excess of 600 square feet in net floor area; or
 - (b) The application is for an efficiency, one-bedroom, or two-bedroom unit that has a net floor area equal to or less than 50 percent of the primary dwelling unit's net floor area but not to exceed 1,000 square feet, on a lot that exceeds 250 percent of the minimum lot size, and the lot does not have more than one other accessory apartment in excess of 600 square feet in net floor area.
 - (iv) The commission may approve, with a conditional use permit, a 49.25.300.1.140 accessory apartment application if all of the requirements of this section and the following are met:
 - (a) The application is for an efficiency, or one-bedroom unit that does not exceed 600 square feet in net floor area, is on a lot that is less than the minimum lot size, and the lot does not have another accessory apartment in excess of 600 square feet in net floor area;

- (b) The application is for an efficiency, one-bedroom, or two-bedroom unit that has a net floor area equal to or less than 50 percent of the primary dwelling unit's net floor area but not to exceed 1,000 square feet, is on a lot that exceeds 250 percent of the minimum lot size, and where the lot does not have more than one other accessory apartment in excess of 600 square feet in net floor area.
- (G) Multifamily dwelling and accessory apartment approval. Unless authorized by this section, an accessory apartment is prohibited in multifamily, commercial, and mixed-use zoning districts.
 - (i) The director may approve a 49.25.300.1.300 accessory apartment application if all the requirements of this section and the following are met:
 - (a) The application is for an efficiency, or one-bedroom unit that does not exceed 600 square feet in net floor area, is on a lot that exceeds the minimum lot size, and the primary use of the lot is a single-family dwelling.
 - (ii) The commission may approve, with a conditional use permit, a 49.25.300.1.300 accessory apartment application if all of the requirements of this section and the following are met:
 - (a) The application is for an efficiency, or one-bedroom unit that does not exceed 600 square feet in net floor area, is on a lot that is less than the minimum lot size, and the primary use of the lot is a single-family dwelling.
- (H) Common wall accessory apartment approval.
 - (i) Each common wall dwelling may have up to one accessory apartment that does not exceed 600 square feet in net floor area and that is consistent with the requirements of this section.
 - (ii) The director may approve a 49.25.300.1.911 accessory apartment application if all of the requirements of this section and the following are met:
 - (a) The application is for an efficiency, or one-bedroom unit that does not exceed 600 square feet in net floor area, and is on a lot that exceeds the minimum lot size.
 - (iii) The commission may approve, with a conditional use permit, a 49.25.300.1.911 accessory apartment application if all of the requirements of this section and the following are met:
 - (a) The application is for an efficiency, or one-bedroom unit that does not exceed 600 square feet in net floor area, and is on a lot that is less than the minimum lot size.

(Serial No. 87-49, § 2, 1987; Serial No. 89-33, § 2, 1989; Serial No. 91-01, § 2, 1991; Serial No. 94-07, § 4, 1994; Serial No. 95-33, § 8, 1995; Serial No. 97-49, § 3, 1998; Serial No. 2001-12, § 3, 4-2-2001; Serial No. 2006-15, § 5, 6, 6-5-2006; Serial No. 2007-39, § 11, 6-25-2007; Serial No. 2009-22(b), § 3, 10-12-2009; Serial No. 2012-24, § 4, 5-14-2012, eff. 6-14-2012; Serial No. 2012-36, § 3, 9-17-2012; Serial No. 2015-7(b)(am), § 5, 2-23-2015, eff. 3-26-2015; Serial No. 2019-37, § 4, 3-16-2020, eff. 4-16-2020)

49.35.250 Access.

- (a) Principal access to the subdivision. Except as provided below, the department shall designate one right-of-way as principal access to the entire subdivision. Such access, if not already accepted for public maintenance, shall be improved to the applicable standards for public acceptance and maintenance. It shall be the responsibility of the subdivider to pay the cost of the right-of-way improvements.
 - (1) Principal access to remote subdivisions. The department shall designate the principal access to the remote subdivision. Such access may be by right-of-way.
- (b) Publicly maintained access within a subdivision. Unless otherwise provided in this section or in 49.15.420(a)(1), all lots must satisfy the minimum frontage requirement and have direct and practical access to the right-of-way through the frontage. The minimum frontage requirement on a right-of-way is 30 feet or the minimum lot width for the zoning district or use as provided in CBJ 49.25.400. These requirements for frontage and access can be accomplished by:
 - (1) Dedication of a new right-of-way with construction of the street to public standards. This street must connect to an existing publicly maintained street;
 - (2) Use of an existing publicly maintained street;
 - (3) Upgrading the roadway within an existing right-of-way to public street standards. This existing right-of-way must be connected to another publically maintained street; or
 - (4) A combination of the above.
- (c) Privately maintained access within a subdivision. Lots shall front and have direct access to a publically maintained street except as:
 - (1) Privately maintained public access. A subdivision may create new lots served by a privately maintained access within a public right-of-way not maintained by an agency of government as provided by CBJ 49.35, article II, division 3. All lots must have either a minimum of 30 feet of frontage on a right-of-way, or the minimum lot width for the zoning district or use as provided in CBJ 49.25.400.
 - (2) Private shared access. A lot in a subdivision is exempt from having the minimum frontage on a public right-of-way when a shared access is approved pursuant to CBJ 49.35, article II, division 2. All lots served by a shared access shall have a minimum of 30 feet of frontage on the shared access.
- (d) Remote subdivisions accessible by navigable waterbodies. All lots in a remote subdivision solely accessible by navigable waterbodies must have a minimum of 30 feet of frontage on, and direct and practical access to, either the navigable water or a right-of-way. The right-of-way must have direct and practical access to the navigable water.
- (e) Access within remote subdivisions accessible by pioneer paths. All lots must either have direct and practical access with a minimum of 30 feet of frontage on the right-of-way, or the minimum lot width for the zoning district or use as provided in CBJ 49.25.400.

(Serial No. 2016-26(b), § 9, 4-3-2017, eff. 5-3-2017)

49.40.200 General applicability.

Developers must provide off-street parking spaces for automobiles in accordance with the requirements set forth in this chapter at the time any structure is erected, expanded, or when there is a change in the principal use.

(a) Special parking areas.

- (1) Town center parking area. The town center parking area, as depicted in Ordinance 2022-04(b) is adopted. The town center parking area consists of the lots within the area bound by West Tenth Street, Egan Drive, West Twelfth Street, D Street, West Ninth Street, C Street and its projection, West Eight Street and its projection, the rear lot lines of property between 370 through Distin Avenue, Sixth Street and its projection, Harris Street, projection of Third Street, projection of East Street, projection of Second Street, projection of Harris Street, the rear lot lines of property between 143 and 400 Gastineau Avenue, the rear lot lines of property between 511 and 889 South Franklin Street, and Gastineau Channel.
- (2) No parking required area. The no parking required area, as depicted in Ordinance 2022-04(b) is adopted. The lots within the area bound by Gastineau Avenue, Fourth Street, Seward Street, Gastineau Channel, 490 South Franklin Street, and Layton Way are excluded from the parking requirements of this chapter. No additional parking is required for development in this area.
- (b) Conforming parking. The requirements, alternatives and reductions of this chapter can be combined to meet parking requirements of a development.
- (c) Developer responsibility. Developer must submit documentation to demonstrate that applicable parking code requirements have been met, in conformance with this chapter.
- (d) Owner/occupant responsibility. The provision and maintenance of off-street parking and loading spaces required in this chapter is a continuing obligation and joint responsibility of the owner and occupants.
- (e) Determination. The determination of whether the parking requirements of this chapter are satisfied, with or without conditions, and deemed necessary for consistency with this title, must be made by:
 - (1) The director for minor development;
 - (2) The commission for major development; or
 - (3) The commission if the development application relates to a series of applications for minor developments that, taken together, constitute major development, as determined by the director.
- (f) Expansion. In cases of expansion of a structure on or after the effective date of Ordinance 2022-04(b):
 - The number of additional off-street parking spaces required must be based on the gross floor area added.
 - (2) No additional parking spaces are required if the additional spaces would amount to less than ten percent of the total required for the development and amount to two or less spaces.
 - (3) For phased expansion, the required off-street parking spaces is the amount required for the completed development, as determined by the director.
- (g) Change in use. In cases of a change in use on or after the effective date of Ordinance 2022-04(b), the number of spaces required will be based on this chapter.
- (h) Replacement and reconstruction of certain nonconforming structures. Off-street parking requirements for the replacement and reconstruction of certain nonconforming structures in residential districts must be governed by chapter 49.30.

- - (i) Mixed occupancy. Mixed occupancy is when two or more of the parking uses in section 49.40.210 share the same lot(s). For mixed occupancy, the total requirement for off-street parking facilities is the sum of the requirements for the uses computed separately.
 - (j) Uses not specified. The requirements for off-street parking in section 49.20.320 are based on the requirements for the most comparable use specified, as determined by the director for minor development or by the commission for major development.
 - (k) Location. Off-street parking facilities must be located as provided in this chapter. If a distance is specified, such distance is the walking distance measured from the building being served to the parking provision. Off-street parking facilities for:
 - (1) Single-family dwellings and duplexes must be on the same lot as the building served;
 - (2) Multifamily dwellings may not be more than 100 feet distant, unless compliant with section 49.40.215; and
 - (3) Uses other than those specified above, may be not more than 500 feet distant, unless compliant with section 49.40.215.
 - (I) Off-street parking requirements for a lot accessible by air or water only. Off-street parking requirements do not apply to a lot if it is accessible only by air or water. If the director determines that public access by automobile to the lot later becomes available, the owner of the property must be given notice and within one year must provide the required off-street parking.

(Serial No. 2022-04(b), § 2, 4-25-2022, eff. 5-26-2022)

49.40.210 Number of off-street parking spaces required.

(a) General. The minimum number of off-street parking spaces required must be as set forth in the following table. The number of spaces must be calculated and rounded down to the nearest whole number:

| Use | Spaces Required in All Other Areas | Spaces Required in Town Center Parking Area |
|---|---|--|
| Single-family and duplex | 2 per each dwelling unit | 1 per each dwelling unit |
| Multifamily units | 1 per one bedroom unit | 0.4 per one bedroom unit |
| | 1.5 per two-bedroom unit | 0.6 per two-bedroom unit |
| | 2.0 per three- or more bedroom unit | 0.8 per three- or more bedroom unit |
| Rooming house, boardinghouse, single-room occupancies with shared facilities, bed and breakfast, halfway house, and group home | 1 per 2 bedrooms | 1 per 5 bedrooms |
| Single-room occupancies with private facilities | 1 per each single-room occupancy plus 1 additional per each increment of four single-room occupancies with private facilities | 1 per 5 single-room occupancies, plus 1 per each increment of ten single-room occupancies with private facilities. |
| Accessory apartment | 1 per each unit | 0 per each unit |
| Motel | 1 per each unit in the motel | 1 per each 12 units in the motel |
| Hotel | 1 per each four units | 1 per each 12 units |
| Hospital and nursing home | 2 per bed OR one per 400 square feet of gross floor area | 2 per bed OR one per 400 square feet of gross floor area |
| Senior housing | 0.6 parking spaces per dwelling unit | 0.3 spaces per dwelling unit |
| Assisted living facility | 0.4 parking spaces per maximum number of residents | 0.4 parking spaces per maximum number of residents |
| Sobering center | 1 parking space per 12 beds | 2 parking spaces |
| Theater | 1 for each four seats | 1 for each 10 seats |
| Church, auditorium, and similar enclosed places of assembly | 1 for each four seats in the auditorium | 1 for each 10 seats in the auditorium |
| Bowling alley | 3 per alley | 1.2 per alley |
| Bank, office, retail commercial, salon and spa | 1 per 300 square feet of gross floor area | 1 per 750 square feet of gross floor area |
| Medical or dental clinic | 1 per 200 square feet of gross floor area | 1 per 400 square feet of gross floor area |
| Funeral Home | 1 per six seats based on maximum seating capacity in main auditorium | 1 per 15 seats based on maximum seating capacity in main auditorium |
| Warehouse, storage, and wholesale businesses | 1 per 1,000 square feet of gross floor area | 1 per 2,500 square feet of gross floor area |
| Restaurant and alcoholic beverage dispensary | 1 per 200 square feet of gross floor area | 1 per 750 square feet of gross floor area |
| Swimming pool serving general public | 1 per four persons based on pool capacity | 1 per 10 persons based on pool capacity |

| Shopping center and mall | 1 per 300 square feet of gross | 1 per 750 square feet of gross floor area |
|--------------------------------|--|---|
| Canadiana | leasable floor area 49.65 Article V | 1 750 |
| Convenience store | | 1 per 750 square feet of gross floor area |
| Watercraft moorage | 1 per three moorage stalls | 2 per 15 moorage stalls |
| Manufacturing uses; | 1 per 1,000 square feet gross floor | 1 per 2,500 square feet gross floor area |
| research, testing and | area except that office space must | except that office space must provide |
| processing, assembling, | provide parking as required for | parking as provided for offices |
| industry Library and museum | offices 1 per 600 square feet gross floor | 1 1 500 f f fl |
| Library and museum | area | 1 per 1,500 square feet of gross floor area |
| School, elementary | 2 per classroom | 2 per classroom |
| Middle school or junior high | 1.5 per classroom | 1.5 per classroom |
| High school | | |
| HIGH SCHOOL | A minimum of 15 spaces per school; where auditorium or general | A minimum of 15 spaces per school; where auditorium or general assembly |
| | assembly area is available, one per | area is available, one per four seats; one |
| | four seats; one additional space per | additional space per classroom |
| | classroom | additional space per classicom |
| College, main campus | 1 per 500 square feet of gross floor | 1 per 500 square feet of gross floor area |
| conege, mani campus | area of an enclosed area, or, where | of an enclosed area, or, where |
| | auditorium or general assembly | auditorium or general assembly area is |
| | area is available, one per four seats, | available, one per four seats, whichever |
| | whichever is greater | is greater |
| College, satellite facilities | 1 per 300 square feet of gross floor | 1 per 300 square feet of gross floor area |
| | area of an enclosed area, or, where | of an enclosed area, or, where |
| | auditorium or general assembly | auditorium or general assembly area is |
| | area is available, one per four seats, | available, one per four seats, whichever |
| | whichever is greater | is greater |
| Repair/service station | 5 spaces per bay. For facilities with | 3 spaces per bay. All but two of the |
| | two or more bays, up to 60 percent | required non-accessible parking spaces |
| | of the required non-accessible | may be in a stacked configuration |
| | parking spaces may be in a stacked | |
| | parking configuration. | |
| Post office | 1 per 200 square feet gross floor | 1 per 500 square feet of floor area |
| ** | area | |
| Childcare Home | 49.65 Article X, cannot be varied or | 49.65 Article X, cannot be varied or FIL |
| | FIL | |
| Childcare Center | 49.65 Article X, cannot be varied or | 49.65 Article X, cannot be varied or FIL |
| | FIL | |
| Indoor sports facilities, gyms | 1 per 300 square feet gross floor | 1 per 750 square feet gross floor area |
| | area | |
| Mobile Food Vendors | No parking requirement | No parking requirement |
| Open air food service (TPU | 1 per 400 square feet of gross floor | Zero |
| 8.3) | area. | |

(b) Accessible parking spaces. Accessible parking spaces must be provided as part of the required off-street parking spaces, according to the following table (Table 49.40.210(b)). Except, Accessible parking spaces are not required for residential uses that require fewer than ten parking spaces and there are no visitor parking spaces.

| Table 49 | .40.210(b) |
|--------------------------------|--|
| Total Parking Spaces in Lot | Required Minimum Number of Accessible Parking Spaces |
| 1 to 25 | 1 |
| 26 to 50 | 2 |
| 51 to 75 | 3 |
| 76 to 100 | 4 |
| 101 to 150 | 5 |
| 151 to 200 | 6 |
| 201 to 300 | 7 |
| 301 to 400 | 8 |
| 401 to 500 | 9 |
| 501 to 1,000 | 2 percent of total spaces |
| 1,001 and over | 20 plus 1 space for each 100 spaces over 1,100 total spaces in lot |

(c) Facility loading spaces. In addition to the required off-street parking requirements, a development must provide loading spaces as set forth in the following table:

| | Gross Floor Area in Square Feet | | |
|--|---------------------------------|------------------------------|------------------------|
| Use | All other areas | Town Center Parking District | Loading Space Required |
| Motels and hotels | 5,000-29,999 | 6,000—60,000 | 1 |
| | 30,000—60,000 | | 2 |
| | Each additional 30,000 | Each additional 30,000 | 1 |
| Commercial | 5,000-24,999 | 6,00050,000 | 1 |
| | 25,000—50,000 | | 2 |
| | Each additional 30,000 | Each additional 30,000 | 1 |
| Industrial, manufacturing, warehousing, storage, and processing | 5,000—24,999 | 6,000—50,000 | 1 |
| | 25,000—50,000 | | 2 |
| | Each additional 30,000 | Each additional 30,000 | 1 |
| Hospital | 5,000—40,000 | 6,000—40,000 | 1 |
| | Each additional 40,000 | Each additional 40,000 | 1 |
| School | For every two school buses | | 1 |
| Home for the aged, convalescent home, correctional institution | More than 25 beds | | 1 |

(Serial No. 2022-04(b), § 2, 4-25-2022, eff. 5-26-2022)

Juneau, AK Code of Ordinances about:blank

| Table 49.40.210(b) | | | | |
|-----------------------------|--|--|--|--|
| Total Parking Spaces in Lot | Required Minimum Number of Accessible Parking Spaces | | | |
| 1 to 25 | 1 | | | |
| 26 to 50 | 2 | | | |
| 51 to 75 | 3 | | | |
| 76 to 100 | 4 | | | |
| 101 to 150 | 5 | | | |
| 151 to 200 | 6 | | | |
| 201 to 300 | 7 | | | |
| 301 to 400 | 8 | | | |
| 401 to 500 | 9 | | | |
| 501 to 1,000 | 2 percent of total spaces | | | |
| 1,001 and over | 20 plus 1 space for each 100 spaces over 1,100 total spaces in lot | | | |

PART II - CODE OF ORDINANCES TITLE 49 - LAND USE Chapter 49.70 - SPECIFIED AREA PROVISIONS ARTICLE II. HILLSIDE DEVELOPMENT

ARTICLE II. HILLSIDE DEVELOPMENT

49.70.200 Purposes.

The purposes of this article are to:

- (1) Ensure that hillside development provides erosion and drainage control to protect adjoining parcels;
- (2) Protect waterways from sedimentation and pollution;
- (3) Minimize injury or damage to people or property from natural or artificial hazards in hillside development; and
- (4) Minimize any adverse aesthetic impact of hillside development.

(Serial No. 87-49, § 2, 1987)

49.70.210 Applicability and scope.

- (a) This article applies to all development on hillsides in the City and Borough that involves the following:
 - (1) Removal of vegetative cover;
 - (2) Excavation of any slope in excess of 18 percent;
 - (3) Creation of a new slope in excess of 18 percent for a vertical distance of at least five feet; or
 - (4) Any hazard area identified on the landslide and avalanche area maps dated September 9, 1987, consisting of sheets 1—8, as the same may be amended from time to time by the assembly by ordinance or any other areas determined to be susceptible to geophysical hazards.
- (b) All hillside development endorsement applications shall be reviewed by the planning commission, except the following may be reviewed by the director:
 - (1) An excavation below finished grade for basements and footings of a building, a retaining wall or other structure authorized by a building permit, provided that this shall not exempt any fill made with the material from such excavation nor any excavation having an unsupported height greater than two feet after the completion of the associated structure.
 - (2) Graves
 - (3) Mining, quarrying, excavating, processing, or stockpiling of rock, sand, gravel, aggregate or clay provided such operations do not affect the location or peak volume of runoff, the location or amount of standing water, or the lateral support for, the stresses in, or the pressure upon, any adjacent or contiguous property.
 - (4) Exploratory excavations less than 200 square feet in area and under the direction of a civil engineer with knowledge and experience in the application of geology in the design of civil work.
 - (5) An excavation which:
 - (A) Is less than two feet in depth and covers less than 200 square feet; or

Juneau, Alaska, Code of Ordinances (Supp. No. 145)

- (B) Does not create a cut slope greater than five feet in height or steeper than one and one-half horizontal to one vertical.
- (6) A fill less than one foot in depth and intended to support structures which fill is placed on natural terrain with a slope flatter than five horizontal to one vertical, which does not exceed 20 cubic yards on any one lot and which does not obstruct a drainage course.
- (7) A fill less than three feet in depth and not intended to support structures which fill is placed on natural terrain on a slope flatter than five horizontal to one vertical, which does not exceed 50 cubic yards on any one lot and which does not obstruct a drainage course.
- (8) Minor development.

(Serial No. 87-49, § 2, 1987; Serial No. 2006-15, § 22, 6-5-2006; Serial No. 2015-03(c)(am), § 51, 8-31-2015)

49.70.220 Hillside development endorsement application.

- (a) All development on hillsides shall be pursuant to a hillside development endorsement.
- (b) The developer shall apply for and obtain a hillside development endorsement prior to any site work other than land and engineering surveys and soils exploration.

(Serial No. 87-49, § 2, 1987; Serial No. 2015-03(c)(am), § 52, 8-31-2015)

49.70.230 Fees.

The City and Borough shall charge the developer the gross hourly rate for professional review of the application and for inspection. The developer shall deposit one percent of the value of the site development, excluding that portion of the site determined by the engineer to be subject to a public transmission facility permit, in a specially designated reserve account, against which the City and Borough may bill its documented time and expenses. The developer shall promptly replenish this amount when requested, and no endorsement may be issued if there is any deficiency in the developer's reserve account. All unexpended funds in the reserve account shall be returned to the developer upon final approval of development or when the engineer is satisfied that the work under the hillside development endorsement has been completed and the requirements of this chapter have been met.

(Serial No. 87-49, § 2, 1987)

49.70.240 Application.

The application shall be accompanied by the following materials, which shall be signed and stamped by a civil engineer, architect, geologist or land surveyor licensed in the State of Alaska:

- A vicinity map, at a clear and legible scale, showing roads, place and street names and natural waterbodies.
- (2) Site maps, showing the present condition of the site at a clear and legible scale compatible with the size of the development and including:
 - (A) Two-foot contours for flat terrain or five-foot contours for steep terrain and extending 50 feet in all directions beyond the development site; 12 percent line, 30 percent line;
 - (B) Water bodies, tidelands and drainage ways from the development site to accepting natural waterbody;

Created: 2022-10-12 14:40:45 [EST]

- (C) Lot boundaries and easements for the site and adjacent lots; and
- (D) Existing improvements on the site and adjacent lots, including structures, roads, driveways and utility lines.
- (3) The application shall include a finished proposed site plan at a clear and legible scale that includes the following information:
 - (A) Finished grade at two-foot contours for flat terrain or five-foot contours for steep terrain and extending 50 feet in all directions beyond the development site; 12 percent line, 30 percent line.
 - (B) Water bodies, tidelands and drainage ways, and temporary and permanent drainage systems from the development site to the accepting natural waterbody.
 - (C) Lot boundaries, easements and setback lines.
 - (D) The location of improvements including structures, roads, driveways, utility lines, culverts, walls and cribbing.
 - (E) Clearing limits of existing vegetative cover.
 - (F) A cross section of the development site.
- (4) The application shall include detailed engineering drawings of roads, driveways, parking areas, structural improvements for foundations, off-site stormwater runoff systems; cross sections and road elevations.
- (5) A description of the source and type of any off-site fill, and the site for depositing excess fill.
- (6) A landscaping plan, including all trees to be retained in excavation areas, all plant species and locations; temporary slope protection measures; erosion and siltation control measures; seeding or sodding materials, a planting and maintenance program; and methods of stabilization and protection of bare slopes.
- (7) An engineering geologic report, including a summary of the relevant surface and bedrock geology of the site, a discussion of active geologic processes with conclusions and recommendations regarding the effect of geologic factors on the proposed development; data regarding the nature, distribution and relevant parameters of existing soils, recommendations for grading procedures; design criteria for corrective measures as necessary, and recommendations covering the suitability of the site for the proposed development.
- (8) A work schedule, by phase.
- (9) Such other different or more detailed submissions as may be required.

(Serial No. 87-49, § 2, 1987; Serial No. 2015-03(c)(am), § 54, 8-31-2015)

49.70.250 Standards for approval.

Hillside development shall meet the following minimum standards:

- (1) Roads. The City and Borough road standards shall apply to hillside development, except that:
 - (A) Modification of standards. The engineer or planning commission may modify road standards as identified in subsections (1)(B) and (C) of this section, if:
 - The developer's traffic analysis and circulation, land ownership, and development patterns indicate future use of the roadway at less than collector street levels;

- (ii) The modification would enable the development to meet, or more closely approximate, the criteria set forth in section 49.70.260; and either
- (iii) The proposed road or access in question would result in a permanent cul-de-sac; or
- (iv) A secondary access to the proposed development exists or will be developed as a part of the project.
- (B) Road width. The width of a section of residential roadway may be narrowed to 20 feet, with a single four-foot pedestrian way and underground storm drain system, if:
 - The section is not more than 200 feet in length, and is separated from other such sections by at least 100 feet of standard roadway;
 - (ii) No entrances, intersections or parking are allowed in the section;
 - (iii) Guard rails, if any, are designed to permit the passage of plowed snow;
 - (iv) There is at least a 200-foot line of sight along the centerline of the section;
 - (v) The section enables the development to meet, or more closely approximate, the criteria set forth in section 49.70.260:
 - (vi) Grouped off-street parking spaces are provided at the entry to the section; and
 - (vii) Adequate provision is made for storage of snow.
- (C) Road grade. The grade of a section of residential roadway may be increased to a maximum of 15 percent if:
 - The section is not more than 200 feet in length and separated from other such sections by at least 100 feet of roadway;
 - (ii) No entrances or intersections are allowed in the section;
 - (iii) Through intersections at the end of the section have approaches at least 50 feet long measured from the edge of the traveled way of the crossroad and are at a grade of eight percent or less; intersections requiring a full stop have approaches no less than 20 feet long at a grade of two percent or less, or no less than 50 feet long at a grade between two and six percent;
 - (iv) Any guard rails are designed to permit the passage of plowed snow;
 - (v) All sight distances conform to standards of the American Association of State Highway and Transportation Officials; and
 - (vi) The section enables the development to meet, or more closely approximate, the criteria set forth in section 49.70.260.
- (2) Weather. The engineer may prohibit a developer from earthmoving during periods of very wet soil conditions, in which case the permit shall be extended by a like period.
- (3) Sediment. The developer shall not allow any increase in sediment to flow off-site during or after construction if such would be likely to cause an adverse impact on a down slope lot or waterbody.
- (4) Peak discharge. The developer shall ensure that during and after construction of major development, the peak discharge of all streams and natural drainage ways at the down slope boundary shall be no greater than that occurring prior to excavation.

(Serial No. 87-49, § 2, 1987)

49.70.260 Criteria.

The commission or director shall consider the extent to which the development meets the following criteria:

- (1) Soil erosion. Soil disturbance and soil erosion shall be minimized and the effects thereof mitigated.
- (2) Existing vegetation. Depletion of existing vegetation shall be minimized.
- (3) Contours. The developer shall recontour the finished grade to natural-appearing contours which are at or below 30 percent or the natural angle of repose for the soil type, whichever is lower, and which will hold vegetation.
- (4) Time of exposure and soil retention. The developer shall minimize the period of time that soil is exposed and shall employ mats, silt blocks or other retention features to maximize soil retention.
- (5) Replanting. The developer shall mat, where necessary, and plant all exposed soil in grass or other soil-retaining vegetation and shall maintain the vegetation for one full growing season after planting.
- (6) Drainage. The developer shall minimize disturbance to the natural course of streams and drainage ways. Where disturbance is unavoidable, the developer shall provide a drainage system or structures which will minimize the possibility of sedimentation and soil erosion on-site and downstream and which will maintain or enhance the general stream characteristics, spawning quality, and other habitat features of the stream and its receiving waters. Where possible, development shall be designed so lot lines follow natural drainage ways.
- (7) Foundations. The developer shall ensure that buildings will be constructed on geologically safe terrain.
- (8) Very steep slopes. The developer shall minimize excavation on slopes over 30 percent.
- (9) Soil retention features. The developer shall minimize the use of constructed retention features. Where used, their visual impact shall be minimized through the use of natural aggregate or wood, variation of facade, replanted terraces, and the like.
- (10) Wet weather periods. The developer shall minimize exposure of soil during the periods of September 1—November 30 and March 1—May 1.

(Serial No. 87-49, § 2, 1987; Serial No. 2015-03(c)(am), § 54, 8-31-2015)

49.70.270 Conditions on approval.

The commission or director may place conditions upon a hillside development endorsement as necessary or desirable to ensure that the spirit of this chapter will be implemented in the manner indicated in the application. Fulfillment of conditions shall be certified by the engineer. The conditions may consist of one or more of the following:

- (1) Development schedule. The commission or director may place a reasonable time limit on or require phasing of construction activity associated with the development or any portion thereof, in order to minimize construction-related disruption to traffic and neighbors or to ensure that the development is not used or occupied prior to substantial completion of required improvements.
- (2) Dedications. The commission or director may require conveyances of title or other legal or equitable interests to public entities, public utilities, a homeowner's association, or other common entities. The developer may be required to construct any public facilities, such as drainage retention areas, to City and Borough standards prior to dedication.

- (3) Construction guarantees. The commission or director may require the posting of a bond or other surety or collateral providing for whole or partial releases, in order to ensure that all required improvements are constructed as specified in the approved plans.
- (4) Lot size. If justified by site topography, the commission or director may require larger lot areas than prescribed by zoning requirements.

(Serial No. 87-49, § 2, 1987; Serial No. 2015-03(c)(am), § 55, 8-31-2015)

PART II - CODE OF ORDINANCES TITLE 49 - LAND USE Chapter 49.40 - PARKING AND TRAFFIC ARTICLE III. TRAFFIC

ARTICLE III. TRAFFIC1

49.40.300 Applicability.

- (a) A traffic impact analysis (TIA) shall be required as follows:
 - (1) A development projected to generate 500 or more average daily trips (ADT) shall be required to have a traffic impact analysis.
 - (2) A development projected to generate fewer than 250 ADT shall not be required to have a traffic impact analysis.
 - (3) A development projected to generate more than 250 ADT but fewer than 500 ADT shall be required to have a traffic impact analysis if the Community Development Department Director determines that an analysis is necessary based on the type of development, its location, the likelihood of future expansion, and other factors found relevant by the director.
 - (4) The applicant shall provide the traffic projections for the project, and the department will review and approve the final figures.
 - (5) A TIA must be prepared by a licensed engineer, or a transportation planner, with traffic analysis experience, approved by the director.
- (b) The department shall require the applicant to contact the Alaska Department of Transportation and Public Facilities to determine whether a state permit or TIA will be required.

(Serial No. 2008-01, § 2, 1-28-08)

49.40.305 Traffic impact analysis (TIA) requirements.

- (a) A TIA prepared under this section must identify and assess the impacts of the proposed development on all affected transportation systems. The TIA shall identify any effective development design or operational measures that would mitigate impacts of a development on transportation systems. The study area for the TIA shall be that area in which it is anticipated that the proposed development will increase ADT by five percent or more.
- (b) A TIA must forecast traffic generated by a development in accordance with the most recent edition of Institute of Traffic Transportation Engineers' Trip Generation Handbook.
- (c) A TIA must address the following items:
 - (1) Intersections and segments of roadways where the ADT on any approach to an intersection is anticipated to increase by five percent or more due to the proposed development;

| ¹ Editor's note(s)—Serial No. 2008-0 | 1, § 2, adopted January 28, 2008 | , effective February 28, 2008, | repealed former |
|---|----------------------------------|--------------------------------|--------------------|
| Art. III, §§ 49.40.300, 49.40.3 | 10 and enacted provisions design | ated as a new Art. III to read | as herein set out. |
| | | | |

Cross reference(s)—Traffic, CBJ Code tit. 72.

Juneau, Alaska, Code of Ordinances (Supp. No. 148)

Created: 2023-02-09 10:35:32 [EST]

- (2) Each driveway or approach road that will allow egress from or ingress to the proposed development;
- (3) Existing and proposed pedestrian and bicycle facilities, if any, within the proposed development, and existing and proposed pedestrian and bicycle facilities to be used for access to the proposed development:
- (4) Projected traffic at the development's anticipated opening date, and at full build out, both with and without the traffic generated by the development;
- (5) Locations where road improvements are necessary to mitigate traffic impacts due to the development at the opening date, or where improvements are necessary to prevent the level of service (LOS) from deteriorating further at the opening date without the development;
- (6) Road improvement alternatives or other measures that will achieve an acceptable LOS or minimize degradation of service below an already unacceptable LOS according to section 49.40.310 Traffic; minimum standards;
- (7) Internal circulation and parking plans; and
- (8) An accident analysis that contains the following elements:
 - (A) An accident diagram showing accidents over the most recent three years of accident data, at all intersections or roadway segments identified as being impacted by the development, using the State of Alaska Department of Transportation's accident database, if available.
 - (B) An analysis of the type of accidents.
 - (C) An analysis of the accidents to determine if any pattern exists, and whether the accident pattern will be impacted by the development.
 - (D) If an accident pattern exists that will be exacerbated by the development, a determination whether there is a cost-effective solution which would mitigate the problem and how it can be implemented.
- (d) Level of service (LOS) and operational analysis for a traffic impact analysis prepared under this section must be performed in accordance with the most recent edition of the Transportation Research Board's publication Special Report 209, Highway Capacity Manual.

(Serial No. 2008-01, § 2, 1-28-08)

49.40.310 Traffic; minimum standards.

- (a) The minimum acceptable LOS for a roadway segment or intersection within the area affected by the development, on the projected opening date of the development, or full build out of the development, is LOS D.
- (b) If an intersection or roadway segment affected by the development has a pattern of accidents resulting in personal injuries, and the development will aggravate this accident pattern, then mitigation shall be required, regardless of the projected LOS.

(Serial No. 2008-01, § 2, 1-28-08)

49.40.320 Traffic impact analysis review.

(a) The department will review the traffic impact analysis prepared under this section.

Created: 2023-02-09 10:35:32 [EST]

(b) Mitigation measures may be subject to financial guarantee pursuant to Chapter 49.55, if appropriate considering safety and scheduling.

(Serial No. 2008-01, § 2, 1-28-08)

49.40.330 Traffic impact mitigation.

- (a) Except as provided in 49.40.340, an applicant shall make improvements to a roadway or intersection to achieve or maintain an acceptable LOS if a roadway or intersection has an:
 - (1) LOS D without traffic generated by the development; and would drop below LOS D with traffic generated by the development at the opening date of the development or full build out;
 - (2) If a roadway has an LOS below D without traffic generated by the development at the opening date of the development; or
 - (3) If the intersection or roadway segment has a pattern of accidents resulting in personal injuries, and the development would aggravate this accident pattern, then mitigation shall be required regardless of the LOS.
- (b) An applicant for a project for which a traffic impact analysis report has been prepared and mitigation required, shall install signs and markings on approaches to roadways within the development that conform to the Manual on Uniform Traffic Control Devices and the Alaska Traffic Manual, 2003, described in 17 AAC 20.950(1), as it may be amended from time to time.
- (c) Internal circulation and parking layout must provide sufficient queuing distance within the development between the roadway and internal restrictions to ensure that no traffic backs up onto a roadway, including bicycle or pedestrian facilities (See Section 49.40.230 Parking and circulation standards).
- (d) If a traffic impact analysis discloses impacts to pedestrian or bicycle traffic, an applicant shall make the necessary improvements to mitigate the impact.

(Serial No. 2008-01, § 2, 1-28-08)

49.40.340 Mitigation waiver.

- (a) The planning commission or community development department director may, in their discretion, waive or partially waive the requirements for mitigation under this section if the planning commission finds at a public hearing, or the director finds in writing after reviewing a permit which does not require planning commission approval, that either of the following circumstances is true:
 - (1) (A) Existing roadway facilities are only marginally achieving an LOS D without the traffic generated by the development, and would likely fall below LOS D within five years;
 - (B) Traffic generated by the development would result in an LOS below D without mitigation; and
 - (C) The costs of mitigating the impacts outweighs the benefits; or
 - (2) (A) If the LOS is below D. before the development's opening date;
 - (B) If the operation of the roadway or intersection, within the affected area, would not deteriorate more than five percent in terms of delay time, a minimum LOS, LOS E may be acceptable;
 - (C) Does not result in an LOS below E; and
 - (D) The costs of mitigating the impacts outweighs the benefits.

Created: 2023-02-09 10:35:32 [EST]

(Serial No. 2008-01, § 2, 1-28-08)

PART II - CODE OF ORDINANCES TITLE 49 - LAND USE Chapter 49.85 FEES FOR LAND USE ACTIONS

Chapter 49.85 FEES FOR LAND USE ACTIONS

49.85.100 Generally.

Processing fees are established for each development, platting and other land use action in accordance with the following schedule:

- (1) Minor development.
 - (A) Reserved;
 - (B) Staff review, no charge if a building permit is required;
 - (C) Sign permit, \$50.00 for the first two signs, and \$20.00 for each additional sign.
- (2) Minor subdivision or consolidation.
 - (A) Subdivision creating additional lots, \$400.00 plus \$25.00 for each resulting lot;
 - (B) Subdivision creating no additional lots, \$110.00 plus \$25.00 for each lot changed.
- (3) Major development, conditional use permits or modifications, allowable use permits, and wetlands permits. The fees for these land use actions are based on classes of uses, and shall be paid upon application for permit issuance or modification as set forth in subsections (3)(A)—(E) of this section. The fee for an extension of a permit shall be \$250.00 for any class of use.
 - (A) Class I uses, \$350.00. Class I uses are:
 - (i) Mobile homes on single lots;
 - (ii) Agricultural uses of under 50,000 square feet;
 - (iii) Residential structures, four or fewer units;
 - (iv) Transient structures, 12 or fewer rooms for rent;
 - (v) Day care and child care homes;
 - (vi) Accessory or incidental recycling activities under section 49.25.300, category 11.120 uses;
 - (B) Class II uses, \$500.00. Class II uses are:
 - Commercial, mixed use or enclosed industrial uses with less than 10,000 square feet of building space and using less than one acre of land;
 - (ii) Agricultural uses of 50,000 or more square feet;
 - (iii) Residential structures, five to ten dwelling units;
 - (iv) Transient structures, 13 to 30 rooms for rent;
 - (v) Day care and child care centers;
 - (vi) Floating residences and floating structures under 2,500 square feet;
 - (vii) Churches, schools, and additions thereto;
 - (C) Class III uses, \$750.00. Class III uses are:

- Commercial, mixed use or enclosed industrial uses with 10,000 to 20,000 square feet of building space or using one to three acres of land;
- (ii) Residential structures, 11 to 30 dwelling units;
- (iii) Transient structures, 31 to 90 rooms for rent;
- (iv) Floating structures, 2,500 to 10,000 square feet;
- (D) Class IV uses, \$1,000.00. Class IV uses are:
 - Commercial, mixed use or enclosed industrial uses with 20,001 to 40,000 square feet of building space or using more than three but less than six acres of land;
 - (ii) Residential structures, 31 to 60 dwelling units;
 - (iii) Transient structures, 91 to 180 rooms for rent;
 - (iv) Unenclosed industrial uses using less than three acres of land (e.g., batch plants, quarries, sand and gravel operations, junkyards, heliports, and outside storage);
 - (v) Floating structures over 10,000 square feet.
- (E) Class V uses, \$1,600.00. Class V uses are:
 - Commercial, mixed use or enclosed industrial uses with more than 40,000 square feet of building space or using six or more acres of land;
 - (ii) Unenclosed industrial uses using three or more acres of land;
 - (iii) Residential structures, over 60 dwelling units;
 - (iv) Transient structures, over 180 rooms for rent;
 - (v) City and state projects with estimated project cost over \$2,500,000.00.
- (4) Major subdivisions, including mobile home subdivisions.
 - (A) Preliminary plat, \$110.00 per lot;
 - (B) Final plat, \$70.00 per lot;
 - (C) Reserved;
 - (D) Plat amendment, \$110.00 plus \$25.00 per lot.
- (5) Street vacation, \$500.00.
- (6) Administration of developer's subdivision improvement guaranty.
 - (A) Performance bond, \$50.00;
 - (B) Deposit in escrow, \$140.00;
 - (C) Deed of trust, reconveyance, agreement or substitution of trust and reconveyance lots, \$140.00 for first lot, plus \$25.00 for each additional lot.
- (7) Access driveways in rights-of-way, \$400.00.
- (8) Special use or area.
 - (A) Mining.
 - (i) Exploration approval, \$200.00;
 - (ii) Small mine permit and amendment, \$1,200.00;

- (iii) Large mine permit and amendment, \$3,600.00, plus any special fee established pursuant to section 49.65.130;
- (iv) Technical revision \$500.00;
- (v) Ownership transfer requests \$500.00;
- (vi) Summary approval. The fees for a summary approval action shall be based on the classes of uses as established in 49.85.100(3).
- (B) Mobile home parks.
 - (i) Preliminary review, \$90.00 per lot or \$250.00, whichever is greater;
 - (ii) Final review, \$60.00 per lot or \$250.00, whichever is greater.
- (C) Recreational vehicle parks, conditional use permit, \$400.00.
- (D) Hillside development endorsement. Gross hourly rate for professional review and inspection, \$60.00.
- (E) Planned Unit Development (PUD) and Cottage Housing.
 - (i) Preliminary plan application approval, \$400.00 plus \$80.00 per residential unit;
 - (ii) Final plan approval, \$300.00 plus \$60.00 per residential unit.
- (F) Development in landslide or avalanche hazard area conditional use, \$400.00.
- (G) Alternative residential subdivisions.
 - (i) Preliminary plan application review, \$400.00 plus \$80.00 per residential unit;
 - (ii) Final plan review, \$300.00 plus \$60.00 per residential unit.
- (H) Floodplain development permit.
 - (i) Minor development, no building permit required, \$45.00.
 - (ii) Major development, building permit required, \$100.00.
 - (iii) Exception, \$400.00.
- (9) Zone changes and comprehensive plan amendments, \$600.00.
- (10) Variances and alternative development permits.
 - (A) Administrative variance, \$120.00;
 - (B) Non-administrative variance, \$400.00.
- (11) Street name change, \$400.00.
- (12) Preparation of deed restrictions, certificates of common ownership, and similar documents, \$100.00.
- (13) Sidewalk obstruction permit under CBJ 62.10.010: \$100.00.
- (14) Certification of zoning compliance letters, \$150.00.
- (15) Appeal of director's decision, refundable if applicant prevails, \$200.00.
- (16) Fee not listed. The processing fee for any development, platting, or other land use action not specifically listed in this section shall be the fee established for the most similar action listed, as determined by the community development director.

- (17) Fee cancellation. The director may authorize the refunding of a portion of the fee paid for a land use action when the permit application is cancelled before completion of the land use review process. The director may estimate the amount of work not completed and set the amount of the refund at that amount, less ten percent of the fee.
- (18) Wireless communication facility application fees.
 - (A) Application fees required by subsection 49.65.940(b): \$350.00.
 - (B) Additional fee required for special use permit applications required by subsection 49.65.970(b)(1): \$500.00.
 - (C) Any actual costs incurred for technical expert review, publication and mailings.
- (19) Marijuana license fee, \$250.00.
- (20) Certification of nonconforming status, \$150.00; fee is waived if applied for in conjunction with a development permit.
- (21) Parking waiver, \$400.00. If the application is filed in conjunction with a major development permit the fee shall be reduced by 20 percent.
- (22) Fee in lieu, \$10,000.00 per off-street parking space required.

(Serial No. 87-49, § 2, 1987; Serial No. 91-02, § 2, 1991; Serial No. 91-42, § 2, 1991; Serial No. 92-42, § 4, 1992; Serial No. 94-24, § 2, 1994; Serial No. 95-33, § 10, 1995; Serial No. 95-40, § 5, 1996; Serial No. 96-30, § 8, 1996; Serial No. 97-04, § 2, 1997; Serial No. 97-12, § 3, 1997; Serial No. 2000-38, § 2, 10-16-2000; Serial No. 2003-07(am), § 7, 5-12-2003; Serial No. 2010-15(c), § 3, 5-19-2010; Serial No. 2014-32(e)am, § 4, 9-29-2014, eff. 10-29-2014; Serial No. 2015-03(c)(am), § 61, 8-31-2015; Serial No. 2015-38(b)(am), § 2 5-2-2016, eff. 6-2-2016; Serial No. 2017-16, § 3, 6-26-2017, eff. 7-27-2017; Serial No. 2018-04(b), § 3, 5-14-2018, eff. 6-14-2018; Serial No. 2018-41(c), § 4, 12-17-2018, eff. 1-17-2019; Serial No. 2019-37, § 8, 3-16-2020, eff. 4-16-2020; Serial No. 2021-06, § 7, 4-26-2021, eff. 5-26-2021; Serial No. 2021-19, § 10, 8-2-2021, eff. 9-1-2021; Serial No. 2022-04(b), § 5, 4-25-2022, eff. 5-26-2022; Serial No. 2021-36, § 4, 9-12-2022, eff. 10-13-2022)

49.85.110 Amendment of rates.

The manager may adjust the rates in this chapter from time to time to reflect changes in the cost of providing municipal services generally.

(Serial No. 87-49, § 2, 1987)

49.85.130 Payment of fees.

No application, petition, request or appeal for which a fee is established under this title shall be complete unless accompanied by the required fee and shall be returned unless accompanied by such fee. All fees shall be nonrefundable except, if the appellant prevails in an appeal to the assembly or if the appeal is withdrawn prior to commencement of the hearing, the appeal fee shall be refunded less \$25.00 and hearing officer expenses incurred to withdrawal.

(Serial No. 87-49, § 2, 1987)

49.85.140 Development, work, or use commencing before permit application or issuance.

- (a) Any development, work, or use for which a permit is required under this title, but for which no permit is applied for and issued prior to the commencement of the development, work, or use requiring the permit, shall be subject to processing fees in an amount double that specified in section 49.85.100 for the permit.
- (b) The director may waive processing fees in excess of those listed in section 49.85.100 upon a finding that processing the permit application will not require staff time and/or materials in excess of what would have been required to process the permit application if it had been applied for prior to commencing the development, work, or use.

(Serial No. 2009-04, § 2, 6-8-2009)

69.10.023 Property tax incentives for economic development property.

(a) Purpose. This section authorizes property tax exemptions for the following on a property that meets the definition of economic development property in AS 29.45.050(m):

- (1) Assisted living for senior citizens: At least 15 new residential units on one lot of assisted living for senior citizens. The term residential units includes the assisted living residential units for senior citizens and only those building spaces that are necessary and incidental to the assisted living of senior citizens that qualify for inclusion in the exemption like common space, support space, and shared facilities. A residential unit qualifies for the exemption even if a non-senior citizen resides in the unit with a senior citizen. The property is located entirely within the urban service area as defined by Title 49. An assisted living for senior citizens tax exemption runs with the land for the duration of the exemption so long as all of the tax-exempt residential units remain under a single common ownership. The tax abatement terminates on the following January 1 for any residential unit sold, during the prior year, to an individual owner that terminates the common unit ownership.
- (2) Downtown multifamily: At least four new residential units on one lot in the Downtown Juneau Residential Tax Abatement Map, dated January 20, 2021. Such units must not be used as short-term rentals during the property tax abatement period. A downtown multifamily tax exemption runs with the land for the duration of the exemption so long as all of the tax-exempt residential units remain under a single common ownership. The tax abatement terminates on the following January 1 for any residential unit sold, during the prior year, to an individual owner that terminates the common unit ownership. No new downtown multifamily tax exemption applications may be accepted or granted after October 1, 2032.
- (3) High-density residential: At least four new residential units on one lot and the residential development meets or exceeds 75 percent of the maximum density for the lot as allowed by Title 49. Such units must not be used as short-term rentals during the property tax abatement period. The property is located entirely within the urban service area as defined by Title 49. A high-density tax exemption runs with the land for the duration of the exemption so long as all of the tax-exempt residential units remain under a single common ownership. The tax abatement terminates on the following January 1 for any residential unit sold, during the prior year, to an individual owner that terminates the common unit ownership. No new high-density tax exemption applications may be accepted or granted after October 1, 2032.
- (b) Reserved.
- (c) Exclusions. Repair and rehabilitation property as defined in CBJC 69.10.025 for which an exemption application has been filed or granted is not eligible for this housing tax incentive. Submission of an application for exemption pursuant to this section shall automatically terminate any existing CBJC 69.10.025 application or designation for the property.
- (d) Application. An application for an exemption under this section shall be made in writing to the assessor's office prior to issuance of a building permit for the residential units. Applications made after issuance of a building permit for the residential units shall not be accepted, or rejected if accepted. The application shall at a minimum contain the following:
 - (1) Name. The name of the applicant;
 - (2) Address. The legal description and street address of the property for which the application is made;
 - (3) New residential units. Drawings of the residential units that the applicant will construct, including a floor plan that includes approximate square footages;

Created: 2023-03-21 12:41:33 [EST]

- (4) Existing structures. Drawings showing the square footage of all existing structures and structures to be constructed on the property;
- Increase in residential units. Plans showing the construction will increase the total number of residential units on the property;
- (6) Acknowledgement of liability. Applicant acknowledges that the residential units will be taxable if and when the residential units are no longer eligible for tax exemption under this section;
- (7) Economic development property justification. A narrative describing how the application qualifies as economic development property consistent with AS 29.45.050(m);
- (8) Other information. Other information as may be required by the assessor; and
- (9) Application requirements specific to the Downtown Juneau Residential Tax Abatement. In an application for CBJC 69.10.023(a)(2), the property owner must agree not to rent any new residential units as short-term rentals while receiving the tax abatement. A property owner who breaches this provision forfeits the remaining property tax abatement and must reimburse the City and Borough of Juneau for the property tax abatement received since first granted plus interest at the legal maximum rate of interest allowed by state law. If the property owner does not reimburse the City and Borough within 30 calendar days of notice being mailed or served, a lien shall be recorded against the property with the new residential units.
- (e) Provisional approval. The assessor shall provisionally approve an application for tax exemption if:
 - (1) The applicant submitted a complete application; and
 - (2) The applicant acknowledges it must:
 - Construct not less than the required residential units in accordance with the plans and drawings submitted with its application; and
 - (ii) Increase the total number of residential units on the property in order to receive final approval under this section.
- (f) Final approval of exemption. The assessor shall finally approve an application for tax exemption if:
 - (1) The applicant has completed construction of residential units in accordance with the plans and drawings submitted with its application and a certificate of occupancy has been issued pursuant to Title 19 for each structure that contains a residential unit described in the application; and
 - (2) The total number of residential units on the property has increased.
- (g) Magnitude of exemption. Consistent with this subsection, the total potential exemption shall not reduce the amount of taxes below the amount levied on other property for the school district's required local contribution under AS 14.17.410(b)(2). The taxes eligible for exemption under this section are those attributable only to the newly constructed residential units exclusive of previously existing residential units (whether remodeled or not), all nonresidential improvements, and land. Except as provided by subsection (m), the magnitude of exemption shall be determined on a spatial basis as follows: the square footage of the newly constructed residential units shall be divided by the square footage of all structures on the property, then multiplied by the assessed value of all improvements on the property and by the mill rate applicable to the property.
- (h) Duration of tax exemption. Tax exemptions approved under this section shall be for a period of 12 consecutive years beginning on January 1 of the first full calendar year after final approval of the application.
- (i) Recording of exemption. The assessor shall memorialize the terms of an exemption granted under this section in a memorandum recorded in the Juneau Recording District and kept on file in the assessor's office.

Created: 2023-03-21 12:41:33 [EST]

- (j) Termination of exemption upon reduction in number of residential units. An exemption granted under this section shall terminate immediately if and when the number of residential units on the property is less than the number existing at the time of final approval of the application under this section. An exemption granted under this section does not terminate if the property or residential unit is sold and the new owner continues to comply with this section.
- (k) Appeal. Any decision of the assessor under this section may be appealed to the assembly in accordance with CBJC 01.50.
- (I) Annual compliance and status report. Not later than March 31 of each year, the owner of the property for which an exemption has been granted, shall file with the assessor a report with the following information:
 - (1) Occupancy. A statement of occupancy and vacancy of the residential units for the prior 12 months;
 - (2) Residential units remain as described. A certification that the newly constructed residential units described in the application continue to exist and have not been converted to a nonresidential use;
 - (3) Further changes. A description of physical changes or other improvements constructed since the last report or, on first report, since the filing of the application; and
 - (4) Additional information. Any additional information requested by the assessor.
- (m) Late-file penalty. The failure for the owner to file the annual compliance and status report by March 31 shall result in ten percent reduction of the taxes exempted in the prior year.
- (n) Definitions. In this section, the following definitions apply:

Assisted living means a facility providing housing and institutional care for people unable to live independently or without assistance. Assisted living includes facilities that provide nursing care services.

New residential unit means new construction and a condemned or uninhabitable existing dwelling unit that is renovated to current code for a residential dwelling unit according to CBJC Title 19.

Previously exempt property means real or personal property exempt under CBJC Title 69 in the prior calendar year but taxable in the next calendar year.

Residential unit means a dwelling unit as defined by CBJC 49.80.120 and is either owner-occupied or only leased for periods of at least one month.

Senior citizen means a person who is:

- (1) Sixty-five years or older; or
- (2) At least 60 years of age and the widow or widower of a senior citizen who qualified for an exemption under AS 29.45.030(e) and CBJC 69.10.020(1)(A)(i) and (ii).

Short-term rental means a dwelling unit that is rented, leased, or otherwise advertised for occupancy for a period of less than 30 days.

Widow or widower means a person whose spouse has died and who has not remarried.

(Serial No. 2019-23, § 3, 7-22-2019, eff. 8-22-2019 ; Serial No. 2021-01(c)(am), § 2, 3-1-2021, eff. 3-31-2021; Serial No. 2022-42 , § 2, 10-24-2022, eff. 11-24-2022)

Created: 2023-03-21 12:41:33 [EST]

Juneau Affordable Housing Fund

up to \$50,000 per unit

The Juneau Affordable Housing Fund was created to promote the creation of affordable housing in the Capital City. This program runs annually in the Fall.

To review the requirements and guidelines and to learn more about the next funding competition round, please visit:

juneau.org/community-development/grants-juneauaffordable-housing-fund

Mobile Home Down Payment Assistance

up to \$10,000

CBJ has partnered with True North Federal Credit Union (TNFCU) to create a program that will provide low interest loans to qualified residents for up to 50% of the down payment. Residents must be able to match the other 50%. Loans will be available at 1% interest. The borrower will have up to five (5) years to pay back the loan.

juneau.org/community-development/grants-mobile -home-down-payment-assistance

Accessory Apartment Grant Program

\$6,000

The Accessory Apartment Grant Program is a one time grant to homeowners creating an eligible accessory apartment. This apartment cannot be used as a short-term rental.

juneau.org/community-development/grants-aapgp


Property Tax Abatement Programs

- Downtown Tax Abatement: Provides 12year tax abatement for projects that develop four or more new residential units in the mapped area. See map on reverse.
- Senior Assisted Living Tax Abatement:
 Provides 12-year tax abatement for projects that provide at least 15 new residential units of assisted living for senior citizens in the urban service area.
- Subdivision Property Tax Abatement: 5-year tax abatement program for improvements related to subdivision of one lot into three or more lots.
- High Density Tax Abatement: 12-year tax abatement for projects that develop at least four new residential units within the Urban Service Area.

For more information on CBJ tax abatement program eligibility criteria and to apply, please visit:

juneau.org/community-development/grants-cbj -tax-abatement-programs

For more information on CBJ Housing Programs, please contact the Community Development Department at: (907)586-0753 and press "1" to speak to the Planner on Call, or visit: juneau.org/community-development/grants

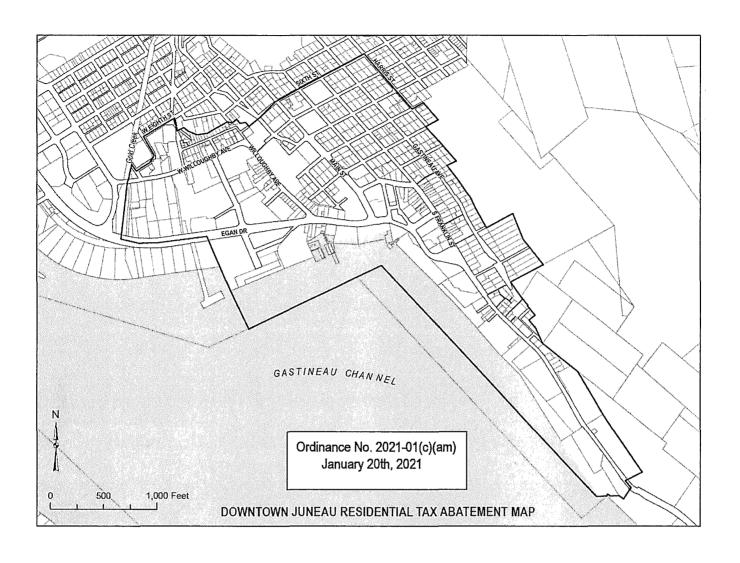

For more information on CBJ Housing Programs, please contact the Community Development Department at: (907)586-0753 and press "1" to speak to the Planner on Call, or visit: juneau.org/community-development/grants

Last update: 2/6/2023



DEVELOPMENT PERMIT APPLICATION

NOTE: Development Permit Application forms must accompany all other Community Development Department land use applications. This form and all documents associated with it are public record once submitted.

| Legal Description(s) (Subdivision, Survey, Block, Tract, Lot) | | | |
|--|--|---------------------------------|----------------------------|
| Parcel Number(s) | | | |
| | | | |
| This property is located in the downtown This property is located in a mapped haza | | | |
| LANDOWNER/ LESSEE | | | |
| Property Owner | Contact Person | | |
| Mailing Address | | Phone Number(s) | |
| E-mail Address | | | |
| | | | |
| LANDOWNER/ LESSEE CONSENT | | | |
| Required for Planning Permits, not needed on Building/En Consent is required of all landowners/ lessees. If submitte | =- | vritten approval may be suffic | ient. Written anoroval mu |
| include the property location, landowner/ lessee's printed | | | and tritten approved the |
| I am (we are) the owner(s)or lessee(s) of the property subj | ect to this application and I (we) co | nsent as follows: | |
| A. This application for a land use or activity review for de | velopment on my (our) property is | made with my complete unde | |
| B. I (we) grant permission for the City and Borough of Ju | neau officials/employees to inspect n | ny property as needed for pur | poses of this application. |
| | | | |
| Landowner/Lessee (Printed Name) | Title (e.g.: Landowr | ner, Lessee) | |
| | | | |
| X | | | |
| Landowner/Lessee (Signature) | | Date | |
| | | ***** | |
| Landowner/Lessee (Printed Name) | Title (e.g.: Landowr | ner, Lessee) | |
| x | | | |
| Landowner/Lessee (Signature) | | Date | |
| | | rogular business hours. Move | |
| NOTICE: The City and Borough of Juneau staff may need ac | | | |
| contact you in advance, but may need to access the property | in your absence and in accordance v | | |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put | in your absence and in accordance v | | |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put | rin your absence and in accordance volic hearing date. | | |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT If sam | r in your absence and in accordance v plic hearing date. e as LANDOWNER, write "SAME" | | |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT If sam Applicant (Printed Name) | r in your absence and in accordance v plic hearing date. e as LANDOWNER, write "SAME" | vith the consent above. Also, n | |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT If sam Applicant (Printed Name) Mailing Address | r in your absence and in accordance v plic hearing date. e as LANDOWNER, write "SAME" | vith the consent above. Also, n | |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT If sam Applicant (Printed Name) Mailing Address | r in your absence and in accordance v plic hearing date. e as LANDOWNER, write "SAME" | vith the consent above. Also, n | |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT Applicant (Printed Name) Mailing Address E-mail Address | r in your absence and in accordance v plic hearing date. e as LANDOWNER, write "SAME" | vith the consent above. Also, n | nembers of the Planning |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT Applicant (Printed Name) Mailing Address E-mail Address X Applicant's Signature | vin your absence and in accordance volic hearing date. e as LANDOWNER, write "SAME" Contact Person | Phone Number(s) Date of App | nembers of the Planning |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT If sam Applicant (Printed Name) Mailing Address E-mail Address X | vin your absence and in accordance volic hearing date. e as LANDOWNER, write "SAME" Contact Person | Phone Number(s) Date of App | nembers of the Planning |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT Applicant (Printed Name) Mailing Address E-mail Address X Applicant's Signature | vin your absence and in accordance volic hearing date. e as LANDOWNER, write "SAME" Contact Person | Phone Number(s) Date of App | lication |
| contact you in advance, but may need to access the property Commission may visit the property before a scheduled put APPLICANT Applicant (Printed Name) Mailing Address E-mail Address X Applicant's Signature | vin your absence and in accordance volic hearing date. e as LANDOWNER, write "SAME" Contact Person | Phone Number(s) Date of App | lication |

Updated 6/2022- Page 1 of 1

Page 1 of 2

BUILDING PERMIT APPLICATION (Including Water, Sewer, Driveway, Grading, Mechanical, Plumbing, Electrical, and Building Safety Inspections)

| • | | Project No: | | ie: (City Staff to | | OF FORMON OF FAG | L AT TEXT INOT | Case No: | Date Received: |
|-----------|----------|--|--|--------------------|--|----------------------------------|---|--|--------------------------|
| | CC | ONTRACTOR/OWNER- | BUILDER | | Contact by | E-Mail | | Contact Person | Phone No. |
| | N | lailing Address | * | | ······································ | | | FAX No. | License Number |
| Ė | AF | RCHITECT / ENGINEER | ? | Cont | act by E-Ma | ail | | Contact Person | Phone No. |
| ľ | N | lailing Address | | | | | | FAX No. | License Number |
| ΕĀ | PI | ERMIT CLASS | | ELECTI | RICAL | LUMBING . | MECHANICAL | ☐ WOODSTOVE ☐ WATER | SEWER |
| \propto | | NEW ADDITION R | EPAIR/REMOD | DEMOL | NOITI. | GRADING [] | DRIVEWAY | BUILDING SAFETY OTHER | |
| ۲ | В | UILDING TYPE | | Resid | lential | Commercial | | Other | |
| Z | EXI | STING DWELLING UNITS ON P | ROPERTY | NEW DW | ELLING UNIT | TS THIS PROJECT_ | TC | OTAL EXISTING BUILDINGS ON PROP | ERTY |
| PLICANT | DE | SCRIPTION OF WORK: | | | | | | | arage, deck, unfinished) |
| 7 | | 1777 p. 1. | | | **** | | | New: | |
| API | | | | | | | | New: | |
| ~ | | | | | | | | New: | |
| l | _ | | | | | | | New: | |
| l | l bo | rahi, and the that I have made and a | raminad this ass | inglian and know | u the same to | be true and correct. A | M seculations of | Cost of Remodeling: \$ laws and ordinances governing this type | |
| I | | | | | | | | naws and ordinances governing this type incel the provisions of any other federal, | |
| | | lating construction or the perform | | | | | | Date: | |
| l | _ | mature of Owner, Contrac | tor or Author | izeu Ayeiit. | | | | | |
| | <u>X</u> | | | | | | | X | |
| 1 | | W 50160 | | | | ELOW THIS LINE) | | | |
| | Br | JILDINGS Occupancy C FCC Code | lass | Ty _l | pe of Const rmit Classi | | *************************************** | BUILDING PERMIT FEES PLAN REVIEW FEES | |
| | | Occupancy | | quare Feet | | = Valuatio | n | Building Plan Review | \$ |
| | | - Company of the Comp | | | | | | Grading Plan Review | \$ |
| | | | | | | | | Total Review Fees | \$ |
| | | | | | | | | PLAN REVIEW PAYMENT | |
| | | | | | | | | Date Receipt No | ск |
| | | Bedrooms Stori | esENGINEERIN | IC/DUBLIC M | NOBRG E | LAN REVIEW AP | PROVALS | PERMIT ISSUANCE FEES | |
| | | | | | | | | | ¢ |
| | | RKING | Case No: _ | Units: | | | itials Date | Adjusted Plan Review Fee Fast Track Fee | \$ |
| | | M ZONE | Service - Si | ze | | | | Early Start Fee | \$ |
| EA | FIR | M.MAP | Fire Line - S | ize | | Engineering | | Building Permit Fee | \$ |
| ARI | | | Metered | | | | | Water Assessment Fee | \$ |
| | LAI | ND USE PERMITS: | | units: | | _ Sewer _ Architectural | | Water Inspection Fee Sewer Assessment Fee | \$ \$ |
| 王 | - | Case Number | | Units | | _ Structural | | Sewer Inspection Fee | \$ |
| STAI | | | BOND Case | | | _ Plumbing | | Grading Permit Fee | \$ |
| ဟ | | Case Number | OTHER Case | No: | - | _ Mechanical | | Driveway Permit Fee | \$ |
| | - | Case Number | ADEC On-site | Water | | _ Electrical | | Bond for | \$ |
| | | Case Number | No | Date | _ | _ Access _ Special Inspection | | Other Total Issuance Fees | \$ |
| | - | Case Number | ADEC On-site | Sewer | L- | _ Special inspection | r Folini | PERMIT ISSUANCE PAYMENTS | 3 |
| | | | No | Date | — I | APPROVED FOR I | SSUANCE | _ Date Rcpt Ck | \$ |
| | | Vater Connection Permits | | | | | | _ Date Rcpt Ck _ | \$ |
| | | I hereby acknowledge receipt of | a inch m | eter yoke. | | Signature | | _ Date Rcpt Ck _ | |
| | | X | Date: | | | Date | | _ Date Rcpt Ck _ | <u> </u> |
| | co | NDITIONS AND HOLDS ON I | PERMIT: | | | | | | |
| | ***** | | | | | | | | |
| | | | | | | | | | |
| | | | | | | | | | |
| | | | ***** | | Address and the contract of th | | | | |
| | | | The state of the s | | | | | of the control of the | |
| 1 | | | | | | | | Can | finued on Reverse Side |

NOTE: MUST BE ACCOMPANIED BY DEVELOPMENT PERMIT APPLICATION FORM

TYPES OF INSPECTIONS

The inspections indicated below are normally required for each permit type. (Staff marks applicable items)

| BI (Res. Building Safety Inspection) D100 Setbacks D110 Excavation/Footing D115 Stem Walls/Forms/Rebar D120 Temporary Power D140 Rough Framing D150 Rough Electrical D160 Rough Electrical D160 Rough Flumbing D170 Underslab Utilifies D180 Vents (Bath, Dryer, etc.) D190 Firewall Separation D210 Yellow Tag Electrical D220 Woodstows/Chimney D230 Smoke Detection D240 Insulation D255 Meter Yoke D257 Oil & Gas Piping/Tanks D260 Grading/Drainage D263 ADEC On-Site Vater Final D260 Res Zoning-Final D270 Repair/Rehab Exemption D280 Res Zoning-Final D800 Residential Final WS (Wood Stove) | J100 Underground Plumbing J110 Water Pining J120 DWV Pining J130 Hydronic System J140 Water Heater J150 Water Service J170 Gas Pining J180 Cross Connection Control J500 Plumbing Final MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | WE (Water Extended) WI (Water Inspection) FC (Fire Connection) D100 Water Meter/Yoke D105 Water Meter/Yoke D105 Water Meter Requin D110 Size of Water Servic D120 Depth (Water) Dep D130 Cross Connection C D140 Pressure Test D150 Thaw Waiver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z050 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
|--|--|---|
| D110 Exeavation/Footing D115 Stern Walls/Forms/Rebar D120 Temporary Power D140 Rough Framing D150 Rough Electrical D160 Rough Electrical D160 Rough Electrical Unifers D160 Power Research Unifers D170 Undersland Unifers D180 Vents (Bath, Dryer, etc.) D190 Firewall Separation D210 Yellow Tag Electrical D220 Woodstove/Chimney D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 D18 Gas Piping/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D268 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | J120 DWP Piping J130 Hydronic System J140 Water Heater J150 Water Service J170 Gas Piping J180 Cross Connection Control J500 Plumbing Final MC {Mechanical} H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H1410 Computation Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC {Electrical} F100 Temporary Power | FC (Fire Connection) D100 Water Meter/Yoke D105 Water Meter Requin D110 Size of Water Servic D120 Depth (Water) Dep D130 Cross Connection C D140 Pressure Test D150 Thaw Walver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D115 Stem Walls/Forms/Rebar D120 Temporary Power D140 Rough Framing D150 Rough Framing D150 Rough Flumbing D170 Underslab Utilities D180 Vents (Balth, Dyer, etc.) D190 Firewall Separation D210 Yellow Tag Electrical D220 Woodsfove/Chimney D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 D18 Gas Pping/Tanks D260 Grading/Drianage D263 ADEC On-Site Water Final D266 ADEC On-Site Sewort Final D270 Repair/Rehab Exemption D280 Res Zenting Final D800 Residential Final | J130 Hydronic System J140 Water Heater J150 Water Softener J160 Water Softener J170 Gas Piping J180 Cross Connection Control J500 Plumbing Final MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Combustion Air H150 Comptessor H160 Appliance Clearance H170 Simoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D100 Water Meter/Yoke D105 Water Meter Requir D110 Size of Water Servic D120 Depth (Water) Dep D130 Cross Cennection C D140 Pressure Test D150 Thow Waiver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z680 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sawer Inspection) C100 Depth C110 Soil |
| D120 Temporary Power D140 Rough Framing D150 Rough Framing D150 Rough Electrical D160 Rough Electrical D160 Rough Electrical D170 Understalb Utilities D180 Vents (Bath, Dryer, etc.) D190 Firewall Separation D210 Yellow Tag Electrical D220 Woodstove/Chinney D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Piping/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D260 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | J140 Water Heater J150 Water Service J170 Gas Piping J180 Cross Connection Control J500 Plumbing Final MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D105 Water Meter Requir D110 Size of Water Servic D120 Depth (Water) Dep D130 Cross Connection C D140 Pressure Test D150 Thaw Waiver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D140 Rough Framing | J150 Water Saftener J160 Water Service J170 Gas Pping J180 Cross Connection Control J500 Plumbing Final MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Computsion Air H150 Comptessor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D110 Size of Water Servic D120 Depth (Water) Dep D130 Cross Connection C D140 Pressure Test D150 Thaw Waiver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sawer Inspection) C100 Depth C110 Soil |
| D150 Rough Electrical D160 Rough Plumbing D170 Underslab Utilities D180 Vents (Bath, Dryer, etc.) D190 Firewall Separation D210 Yellow Tag Electrical D220 Woodstove/Chirmey D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Pipring/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D260 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | J160 Water Service J170 Gas Piping J180 Cross Connection Control J500 Plumbing Final MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D120 Depth (Water) Dep D130 Cross Connection C D140 Pressure Test D150 Thaw Waiver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water OF D610 Seasonal Water Tur Z010 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D160 Rough Plumbing D170 Understalb Utilities D180 Vents (Bath, Dryer, etc.) D190 Firewall Separation D210 Yellow Tag Electrical D220 Woodstove/Chinney D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 D18 Gast Pping/Tanks D260 Grading/Drianage D263 ADEC On-Site Water Final D268 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | J180 Cross Connection Control J500 Plumbing Final MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Compussion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D130 Cross Connection C D140 Pressure Test D150 Thow Walver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D180 Vents (Bath, Dyer, etc.) D190 Firewall Separation D210 Yellow Tag Electrical D220 Woodstove/Chinney D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Piping/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D260 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | J500 Plumbing Final MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D150 Thaw Waiver D500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D190 Firewall Separation D210 Yellow Tag Electrical D220 Weodstove/Chimney D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Piping/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Res Zoning Final D800 Residential Final | MC (Mechanical) H110 Plenums & Ducts H120 Furnace H130 Inlets & Outlets H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | O500 Turn Water OFF D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water In Z680 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sawer Inspection) C100 Depth C110 Soil |
| D210 Yellow Tag Electrical D220 Woodstove/Chimney D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Pipring/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D260 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H110 Pienums & Ducts H120 Furnace H130 Inlets & Outlets H140 Complustion Air H150 Comptessor H160 Appliance Clearance H170 Somke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D510 Seasonal Water Tur D550 Hold D600 Turn Water ON D610 Seasonal Water Tur Z600 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D220 Woodstove/Chimney D230 Smoke Detection D240 Insulation D250 Toress Connection Control D255 Meter Yoke D257 Oil & Gas Pping/Tanks D260 Grading/Drainage D63 ADEC On-Site Water Final D260 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H110 Pienums & Ducts H120 Furnace H130 Inlets & Outlets H140 Complustion Air H150 Comptessor H160 Appliance Clearance H170 Somke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | DSS Hold D600 Turn Water ON D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D230 Smoke Detection D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Piping/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D266 ADEC On-Site Swer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H120 Furnace H130 Inlets & Outlets H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D600 Turn Water ON D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D240 Insulation D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Piping/Tanks D260 Grading/Drianage D263 ADEC On-Site Water Final D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H130 Inlets & Outlets H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D610 Seasonal Water Tur Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D250 Cross Connection Control D255 Meter Yoke D257 Oil & Gas Pipring/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H140 Combustion Air H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | Z080 Billing Authorization D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D255 Meter Yoke D257 Oil & Gas Psping/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H150 Compressor H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | D800 Water Final SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D257 Oil & Gas P;ping/Tanks D260 Grading/Drainage D263 ADEC On-Site Water Final D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H160 Appliance Clearance H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | SC (Sewer Connection) SI (Sewer Inspection) C100 Depth C110 Soil |
| D260 Grading/Drainage D263 ADEC On-Site Water Final D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H170 Smoke Detection Systems H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | SI (Sewer Inspection) C100 Depth C110 Soil |
| D263 ADEC On-Site Water Final D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H190 Commercial Hood H500 Mechanical Final EC (Electrical) F100 Temporary Power | SI (Sewer Inspection) C100 Depth C110 Soil |
| D266 ADEC On-Site Sewer Final D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | H500 Mechanical Final EC (Electrical) F100 Temporary Power | C100 Depth C110 Soil |
| D270 Repair/Rehab Exemption D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | EC (Electrical) F100 Temporary Power | C110 Soil |
| D280 Res Zoning Final D800 Residential Final WS (Wood Stove) | F100 Temporary Power | |
| D800 Residential Final WS (Wood Stove) | F100 Temporary Power | |
| WS (Wood Stove) | | C120 Material |
| | | C125 Grade C130 Cleanouts |
| | F110 Building Service F120 Conduit & Raceway Systems | |
| | F120 Conduit & Raceway Systems F140 General Wiring | C140 Sewer Connection C150 Sewer Disconnect |
| K100 Approved Model K110 Stove Clearances | F150 Cable Systems | |
| K110 Stove Clearances K120 Stack Clearances | F160 Cable Systems F160 Bonding | Z070 Billing Authorization C500 Sewer Final |
| K130 Hearth | F170 Grounding | C500 Sewer Piliai |
| | | GR (Grading) |
| N200 WOOdstove Filial | | G100 Retaing Walls, etc. |
| ES (Eira Sprinklar) | | G120 Drainage |
| | 1 300 Electrican I IIIai | G130 Slopes |
| | DW (Delyaway) | G140 Compaction |
| | | G150 Material |
| | | G200. Grading Final |
| | | Ozoo: Glading Cina |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| L500 Fire Final | | |
| | K200 Woodstove Final PS (Fire Sprinkler) FA (Fire Alarm) L100 Pressure Test L110 Underground Flush L120 Proper Bracing L130 Return Bends L14H Head Placement L150 FDC Location L160 Alarm Panel/Transmitter L170 Alarm Zones L180 Battery/Backup L190 Phone Connection L200 Reset Procedures L210 System Test L220 Detectors Spare | Fig. Smoke Detection |



ALLOWABLE/CONDITIONAL USE PERMIT APPLICATION

See reverse side for more information regarding the permitting process and the materials required for a complete application.

NOTE: Must be accompanied by a DEVELOPMENT PERMIT APPLICATION form.

| | PROJECT SUMMARY | | | | | | | | | | | |
|---------------------------|--|--|--|--|--|--|--|--|--|--|--|--|
| | | | | | | | | | | | | |
| | TYPE OF ALLOWABLE OR CONDITIONAL USE PERMIT REQUESTED | | | | | | | | | | | |
| | Accessory Apartment – Accessory Apartment Application (AAP) | | | | | | | | | | | |
| | Use Listed in 49.25.300 – Table of Permissible Uses (USE) Table of Permissible Uses Category: | | | | | | | | | | | |
| | IS THIS A MODIFICATION OF EXTENSION OF AN EXISTING APPROVAL? One of the second | | | | | | | | | | | |
| | UTILITIES PROPOSED WATER: Public On Site SEWER: Public On Site | | | | | | | | | | | |
| | SITE AND BUILDING SPECIFICS | | | | | | | | | | | |
| ant | Total Area of Lot square feet | | | | | | | | | | | |
| plice | Total Area of Proposed Structure(s)square feet | | | | | | | | | | | |
| be completed by Applicant | Existing to remain Proposed No Ves – Provide fixture information, cutoff sheets, and location of lighting fixtures Yes – Provide fixture information, cutoff sheets, and location of lighting fixtures | | | | | | | | | | | |
| du | ALL REQUIRED DOCUMENTS ATTACHED If this is a modification or extension include: | | | | | | | | | | | |
| 9 0 | ■ Narrative including: ■ Notice of Decision and case number | | | | | | | | | | | |
| To b | Current use of land or building(s) Justification for the modification or | | | | | | | | | | | |
| | Description of project, project site, circulation, traffic etc. extension Application submitted at least 20 days | | | | | | | | | | | |
| | ☐ Proposed use of land or building(s) ☐ Application submitted at least 30 days ☐ How the proposed use complies with the Comprehensive Plan before expiration date | | | | | | | | | | | |
| | Plans including: | | | | | | | | | | | |
| | Site plan | | | | | | | | | | | |
| | ☐ Floor plan(s) | | | | | | | | | | | |
| | Elevation view of existing and proposed buildings | | | | | | | | | | | |
| | Proposed vegetative cover | | | | | | | | | | | |
| | Existing and proposed parking areas and proposed traffic circulation | | | | | | | | | | | |
| | Existing physical features of the site (e.g.: drainage, habitat, and hazard areas) | | | | | | | | | | | |
| | DEPARTMENT USE ONLY BELOW THIS LINE | | | | | | | | | | | |
| | ALLOWABLE/CONDITIONAL USE FEES | | | | | | | | | | | |
| | Fees Check No. Receipt Date Application Fees \$ | | | | | | | | | | | |
| | Admin. of Guarantee \$ | | | | | | | | | | | |
| | Adjustment \$ | | | | | | | | | | | |
| | Pub. Not. Sign Fee \$ Pub. Not. Sign Deposit \$ | | | | | | | | | | | |
| | Total Fee \$ | | | | | | | | | | | |
| | | | | | | | | | | | | |
| | This form and all documents associated with it are public record once submitted. | | | | | | | | | | | |
| <u>!</u> | NCOMPLETE APPLICATIONS WILL NOT BE ACCEPTED Case Number Date Received | | | | | | | | | | | |
| i | For assistance filling out this form, contact the Permit Center at 586-0770. | | | | | | | | | | | |

Allowable/Conditional Use Permit Application Instructions

Allowable Use permits are outlined in CBJ 49.15.320, Conditional Use permits are outline in CBJ 49.15.330

<u>Pre-Application Conference</u>: A pre-application conference is required prior to submitting an application. There is no fee for a pre-application conference. The applicant will meet with City & Borough of Juneau and Agency staff to discuss the proposed development, the permit procedure, and to determine the application fees. To schedule a pre-application conference, please contact the Permit Center at 586-0770 or via e-mail at permits@juneau.org.

Application: An application for an Allowable/Conditional Use Permit will not be accepted by the Community Development Department until it is determined to be complete. The items needed for a complete application are:

- 1. Forms: Completed Allowable/Conditional Use Permit Application and Development Permit Application forms.
- 2. Fees: Fees generally range from \$350 to \$1,600. Any development, work, or use done without a permit issued will be subject to double fees. All fees are subject to change.
- 3. Project Narrative: A detailed narrative describing the project.
- 4. Plans: All plans are to be drawn to scale and clearly show the items listed below:
 - A. Site plan, floor plan and elevation views of existing and proposed structures
 - B. Existing and proposed parking areas, including dimensions of the spaces, aisle width and driveway entrances
 - C. Proposed traffic circulation within the site including access/egress points and traffic control devices
 - D. Existing and proposed lighting (including cut sheets for each type of lighting)
 - E. Existing and proposed vegetation with location, area, height and type of plantings
 - F. Existing physical features of the site (i.e. drainage, eagle trees, hazard areas, salmon streams, wetlands, etc.)

Document Format: All materials submitted as part of an application shall be submitted in either of the following formats:

- 1. Electronic copies in the following formats: .doc, .txt, .xls, .bmp, .pdf, .jpg, .gif, .xlm, .rtf (other formats may be preapproved by the Community Development Department).
- 2. Paper copies 11" X 17" or smaller (larger paper size may be preapproved by the Community Development Department).

<u>Application Review & Hearing Procedure</u>: Once the application is determined to be complete, the Community Development Department will initiate the review and scheduling of the application. This process includes:

Review: As part of the review process the Community Development Department will evaluate the application for consistency with all applicable City & Borough of Juneau codes and adopted plans. Depending on unique characteristics of the permit request the application may be required to be reviewed by other municipal boards and committees. During this review period, the Community Development Department also sends all applications out for a 15-day agency review period. Review comments may require the applicant to provide additional information, clarification, or submit modifications/alterations for the proposed project.

Hearing: All Allowable/Conditional Use Permit Applications must be reviewed by the Planning Commission for vote. Once an application has been deemed complete and has been reviewed by all applicable parties the Community Development Department will schedule the requested permit for the next appropriate meeting.

Public Notice Responsibilities: Allowable/Conditional Use requests must be given proper public notice as outlined in CBJ 49.15.230:

The Community Development Department will give notice of the pending Planning Commission meeting and its agenda in the local newspaper a minimum of 10-days prior to the meeting. Furthermore, CDD will mail notices to all property owners within 500-feet of the project site.


The Applicant will post a sign on the site at least 14 days prior to the meeting. The sign shall be visible from a public right-of-way or where determined appropriate by CDD. Signs may be produced by the Community Development Department for a preparation fee of \$50, and a \$100 deposit that will be refunded in full if the sign is returned within seven days of the scheduled hearing date. If the sign is returned between eight and 14 days of the scheduled hearing \$50 may be refunded. The Applicant may make and erect their own sign. Please contact the Community Development Department for more information.

INCOMPLETE APPLICATIONS WILL NOT BE ACCEPTED

Invitation to Comment

On a proposal to be heard by the CBJ Planning Commission

Your Community, Your Voice

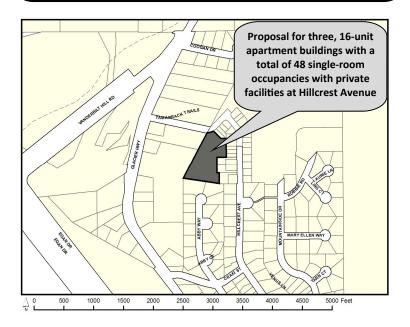



TO

Conditional Use Permit has been submitted for consideration and public hearing by the Planning Commission for **three**, **16-unit apartment buildings with a total of 48 single-room occupancies with private facilities** at **Hillcrest Avenue** in a **D15** zoning district.

PROJECT INFORMATION:

Project Information can be found at:

https://juneau.org/community-development/short-term-projects

PLANNING COMMISSION DOCUMENTS:

Staff Report expected to be posted May 6, 2024 at

https://juneau.org/community-development/planning-commission

Find hearing results, meeting minutes, and more here, as well.

Now through April 22

Comments received during this period will be sent to the Planner, **Joseph Meyers**, to be included as an attachment in the staff report.

April 23 — noon, May 10

Comments received during this period will be sent to Commissioners to read in preparation for the hearing.

HEARING DATE & TIME: 7:00 pm, May 14, 2024

This meeting will be held in person and by remote participation. For remote participation: join the Webinar by visiting https://juneau.zoom.us/j/86939674618 and use the Webinar ID: 869 3967 4618 OR join by telephone, calling: 1-253-215-8782 and enter the Webinar ID (above).

You may also participate in person in City Hall Assembly Chambers, 155 Heritage Way Juneau, Alaska.

May 15

The results of the hearing will be posted online.

FOR DETAILS OR QUESTIONS,

Phone: (907)586-0753 ext. 4209

Email: pc_comments@juneau.gov or joseph.meyers@juneau.gov Mail: Community Development, 155 Heritage Way, Juneau AK 99801

Printed April 4, 2024

Case No.: USE2024 0006 Parcel No.: 7B1001160014

CBJ Parcel Viewer: http://epv.juneau.org





(907) 586-0715 CDD_Admin@juneau.gov www.juneau.org/community-development 155 Heritage Way • Juneau, AK 99801

COMMUNITY DEVELOPMENT DEPARTMENT - REQUEST FOR AGENCY COMMENT

DEPARTMENT: CCFR

STAFF PERSON/TITLE: T. Ross, Fire Marshal

DATE: 2/26/2024

APPLICANT: Chilkat Vistas, LLC

TYPE OF APPLICATION: Conditional Use Permit

PROJECT DESCRIPTION:

48-unit multifamily development at Chilkat Vistas

LEGAL DESCRIPTION: Chilkat Vistas, Tract A3

PARCEL NUMBER(S): 7B1001160014

PHYSICAL ADDRESS:

NHN

SPECIFIC QUESTIONS FROM PLANNER:

Does the proposed site plan including the hammerhead and second access meet the requirements of the fire code?

AGENCY COMMENTS:

So as long as access has already been addressed and hydrant locations approved under that permit as well the only thing I can think of would be the requirement of signage for the hammerhead, that will be called out when the actual buildings are submitted for review.



(907) 586-0715 CDD_Admin@juneau.gov www.juneau.org/community-development 155 Heritage Way • Juneau, AK 99801

COMMUNITY DEVELOPMENT DEPARTMENT - REQUEST FOR AGENCY COMMENT

| DEPARTMENT: | |
|----------------------------------|--|
| STAFF PERSON/TITLE: | |
| DATE: | |
| APPLICANT: | |
| TYPE OF APPLICATION: | |
| PROJECT DESCRIPTION: | |
| | |
| | |
| LEGAL DESCRIPTION: | |
| PARCEL NUMBER(S): | |
| PHYSICAL ADDRESS: | |
| | |
| SPECIFIC QUESTIONS FROM PLANNER: | |
| | |
| | |
| | |
| | |
| AGENCY COMMENTS: | |

From: Maralee Guiher
To: Joseph Meyers
Subject: Chilkat Vistas

Date: Monday, April 22, 2024 9:42:45 AM

EXTERNAL E-MAIL: BE CAUTIOUS WHEN OPENING FILES OR FOLLOWING LINKS

USE2024 0006 7B1001160014

No, No, No! 48 efficiency apartments attached to our quiet Mountainside community!?

Please, consider not allowing this to take place. Our quiet neighborhood has already been impacted by the newest addition and its traffic (vehicle and foot.) The addition of these apartments really scares me. I'm afraid for our security and safety. For instance, traffic has increased and more and more vehicles are not observing the posted speed limits since the connecting of Glacier Hwy to Hillcrest Ave. Foot traffic down Hillcrest has considerably increased.

Please be considerate of the current residents of Mountainside Estates.

Maralee Guiher Crest Ct. Mountainside Estates August 11, 2022

Michael and William Heumann 6000 Thane Rd Juneau, AK 99801 mpheumann@hotmail.com (971) 261-8014

RE: Chilkat Vistas Subdivision, Phase II - Drainage Report

To Whom It May Concern,

The following Drainage Plan has been prepared for the Chilkat Vistas Subdivision, Phase II in Juneau, AK, a proposed multi-phase major subdivision on a 30-acre site at the 4500 block of Hillcrest Avenue. This drainage report addresses the second phase of the overall subdivision that will create 13 new single family lots, plus 3 tracts. Phase II of the subdivision will also include extending Hillcrest Avenue and improvement/extension of Hooter Lane, which will result in a looped connection between the two streets. This drainage report is independent of any previous drainage reports as it examines all on-site and upland stormwater that will be directed through the entire project area (phase I and phase II). Phase II of this subdivision will involve rerouting a stormdrain that currently flows across private property so that this stormwater will remain within the Hillcrest Ave and Hooter Lane right-of-way in the developed conditions. Improvements include extending Hillcrest Avenue and Hooter Lane by constructing new sidewalk, street, ditches, driveways and utilities along with building pads on the newly subdivided Lots. The 2010 CBJ Manual of Stormwater Best Management Practices was used to evaluate if the proposed and existing drainage features could convey runoff during the 25-year storm event.

Attachments to this report include sheets depicting survey data, proposed ROW improvements, as-built information, calculations and rainfall data used for the drainage analysis.

Site Runoff Calculation Method:

The existing conditions include 2 sub-basins and 2 discharge points, and the developed conditions will include 3 sub-basins and 3 discharge points. Though stormwater will be rerouted through the project area, all discharge points combine in the wetlands on the west side of Glacier Highway, which will preserve historic drainage patterns. It should be noted that the basin for Chilkat Vistas Subdivision phase I was used as the "pre-developed" condition. Since the phase I/pre-developed phase II conditions were analyzed in a previous drainage report, the existing conditions will not be discussed in detail in this report (see the Chilkat Vistas Phase I drainage report in appendix "G" for details on the existing conditions"). The catchment areas we determined using the proposed design model, Lidar data and aerial photos in AutoCAD C3D and were verify by several site visits. A delineation of the catchment areas can be found in Appendix A. Soil conditions were based on information from Shoephorster and Furbush (1974) and the National Engineering Handbook (see appendix E for more information about the on-site soils).

Page 1 | 4



To calculate the site runoff for Drainage Basins A, B, and C we have elected to use the SCS TR-55 method. The SCS TR-55 is most appropriate for evaluating drainage basins of 10 acres to 1,300 acres. Appendix D of the "2010 CBJ Manual of Stormwater Best Management Practices" was utilized as a guide. The calculations and supporting documentation can be found in Appendix B, C & F of this Report.

Anticipated Site Runoff (Q):

Using the SCS Unit Hydrograph Method, the amount of stormwater runoff during the 25-year storm event per catchment area was determined. The analysis shows that approximately 1.13 cfs of runoff will be removed from the discharge point A due to the proposed development. See Table 1.1 below for results, the calculations can be found in Appendix B.

| Catchment Area | Q (cfs) |
|-------------------------------------|---------|
| Drainage Basin A, Discharge Point A | 11.58 |
| Drainage Basin B, Discharge Point B | 1.03 |
| Drainage Basin C, Discharge Point C | 3.24 |
| Table 1.1 | |

Conveyance/Discharge Structure Capacities:

The capacity of the existing and proposed drainage systems was calculated to determine if proposed 25-year storm event flows could be conveyed. The entire network was analyzed in AutoCAD SSA, and the most vulnerable drainage structures/conveyance systems to failure along the analyzed flow path were also evaluated using HY-8 software. See Table 1.2 below for results on the most vulnerable drainage element in each basin's conveyance system. The supporting calculations can be found in Appendix C.

| Catchment Area | Q (cfs) |
|--|---------|
| Drainage Basin A – (P-1) Proposed 36" CMP Culvert | 47.75 |
| Drainage Basin B – (P-EX-1) Existing 18" CPP | 8.89 |
| Drainage Basin C – No net increase over existing conditions. | 5.58 |
| Table 1.2 | |



Summary:

Table 1.3 below compares anticipated 25-year runoff in the proposed and existing conveyance systems to their available hydraulic capacity. To simplify and provide a conservative evaluation runoff from the entire drainage basin was used for comparison even though uphill conveyance systems would not need to handle all of the calculated runoff from the lower discharge point.

| | Anticipated Runoff | Capacity | Available | | | | | | | | | |
|--------------------------------------|--------------------|----------|------------------|--|--|--|--|--|--|--|--|--|
| Drainage Basin/Discharge Point | Q (cfs) | Check | Capacity Q (cfs) | | | | | | | | | |
| Basin A/P-1 | 11.58 | < | 47.75 | | | | | | | | | |
| Basin B/P-EX-1 | 1.03 | < | 8.89 | | | | | | | | | |
| Basin C/Existing Ditch Near Tract-A3 | 3.24 | < | 5.58 | | | | | | | | | |
| | Table 1.3 | | | | | | | | | | | |

Our analysis shows the proposed 36-inch CMP pipe under Glacier Highway will have an excess of capacity to accommodate the stormwater that will result from phase II of the Chilkat Vistas Subdivision, as well as potential future development. It demonstrates that there is excess capacity in the existing 18-inch CPP culvert on the southern side of Hooter Lane. Our analysis also shows that the drainage along the southern portion of Hooter Lane will see a reduction in water from the existing conditions due to a redirection of upland flows into the new 36-inch pipe on the opposite side of the street. Similarly, the existing ditch that leaves the project area at the southern portion of tract-A3 will see a net reduction in water due to the elimination of a stormdrain outfall from Hillcrest Ave in the ditch above Tract-A3.

Respectfully,

Lucas Chambers, P.E.

Lucas Chambes


Principal Engineer – proHNS LLC Juneau


License #CE-106593



Appendices:

- A Catchment Areas & Flow Paths
- B SSA Calculations
- C HY-8 Calculations
- D Rainfall Intensity
- E Soil Data
- F SCS Hydrograph
- G Prior Drainage Reports "Richland Manor Subdivision Drainage Report dated 10/31/19, Hooter Lane Phase I ROW Improvements Drainage Report dated 1/23/20

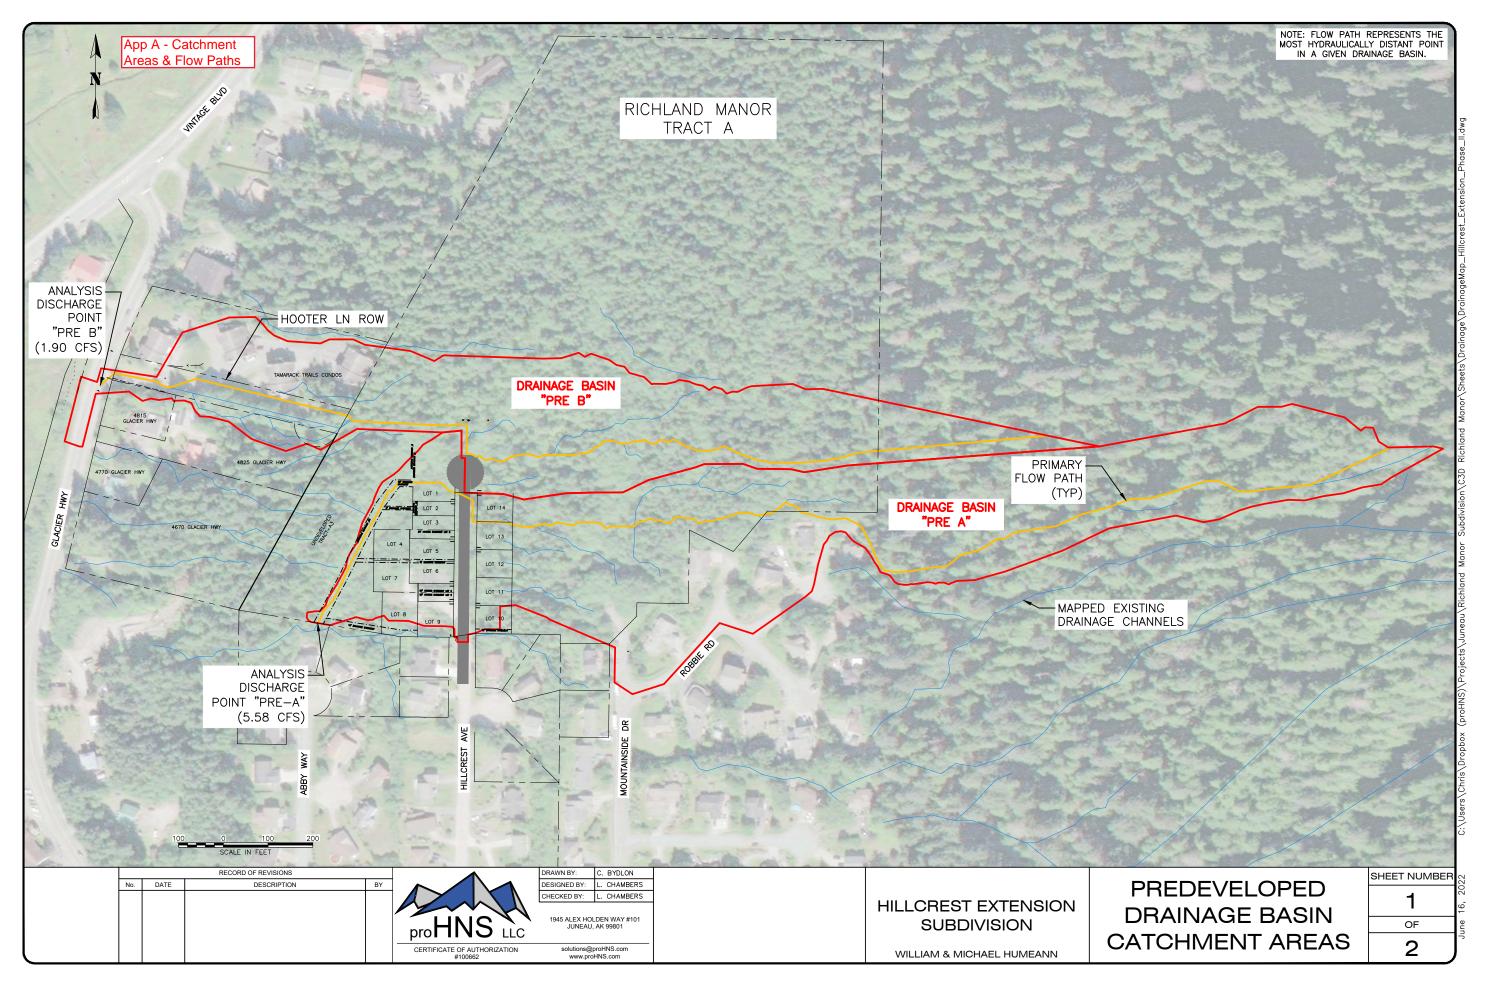

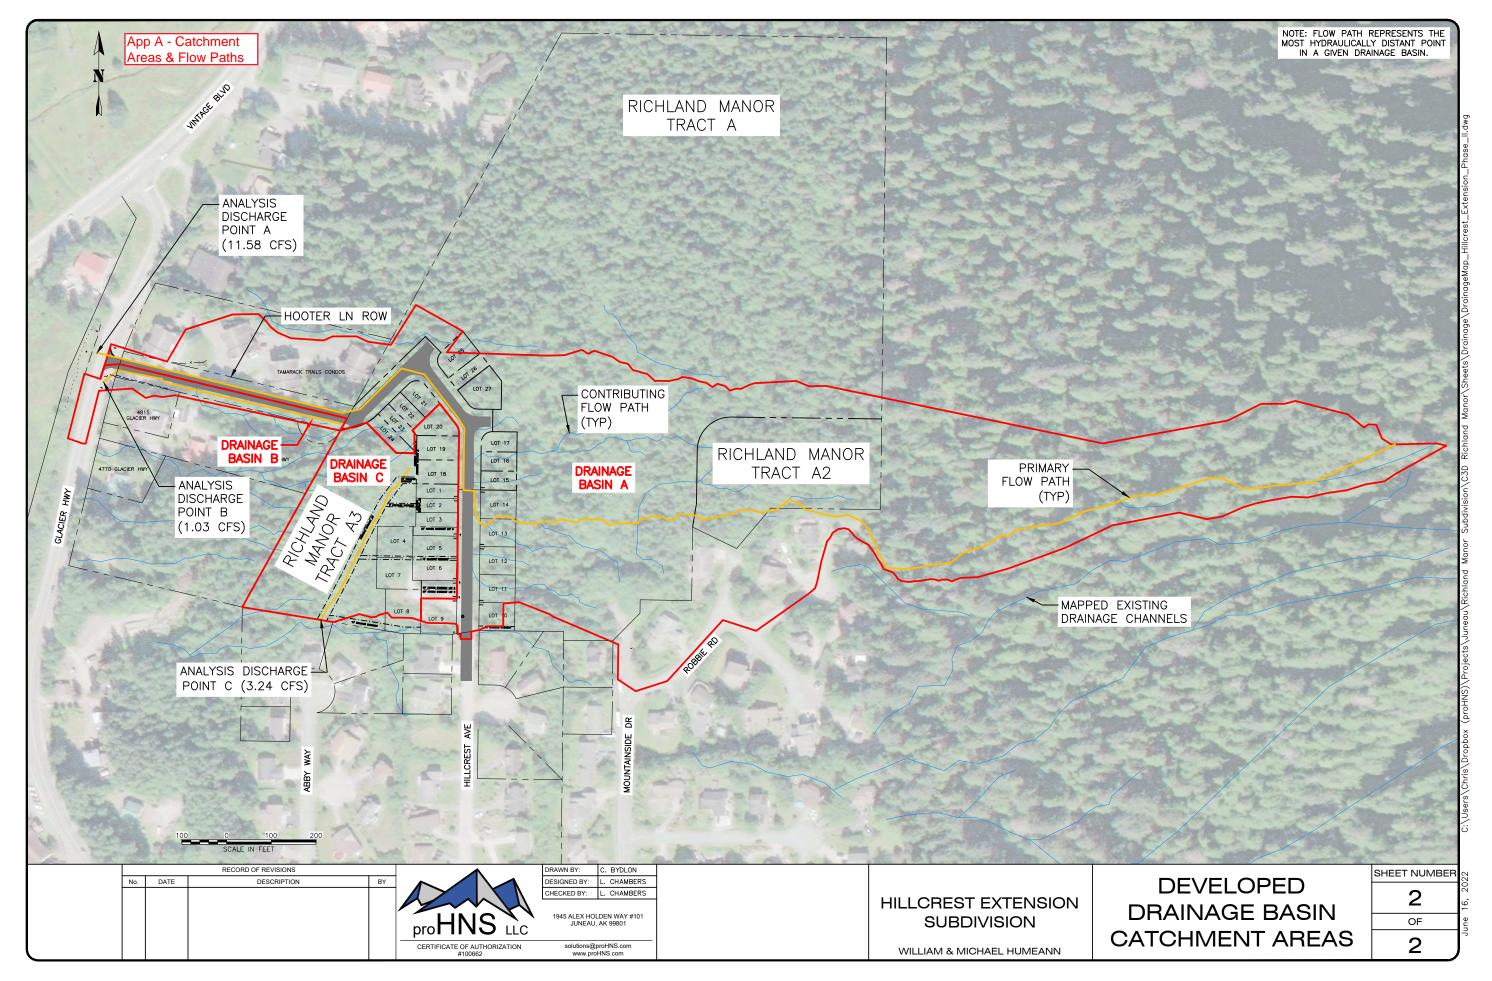

| Element ID | From (Inlet) Node | To (Outlet) Leng | th Inlet | Inlet | | Outlet Total | | Pipe Pipe | | Manning's Roughness | Entrance E Losses | xit/Bend Losses | | Initial Peak Flow Flow | | Travel Time | | Max Flow / Design Flow | Max | | Max Reported Flow Condition |
|---------------|----------------------|-------------------|-----------|--------|-----------|--------------|--------------|-------------|----------|------------------------|----------------------|--------------------|--------|---------------------------|----------|----------------|----------|---------------------------|-----------------|----------|--------------------------------|
| 10 | Noue | Noue | | | Elevation | | Slope 3 | or Height | | Nougilless | LUSSES | LUSSES | LUSSES | FIOW FIOW | Velocity | | Capacity | - | Total Depth Sur | | |
| | | | Elevation | Oliset | Elevation | Oliset | | or neigh | | | | | | | velocity | | Capacity | Natio | Ratio | nargeu i | рерип |
| | | (1 | t) (ft) | (ft) | (ft) | (ft) (ft) | (%) | (inches) | (inches) | | | | | (cfs) (cfs) | (ft/sec) | (min) | (cfs) | | | (min) | (ft) |
| P-1 | S-1 | END_OF_P-1 76.0 | 08 24.40 | 0.00 | 24.02 | 0.00 0.38 | 0.5000 CIRC | ULAR 36.000 | 36.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 11.58 | 5.84 | 0.22 | 51.07 | 0.23 | 0.32 | 0.00 | 0.97 Calculated |
| P-2 | S-2 | S-1 50.0 | 27.80 | 0.00 | 24.50 | 0.10 3.30 | 6.5900 CIRC | ULAR 30.000 | 30.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 11.60 | 14.96 | 0.06 | 114.09 | 0.10 | 0.22 | 0.00 | 0.54 Calculated |
| P-3 | S-3 | S-2 68.5 | 36.80 | 0.00 | 27.90 | 0.10 8.90 | 12.9900 CIRC | ULAR 30.000 | 30.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 11.60 | 19.00 | 0.06 | 160.14 | 0.07 | 0.18 | 0.00 | 0.45 Calculated |
| P-5 | S-4 | S-3 119.6 | 66 49.70 | 0.00 | 36.90 | 0.10 12.80 | 10.7000 CIRC | ULAR 30.000 | 30.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 11.61 | 17.78 | 0.11 | 145.33 | 0.08 | 0.19 | 0.00 | 0.48 Calculated |
| P-7 | S-5 | S-4 165.2 | 23 69.70 | 0.00 | 49.80 | 0.10 19.90 | 12.0400 CIRC | ULAR 30.000 | 30.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 10.12 | 17.67 | 0.16 | 154.21 | 0.07 | 0.17 | 0.00 | 0.44 Calculated |
| P-8 | S-6 | S-5 136.8 | 85.80 | 0.00 | 69.80 | 0.10 16.00 | 11.6900 CIRC | ULAR 30.000 | 30.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 9.96 | 17.40 | 0.13 | 151.94 | 0.07 | 0.17 | 0.00 | 0.43 Calculated |
| P-9 | S-7 | S-6 35.0 | 9 86.10 | 0.00 | 85.90 | 0.10 0.20 | 0.5700 CIRC | ULAR 18.000 | 18.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.47 | 2.61 | 0.22 | 8.59 | 0.06 | 0.16 | 0.00 | 0.24 Calculated |
| P-10 | S-8 | S-7 30.2 | | 0.00 | 86.20 | 0.10 1.00 | 3.3100 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.47 | 4.69 | 0.11 | 20.70 | 0.02 | 0.11 | 0.00 | 0.16 Calculated |
| P-11 | S-9 | S-8 32.2 | | 0.00 | 87.30 | | 16.4600 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.47 | 8.42 | 0.06 | 46.17 | 0.01 | 0.07 | 0.00 | 0.11 Calculated |
| P-12 | S-10 | S-9 37.4 | | 0.00 | 92.70 | | 10.9400 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.47 | 7.34 | 0.09 | 37.63 | 0.01 | 0.08 | 0.00 | 0.12 Calculated |
| P-13 | S-11 | S-10 22.2 | | 0.00 | 96.90 | | 11.6900 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.47 | 7.50 | 0.05 | 38.91 | 0.01 | 0.08 | 0.00 | 0.12 Calculated |
| P-14 | S-12 | S-6 129.3 | | 0.00 | 85.90 | 0.10 12.00 | 9.2900 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 9.64 | 16.00 | 0.13 | 135.47 | 0.07 | 0.18 | 0.00 | 0.45 Calculated |
| | D-TRAP-INLET_1 | S-12 100.7 | | 0.00 | 98.00 | 0.10 8.40 | 8.3400 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.36 | 5.80 | 0.29 | 70.76 | 0.01 | 0.05 | 0.00 | 0.10 Calculated |
| P-16 | S-13 | S-12 66.0 | | 0.00 | 98.00 | 0.10 3.00 | 4.5400 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 9.44 | 12.58 | 0.09 | 52.22 | 0.18 | 0.29 | 0.00 | 0.58 Calculated |
| P-17 | S-14 | S-13 32.9 | | | 103.00 | 2.00 1.10 | 3.3400 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.57 | 5.12 | 0.11 | 20.78 | 0.03 | 0.11 | 0.00 | 0.17 Calculated |
| P-18 | S-15 | S-14 29.3 | | 0.00 | 104.20 | 0.10 0.20 | 0.6800 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | | 2.93 | 0.17 | 9.40 | 0.06 | 0.17 | 0.00 | 0.25 Calculated |
| P-19 | S-16 | S-15 33.7 | | 0.00 | 104.50 | 0.10 0.40 | 1.1800 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.57 | 3.57 | 0.16 | 12.39 | 0.05 | 0.15 | 0.00 | 0.22 Calculated |
| P-20 | S-17 | S-16 50.9 | | 0.00 | 105.00 | 0.10 0.90 | 1.7700 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.57 | 4.09 | 0.21 | 15.12 | 0.04 | 0.13 | 0.00 | 0.20 Calculated |
| P-21 | S-18 | S-13 143.7 | | 0.00 | 101.10 | 0.10 0.80 | 0.5600 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 9.03 | 5.80 | 0.41 | 18.28 | 0.49 | 0.50 | 0.00 | 0.99 Calculated |
| P-22 | S-EX-1 | S-18 126.0 | | 0.00 | 105.00 | 3.10 1.00 | 0.7900 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 5.87 | 5.94 | 0.35 | 10.13 | 0.58 | 0.55 | 0.00 | 0.82 Calculated |
| P-23 | S-19 | S-18 43.4 | | 0.00 | 102.00 | | 1.1500 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 3.12 | 5.61 | 0.13 | 26.28 | 0.12 | 0.23 | 0.00 | 0.47 Calculated |
| | DIMENT-TRAP_2 | S-19 31.5 | | -0.20 | 102.50 | | 17.4400 CIRC | | | 0.0150 | 0.5000 | 0.5000 | 0.0000 | 0.00 0.16 | | 0.10 | 38.70 | 0.00 | 0.05 | 0.00 | 0.07 Calculated |
| P-25 | S-20 | S-19 40.4 | | 0.00 | 105.50 | 3.00 0.50 | 1.2400 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 3.04 | 5.88 | 0.11 | 12.65 | 0.24 | 0.33 | 0.00 | 0.50 Calculated |
| P-26 | S-21 | S-20 42.8 | | 0.00 | 106.10 | 0.10 0.30 | 0.7000 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 3.04 | 4.79 | 0.15 | 9.52 | 0.32 | 0.39 | 0.00 | 0.58 Calculated |
| P-27 | S-22 | S-21 38.3 | | 0.00 | 106.50 | 0.10 0.40 | 1.0400 CIRC | | | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 3.04 | 5.54 | 0.12 | 11.62 | 0.26 | 0.35 | 0.00 | 0.52 Calculated |
| P-EX-1 | P-EX-1_INLET E | ND_OF_P-EX-1 34.9 | 27.50 | 0.00 | 27.10 | 0.00 0.40 | 1.1500 CIRC | ULAR 18.000 | 18.00 | 0.0120 | 0.5000 | 0.5000 | 0.0000 | 0.00 1.03 | 4.20 | 0.14 | 12.18 | 0.08 | 0.20 | 0.00 | 0.30 Calculated |

| S | SN | Element | X Coordinate | Y Coordinate Description | n Invert | Boundary | Flap | Fixed | Peak | Peak | Maximum | Maximum |
|---|---------|---------------|--------------|--------------------------|-----------|----------|------|-----------|--------|---------|------------------|----------------------|
| | | ID | | | Elevation | Туре | Gate | Water | Inflow | Lateral | HGL Depth | HGL Elevation |
| | | | | | | | | Elevation | | Inflow | Attained | Attained |
| | | | | | | | | | | | | |
| | | | | | (ft) | | | (ft) | (cfs) | (cfs) | (ft) | (ft) |
| | 1 | END_OF_P-1 | 2526888.51 | 2379837.82 | 24.02 | FREE | NO | | 11.58 | 0.00 | 0.97 | 24.99 |
| | 2 | END_OF_P-EX-1 | 2526933.45 | 2379754.07 | 27.10 | FREE | NO | | 1.03 | 0.00 | 0.30 | 27.40 |
| | 3 SWALE | NEAR TRACT AS | 2527489 84 | 2379116 91 | 0.00 | FRFF | NO | | 3 24 | 3 24 | 0.00 | 0.00 |

| Element | Invert | Ground/Rim | Ground/Rim | Initial | Initial | Surcharge | Surcharge | Ponded | Minimum | Peak | Peak | Maximum | Minimum | Total | Total | |
|------------------|----------|------------|------------|-----------|---------|-----------|-----------|--------|------------|--------|---------|-----------|-----------|-------------|-----------|--|
| ID E | levation | (Max) | (Max) | Water | Water | Elevation | Depth | Area | Pipe Cover | Inflow | Lateral | Surcharge | Freeboard | Flooded | Time | |
| | | Elevation | Offset | Elevation | Depth | | | | | | Inflow | Depth | Attained | Volume | Flooded | |
| | | | | | | | | | | | | Attained | | | | |
| | (ft) | (ft) | (ft) | (ft) | (ft) | (ft) | (ft) | (ft²) | (inches) | (cfs) | (cfs) | (ft) | (ft) | (ac-inches) | (minutes) | |
| S-1 | 24.40 | 29.03 | 4.63 | 24.40 | 0.00 | 29.03 | 0.00 | 0.00 | | 11.60 | | | 3.66 | 0.00 | 0.00 | |
| S-2 | 27.80 | 32.26 | | 27.80 | 0.00 | 32.26 | 0.00 | 0.00 | | 11.60 | | | 3.90 | 0.00 | 0.00 | |
| S-3 | 36.80 | 40.47 | 3.67 | 36.80 | 0.00 | 40.47 | 0.00 | 0.00 | | 11.61 | 0.00 | | 3.09 | 0.00 | 0.00 | |
| S-4 | 49.70 | 54.83 | 5.13 | 49.70 | 0.00 | 54.83 | 0.00 | 0.00 | | 11.60 | 1.68 | | 4.60 | 0.00 | 0.00 | |
| S-5 | 69.70 | 74.66 | 4.96 | 69.70 | 0.00 | 74.66 | 0.00 | 0.00 | 28.31 | 10.12 | 0.29 | | 4.43 | 0.00 | 0.00 | |
| S-6 | 85.80 | 90.62 | 4.82 | 85.80 | 0.00 | 90.62 | 0.00 | 0.00 | | 9.96 | 0.00 | | 4.27 | 0.00 | 0.00 | |
| S-7 | 86.10 | 90.61 | | 86.10 | 0.00 | 90.61 | 0.00 | 0.00 | 34.91 | | 0.00 | | 4.25 | 0.00 | 0.00 | |
| S-8 | 87.20 | 93.06 | 5.86 | 87.20 | 0.00 | 93.06 | 0.00 | 0.00 | 51.15 | 0.47 | 0.00 | | 5.66 | 0.00 | 0.00 | |
| S-9 | 92.60 | 96.93 | 4.33 | 92.60 | 0.00 | 96.93 | 0.00 | 0.00 | 32.72 | 0.47 | 0.00 | | 4.11 | 0.00 | 0.00 | |
| S-10 | 96.80 | 101.43 | 4.63 | 96.80 | 0.00 | 101.43 | 0.00 | 0.00 | 36.32 | 0.47 | 0.00 | | 4.41 | 0.00 | 0.00 | |
| S-11 | 99.50 | 103.00 | | 99.50 | 0.00 | 103.00 | 0.00 | 0.00 | | 0.47 | 0.47 | | 3.38 | 0.00 | 0.00 | |
| S-12 | 97.90 | 105.21 | 7.31 | 97.90 | 0.00 | 105.21 | 0.00 | 0.00 | 57.76 | 9.64 | 0.00 | | 6.64 | 0.00 | 0.00 | |
| S-13 | 101.00 | 108.20 | 7.20 | 101.00 | 0.00 | 108.20 | 0.00 | 0.00 | 44.38 | 9.44 | 0.00 | | 5.03 | 0.00 | 0.00 | |
| S-14 | 104.10 | 107.68 | 3.58 | 104.10 | 0.00 | 107.68 | 0.00 | 0.00 | | 0.57 | 0.00 | | 3.23 | 0.00 | 0.00 | |
| S-15 | 104.40 | 108.02 | 3.62 | 104.40 | 0.00 | 108.02 | 0.00 | 0.00 | 24.22 | 0.57 | 0.00 | 0.00 | 3.30 | 0.00 | 0.00 | |
| S-16 | 104.90 | 108.52 | 3.62 | 104.90 | 0.00 | 108.52 | 0.00 | 0.00 | 24.20 | 0.57 | 0.00 | 0.00 | 3.32 | 0.00 | 0.00 | |
| S-17 | 105.90 | 109.43 | 3.53 | 105.90 | 0.00 | 109.43 | 0.00 | 0.00 | 24.42 | 0.57 | 0.57 | 0.00 | 3.34 | 0.00 | 0.00 | |
| S-18 | 101.90 | 110.56 | 8.66 | 101.90 | 0.00 | 110.56 | 0.00 | 0.00 | 48.67 | 9.03 | 0.08 | | 4.74 | 0.00 | 0.00 | |
| S-19 | 102.50 | 109.91 | 7.41 | 102.50 | 0.00 | 109.91 | 0.00 | 0.00 | 34.87 | 3.12 | 0.00 | 0.00 | 3.91 | 0.00 | 0.00 | |
| S-20 | 106.00 | 109.67 | 3.67 | 106.00 | 0.00 | 109.67 | 0.00 | 0.00 | 24.80 | 3.04 | 0.00 | 0.00 | 2.98 | 0.00 | 0.00 | |
| S-21 | 106.40 | 110.01 | 3.61 | 106.40 | 0.00 | 110.01 | 0.00 | 0.00 | 24.13 | 3.04 | 0.00 | 0.00 | 2.99 | 0.00 | 0.00 | |
| S-22 | 106.90 | 110.47 | 3.57 | 106.90 | 0.00 | 110.47 | 0.00 | 0.00 | 24.87 | 3.04 | 3.04 | 0.00 | 3.05 | 0.00 | 0.00 | |
| S-EX-1 | 106.00 | 108.47 | 2.47 | 106.00 | 0.00 | 108.47 | 0.00 | 0.00 | 11.60 | 5.88 | 5.88 | 0.00 | 1.65 | 0.00 | 0.00 | |
| P-EX-1_INLET | 27.50 | 27.50 | 0.00 | 0.00 | -27.50 | 6.00 | -21.50 | 0.00 | 0.00 | 1.03 | 1.03 | 0.00 | 1.20 | 0.00 | 0.00 | |
| SEDIMENT-TRAP_2 | 108.20 | 108.20 | 0.00 | 0.00 | -108.20 | 6.00 | -102.20 | 0.00 | 0.00 | 0.16 | 0.16 | 0.00 | 1.43 | 0.00 | 0.00 | |
| SED-TRAP-INLET_1 | 106.40 | 106.40 | 0.00 | 0.00 | -106.40 | 6.00 | -100.40 | 0.00 | 0.00 | 0.36 | 0.36 | 0.00 | 1.90 | 0.00 | 0.00 | |
| | | | | | | | | | | | | | | | | |

App B - SSA

| SN | Element Description | Data | Data | Rainfall | Rain | State | County | Return | Rainfall | Rainfall |
|--------|----------------------------|------------|----------|-----------|--------|------------|----------|---------|----------|-------------------|
| | ID | Source S | Source | Type | Units | | | Period | Depth | Distribution |
| | | | ID | | | | | | | |
| | | | | | | | | (vears) | (inches) | |
| | | | | | | | | (years) | (inches) | |
| 1 MOUN | ITAINSIDE_RAIN T | ime Series | TS-01 Ct | umulative | inches | Alaska Jun | ieau (B) | 25 | 4.82 9 | SCS Type IA 24-hr |

| SN | Element Description | Area | Drainage ' | Weighted | Rain Gage | Peak | Total | Total | Peak | Time |
|-------|--------------------------|---------|--------------------|----------|-------------------|--------|--------------|---------------|--------|----------------------|
| | ID | | Node ID | Curve | ID | Rate P | recipitation | Runoff I | Runoff | of |
| | | | Number | | Factor | | | Concentration | | |
| | | (acres) | | | | | (inches) | (inches) | (cfs) | (days hh:mm:ss) |
| | · | (acres) | | | | | (iliciles) | (iiiciies) | (CI3) | (uays IIII.IIIII.35) |
| 3 | GRAVEL_A-1 | 0.07 | SED-TRAP-INLET_1 | 91.00 | MOUNTAINSIDE RAIN | 484 | 4.82 | 3.81 | 0.07 | 0 00:05:00 |
| 4 | GRAVEL_A-2 | 0.16 | SEDIMENT-TRAP_2 | 91.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 3.81 | 0.16 | 0 00:05:00 |
| 5 | LOTS_10-14 | 0.65 | S-EX-1 | 92.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 3.91 | 0.67 | 0 00:06:55 |
| 6 | LOTS_15-17 | 0.27 | S-22 | 92.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 3.91 | 0.28 | 0 00:06:06 |
| 8 | LOTS_22-25 | 0.33 | S-11 | 92.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 3.91 | 0.34 | 0 00:11:31 |
| 9 | Lots_25-27 | 0.34 | S-17 | 92.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 3.91 | 0.35 | 0 00:05:00 |
| 10 | ROAD_A-1 | 0.25 | S-5 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.29 | 0 00:05:00 |
| 11 | ROAD_A-2 | 0.10 | SED-TRAP-INLET_1 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.12 | 0 00:05:00 |
| 12 | ROAD_A-3 | 0.12 | S-11 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.14 | 0 00:05:00 |
| 13 | ROAD_A-4 | 0.07 | S-17 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.08 | 0 00:05:00 |
| 14 | ROAD_A-5 | 0.07 | S-18 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.08 | 0 00:05:00 |
| 15 | ROAD_A-6 | 0.07 | S-22 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.08 | 0 00:05:00 |
| 16 | ROAD_A-7 | 0.21 | S-EX-1 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.24 | 0 00:05:00 |
| 17 | ROAD_A-8 | 0.12 | S-22 | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.14 | 0 00:05:00 |
| 19 TA | MARACK_TRAIL_APARTMENTS | 1.54 | S-4 | 95.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.24 | 1.68 | 0 00:09:54 |
| 21 | UPLANDS_A-1 | 10.90 | S-EX-1 | 77.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 2.47 | 5.36 | 0 00:32:45 |
| 22 | UPLANDS_A-2 | 5.86 | S-22 | 77.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 2.47 | 2.79 | 0 00:36:34 |
| 23 | UPLANDS_A-3 | 0.34 | S-17 | 77.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 2.47 | 0.17 | 0 00:27:44 |
| 24 | UPLANDS_A-4 | 0.25 | SED-TRAP-INLET_1 | 80.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 2.74 | 0.17 | 0 00:05:00 |
| 18 | ROAD_B-1 | 0.34 | P-EX-1_INLET | 98.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.58 | 0.39 | 0 00:05:00 |
| 1 | ADJACENT_RESIDENTIAL_B-1 | 0.63 | P-EX-1_INLET | 92.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 3.91 | 0.64 | 0 00:05:00 |
| 20 | TRACT_A3 | 1.18 5 | WALE_NEAR_TRACT_A3 | 95.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 4.24 | 1.29 | 0 00:07:50 |
| 7 | LOTS_1-9_18-20 | 1.35 \$ | WALE_NEAR_TRACT_A3 | 92.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 3.91 | 1.38 | 0 00:06:43 |
| 2 | GRASS/DRAINGE_EASEMENT | 0.86 S | WALE_NEAR_TRACT_A3 | 80.00 | MOUNTAINSIDE_RAIN | 484 | 4.82 | 2.74 | 0.57 | 0 00:08:15 |

HY-8 Analysis Results

Crossing Summary Table

Calculated Flow

Culvert Crossing: 36-INCH CMP (PROPOSED)

| Headwater Elevation (ft) | Total Discharge (cfs) | P-1 Discharge (cfs) | Roadway Discharge (cfs) | Iterations |
|--------------------------|-----------------------|---------------------|----------------------------|-------------|
| 24.89 | 1.0 | 1.00 | 0.00 | 1 |
| 25.63 | 5.90 | 5.90 | 0.00 | 1 |
| 26.17 | 11.58 | 11.58 | 0.00 | 1 |
| 26.50 | 15.70 | 15.70 | 0.00 | 1 |
| 26.86 | 20.60 | 20.60 | 0.00 | 1 |
| 27.20 | 25.50 | 25.50 | 0.00 | 1 |
| 27.54 | 30.40 | 30.40 | 0.00 | 1 |
| 27.89 | 35.30 | 35.30 | 0.00 | 1 |
| 28.29 | 40.20 | 40.20 | 0.00 | 1 |
| 28.86 | 45.10 | 45.10 | 0.00 | 1 |
| 29.29 | 50.00 | 48.73 | 1.25 | 8 |
| 29.17 | 4 7. 75 | 47.75 | 0.00 | Overtopping |

Discharge Needed

HY-8 Analysis Results

Crossing Summary Table

Calculated Flow

Culvert Crossing: P-EX-1

| Headwater Elevation (ft) | Total Discharge (cfs) | P-EX-1 Discharge (cfs) | Roadway Discharge (cfs) | Iterations |
|--------------------------|-----------------------|------------------------|-------------------------|-------------|
| | | (* / | (/ | |
| 28.11 | 1.03 | 1.03 | 0.00 | 1 |
| 28.67 | 3.40 | 3.40 | 0.00 | 1 |
| 29.12 | 5.80 | 5.80 | 0.00 | 1 |
| 29.72 | 8.20 | 8.20 | 0.00 | 1 |
| 30.07 | 10.60 | 9.06 | 1.51 | 13 |
| 30.12 | 13.00 | 9.19 | 3.78 | 5 |
| 30.17 | 15.40 | 9.28 | 6.06 | 4 |
| 30.21 | 17.80 | 9.37 | 8.39 | 4 |
| 30.24 | 20.20 | 9.46 | 10.67 | 3 |
| 30.28 | 22.60 | 9.53 | 13.01 | 3 |
| 30.31 | 25.00 | 9.63 | 15.37 | 3 |
| 30.00 | 8.89 | 8.89 | 0.00 | Overtopping |

Discharge Needed

App D - Rainfall



NOAA Atlas 14, Volume 7, Version 2 Location name: Juneau, Alaska, USA* Latitude: 58.3454°, Longitude: -134.4896° Elevation: 120.33 ft** *source: ESRI Maps *source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Douglas Kane, Sarah Dietz, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Svetlana Stuefer, Amy Tidvell, Carl Trypaluk, Dale Unruh, Michael Yekta, Erica Betts, Geoffrey Bonnin, Sarah Heim, Lillian Hiner, Elizabeth Lilly, Jayashreve Narayanan, Fenglin Yan, Tan Zhao

NOAA, National Weather Service, Silver Spring, Maryland

and
University of Alaska Fairbanks, Water and Environmental Research Center

PF_tabular | PF_graphical | Maps_&_aerials

PF tabular

| Duration | | | | Avera | ge recurren | ce interval (| years) | | | |
|----------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------------|-------------------------|-------------------------|-------------------------|------------------------|
| Duration | 1 | 2 | 5 | 10 | 25 | 50 | 100 | 200 | 500 | 1000 |
| 5-min | 0.131 (0.106-0.166) | 0.153 (0.122-0.197) | 0.187 (0.146-0.246) | 0.215 (0.165-0.287) | 0.253 (0.189-0.346) | 0.282 (0.207-0.393) | 0.312 (0.225-0.442) | 0.350 (0.248-0.505) | 0.400 (0.277-0.590) | 0.438 (0.299-0.65 |
| 10-min | 0.176 (0.142-0.223) | 0.206 (0.164-0.265) | 0.251 (0.195-0.330) | 0.288 (0.220-0.385) | 0.339 (0.253-0.464) | 0.379 (0.278-0.528) | 0.418 (0.302-0.592) | 0.470 (0.333-0.678) | 0.537 (0.372-0.792) | 0.588 (0.401-0.88 |
| 15-min | 0.206 (0.166-0.261) | 0.241 (0.192-0.310) | 0.293 (0.228-0.385) | 0.337 (0.258-0.450) | 0.397 (0.297-0.543) | 0.443 (0.325-0.617) | 0.490 (0.353-0.694) | 0.549 (0.389-0.791) | 0.629 (0.436-0.927) | 0.689 (0.470-1.0 |
| 30-min | 0.273 (0.220-0.346) | 0.320 (0.255-0.411) | 0.389 (0.303-0.511) | 0.447 (0.342-0.597) | 0.527 (0.394-0.721) | 0.588 (0.432-0.819) | 0.650 (0.469-0.921) | 0.729 (0.517-1.05) | 0.834 (0.578-1.23) | 0.914 (0.623-1.3 |
| 60-min | 0.374 (0.302-0.474) | 0.438 (0.349-0.563) | 0.533 (0.415-0.700) | 0.613 (0.469-0.819) | 0.722 (0.539-0.988) | 0.806 (0.592-1.12) | 0.890 (0.642-1.26) | 0.999 (0.708-1.44) | 1.14 (0.792-1.69) | 1.25 (0.853-1.8 |
| 2-hr | 0.552 (0.445-0.700) | 0.647 (0.515-0.832) | 0.789 (0.614-1.04) | 0.906 (0.693-1.21) | 1.07 (0.798-1.46) | 1.19 (0.875-1.66) | 1.32 (0.949-1.86) | 1.48 (1.05-2.13) | 1.69 (1.17-2.49) | 1.85 (1.26-2.77 |
| 3-hr | 0.729 (0.588-0.925) | 0.854 (0.680-1.10) | 1.04 (0.811-1.37) | 1.20 (0.915-1.60) | 1.41 (1.05-1.93) | 1.57 (1.15-2.19) | 1.73 (1.25-2.46) | 1.95 (1.38-2.81) | 2.23 (1.54-3.29) | 2.44 (1.66-3.66 |
| 6-hr | 1.17 (0.944-1.48) | 1.37 (1.09-1.76) | 1.67 (1.30-2.19) | 1.92 (1.47-2.56) | 2.26 (1.69-3.09) | 2.52 (1.85-3.51) | 2.78 (2.01-3.94) | 3.13 (2.22-4.51) | 3.58 (2.48-5.27) | 3.92 (2.67-5.88 |
| 12-hr | 1.76 (1.42-2.23) | 2.06 (1.64-2.65) | 2.50 (1.95-3.29) | 2.87 (2.19-3.83) | 3.38 (2.53-4.62) | 3.79 (2.78-5.27) | 4.21 (3.04-5.96) | 4.73 (3.35-6.82) | 5.42 (3.76-7.99) | 5.94 (4.05-8.9 |
| 24-hr | 2.54 (2.30-2.84) | 2.97 (2.65-3.37) | 3.59 (3.14-4.16) | 4.10 (3.52-4.83) | 4.82 (4.05-5.81) | 5.41 (4.46-6.64) | 6.04 (4.90-7.54) | 6.78 (5.41-8.61) | 7.76 (6.05-10.1) | 8.51 (6.52-11.2 |
| 2-day | 3.45 (3.12-3.87) | 4.01 (3.58-4.55) | 4.79 (4.19-5.55) | 5.42 (4.65-6.38) | 6.29 (5.28-7.59) | 7.00 (5.77-8.59) | 7.74 (6.28-9.66) | 8.59 (6.85-10.9) | 9.72 (7.57-12.6) | 10.6 (8.10-13.9 |
| 3-day | 4.10 (3.70-4.58) | 4.73 (4.22-5.36) | 5.61 (4.90-6.49) | 6.30 (5.41-7.42) | 7.26 (6.09-8.75) | 8.03 (6.62-9.85) | 8.82 (7.15-11.0) | 9.72 (7.75-12.3) | 10.9 (8.51-14.2) | 11.8 (9.06-15.0 |
| 4-day | 4.63 (4.18-5.18) | 5.32 (4.75-6.04) | 6.28 (5.49-7.27) | 7.03 (6.04-8.28) | 8.07 (6.77-9.72) | 8.88 (7.33-10.9) | 9.73 (7.89-12.1) | 10.7 (8.51-13.6) | 11.9 (9.30-15.5) | 12.9 (9.87-17.0 |
| 7-day | 5.98 (5.40-6.69) | 6.84 (6.10-7.75) | 8.02 (7.00-9.28) | 8.94 (7.68-10.5) | 10.2 (8.57-12.3) | 11.2 (9.25-13.8) | 12.3 (9.93-15.3) | 13.4 (10.7-17.0) | 15.0 (11.7-19.4) | 16.1 (12.4-21.3 |
| 10-day | 7.07 (6.39-7.92) | 8.07 (7.20-9.15) | 9.44 (8.24-10.9) | 10.5 (9.02-12.4) | 12.0 (10.0-14.4) | 13.1 (10.8-16.1) | 14.3 (11.6-17.8) | 15.6 (12.5-19.8) | 17.4 (13.6-22.6) | 18.7 (14.4-24.7 |
| 20-day | 10.6 (9.59-11.9) | 12.1 (10.8-13.7) | 14.1 (12.3-16.3) | 15.6 (13.4-18.3) | 17.6 (14.8-21.2) | 19.2 (15.8-23.5) | 20.7 (16.8-25.9) | 22.4 (17.9-28.5) | 24.7 (19.3-32.1) | 26.4 (20.2-34.8 |
| 30-day | 14.0 (12.6-15.6) | 15.9 (14.2-18.1) | 18.5 (16.2-21.4) | 20.4 (17.5-24.0) | 22.9 (19.3-27.7) | 24.9 (20.5-30.5) | 26.8 (21.7-33.4) | 28.8 (23.0-36.6) | 31.5 (24.6-40.9) | 33.5 (25.7-44.2 |
| 45-day | 18.5 (16.7-20.7) | 21.1 (18.8-23.9) | 24.5 (21.4-28.4) | 27.0 (23.2-31.8) | 30.1 (25.3-36.3) | 32.5 (26.8-39.8) | 34.8 (28.2-43.4) | 37.1 (29.5-47.1) | 40.1 (31.3-52.0) | 42.4 (32.5-55.5 |
| 60-day | 22.1 (19.9-24.7) | 25.4 (22.6-28.8) | 29.5 (25.7-34.1) | 32.3 (27.8-38.1) | 35.9 (30.1-43.3) | 38.4 (31.7-47.1) | 40.8 (33.1-50.9) | 43.0 (34.2-54.5) | 45.8 (35.7-59.5) | 48.0 (36.8-63.4 |

Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).


Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.

|Please refer to NOAA Atlas 14 document for more information.

Back to Top


PF graphical

App D - Rainfall

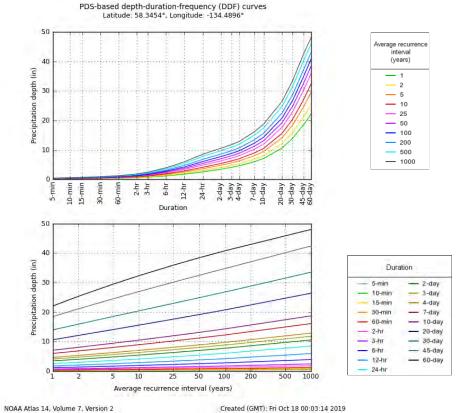


Back to Top


Maps & aerials



App D - Rainfall








Back to Top

US Department of Commerce
National Oceanic and Atmospheric Administration
National Weather Service
National Water Center
1325 East West Highway
Silver Spring, MD 20910
Questions: HDSC Questions@noa.gov

Disclaime

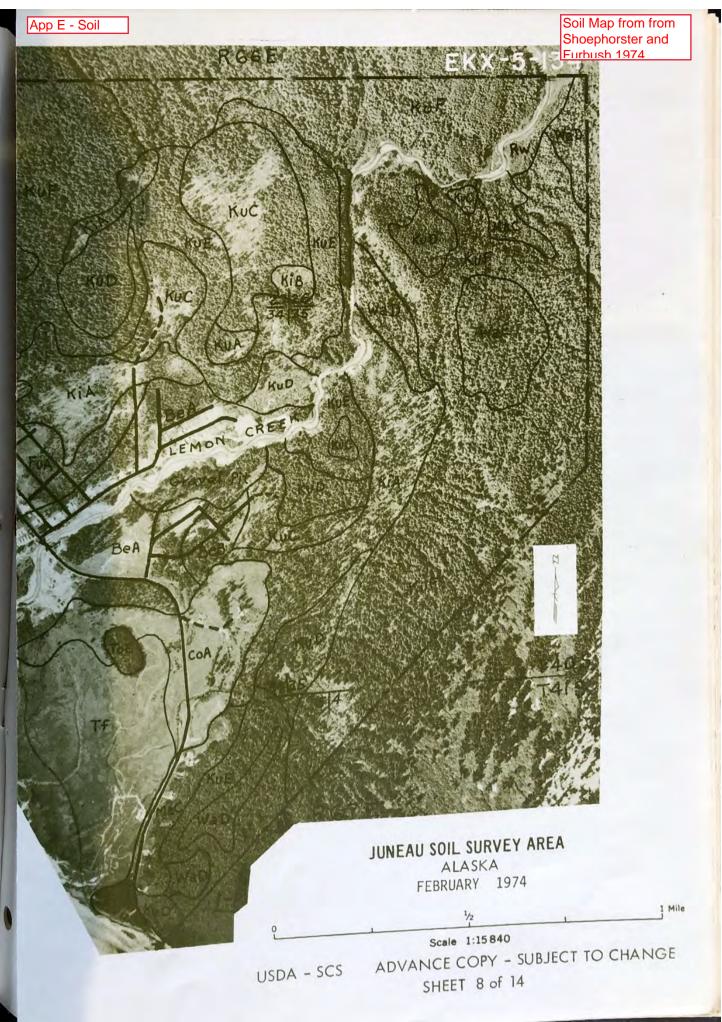

Attachment E - Approved Drainage Plan

0i2 18-60" Yellowish brown (10YR 5/6) peat, yellow (10YR 7/6) pressed; about 80 percent fiber, 50 percent after rubbing; largely sphagnum moss fibers; extremely acid.

The peat materials are more than 5 feet thick. They may be underlain by till, bedrock, or alluvial sediments. The water table is usually near the surface.

Mapping Units:

- (KoA) Kogish peat, 0 to 3 percent slopes
 (KoB) Kogish peat, 3 to 7 percent slopes
 (KoC) Kogish peat, 7 to 12 percent slopes
- (KoD) Kogish peat, 12 to 20 percent slopes

The Kogish soils in these mapping units are similar except for gradient. In places, small ponds and patches of Kina and Fu soils are included in the mapped areas.

Kupreanof Series

The Kupreanof series consists of well drained soils on moraines. These soils are formed in very gravelly loamy till. Beneath a layer of forest litter, they have a thin light brownish gray layer, fairly thick layers with dark reddish brown to dark grayish brown colors, and an olive gray substratum. They support a forest dominated by Sitka spruce and western hemlock.

Representative profile of Kupreanof gravelly silt loam; NW_4^1 , NW_4^1 , Sec. 11, T39S, R64E, Copper River Meridian.

- 01 7-2" Black (10YR 2/1) partially decomposed forest litter; many roots; abrupt smooth boundary.
- 02 2-0" Black (5YR 2/1) muck; many roots; extremely acid; abrupt smooth boundary.
- A2 0-12" Light brownish gray (10YR 6/2) gravelly silt loam; massive; very friable; smeary; many fine roots; extremely acid; abrupt irregular boundary.

- Dark reddish brown (5YR 2/2) gravelly silt loam; weak fine granular structure; very friable; smeary; few roots; extremely acid; abrupt wavy boundary.
- B22 4-9" Dark reddish brown (5YR 3/4) gravelly silt loam; weak fine subangular blocky structure; very friable; smeary; extremely acid; gradual boundary.
- B23 9-18" Dark brown (7.5YR 4/4) gravelly silt loam; weak fine sub-angular blocky structure; very friable; smeary; few roots; very strongly acid; clear wavy boundary.
- B3 18-24" Dark grayish brown (2.5Y 4/2) very gravelly sandy loam; few patches of dark brown (7.5YR 3/3); massive; friable; strongly acid; clear wavy boundary.
- Cl 24-60" Olive gray (5Y 4/2) very gravelly sandy loam; massive; friable; strongly acid.

The texture of the mineral surface layer ranges from gravelly silt loam to very gravelly sandy loam. The substratum ranges in texture from very gravelly loam to very gravelly sandy loam. Coarse fragments make up 40 to 60 percent of its volume. Large stones and boulders are common.

Mapping Units:

- (KuA) Kupreanof gravelly silt loam, 0 to 3 percent slopes
 (KuB) Kupreanof gravelly silt loam, 3 to 7 percent slopes
 (KuC) Kupreanof gravelly silt loam, 7 to 12 percent slopes
 (KuD) Kupreanof gravelly silt loam, 12 to 20 percent slopes
- The Kupreanof soils in each of these mapping units are similar except for gradient. The mapped areas include small spots of Wadleigh, Maybeso, and Karta soils. There are also a few patches of Tolstoi soils.

```
(KuE) - <u>Kupreanof</u> gravelly silt loam, 20 to 35 percent slopes
(KuF) - <u>Kupreanof</u> gravelly silt loam, 35 to 75 percent slopes
```

Mapped, but not consistent with soils encountered on-site during

These soils occur on moderately steep and steep uplands. In addition to small spots of Tolstoi and Karta soils, the mapped areas include a few nearly level to moderately sloping Kupreanof soils on narrow benches and rounded ridgetops.

Mapped and consistent with soils encountered on-site



In the Tolstoi soils, depth to bedrock ranges from 5 to 20 inches. The texture of the soil materials ranges from stony silt loam to very stony sandy loam.

In the McGilvery soils, the forest litter ranges from 6 to 20 inches in thickness. In places, 1 to 4 inches of loamy material occurs between the litter and the underlying bedrock.

Mapping Units:

- (ToC) & (ToD) Tolstoi-McGilvery complex, 12 to 20 percent slopes
- (ToE) Tolstoi-McGilvery complex, 20 to 35 percent slopes
- (ToF) Tolstoi-McGilvery complex, 35 to 75 percent slopes

The soils in these mapping units are similar except for gradient.

They commonly have very rough irregular slopes. The mapped areas include many sheer rocky cliffs and other rock outcrops, and wet spots with Wadleigh, Maybeso, and Kaikli soils.

Wadleigh Series

The Wadleigh series consists of somewhat poorly drained soils that occur on lower slopes of hills and mountains. These soils are formed in very gravelly loamy materials underlain by firm glacial till that impedes internal drainage. They have a mat of forest litter, a thin grayish brown layer, and dark reddish brown to dark yellowish brown layers above the firm substratum. The vegetation is a forest of western hemlock and scattered Sitka spruce.

Representative profile of Wadleigh gravelly silt loam; $NE^{\frac{1}{4}}$ $NW^{\frac{1}{4}}$, Sec. 25, T37S, R63E, Copper River Meridian.

- 01 8-3" Dark reddish brown (5YR 2/2) partially decomposed forest litter; many roots; clear smooth boundary.
- 02 3-0" Black (5YR 2/1) finely divided organic matter; many roots; abrupt smooth boundary.

- A2 0-3" Grayish brown (10YR 5/2) gravelly silt loam; few fine prominent (7.5YR 4/4) mottles; very weak medium subangular blocky structure; friable; roots common; abrupt wavy boundary.
- B21 3-5" Dark reddish brown (5YR 2/2) very gravelly silt loam; moderate fine granular structure; very friable; few soft fine concretions; few weakly cemented fragments; smeary when rubbed; roots common; very strongly acid; clear irregular boundary.
- B22 5-10" Dark brown (7.5YR 3/2) very gravelly sandy loam; weak fine subangular blocky structure; friable; slightly smeary; roots common; very strongly acid; clear wavy boundary.
- Dark yellowish brown (10YR 3/4) very gravelly sandy loam; very weak medium subangular blocky structure; friable; roots common; very strongly acid; clear smooth boundary.
- B3x 16-23" Olive brown (2.5Y 4/4) very gravelly sandy loam; few fine prominent strong brown (7.5YR 5/6) mottles, and many streaks of dark brown (10YR 4/3); weak medium platy structure; weakly cemented; slightly brittle; clear smooth boundary.
- Clx 23-30" Patchy olive gray (5Y 4/2) and dark grayish brown (2.5Y 4/2) very gravelly sandy loam; few medium distinct olive brown (2.5Y 4/4) mottles; very weak medium platy structure; weakly cemented; slightly brittle; clear smooth boundary.
- C2 30-60" Olive gray (5Y 4/2) very gravelly loam; few medium faint dark gray (5Y 4/1) mottles; massive; slightly sticky, slightly plactic; very strongly acid.

The surface texture ranges from silt loam to very gravelly sandy loam. Below 10 inches coarse fragments, including cobblestones, make up 35 to 65 percent of the soil volume. Depth to the firm substratum ranges from 15 to 25 inches. Seepage water from adjacent higher areas is commonly perched above the very slowly permeable compact substratum.

Mapping Units:

(WaA) & (WaB) - Wadleigh gravelly silt loam, 3 to 7 percent slopes

(WaC) & (FoC) - Wadleigh gravelly silt loam, 7 to 12 percent slopes

(WaD) - Wadleigh gravelly silt loam, 12 to 20 percent slopes

(WaE) & (WaF) - Wadleigh gravelly silt loam, 20 to 50 percent slopes encountered on-site

Mapped and consistent with soils encountered on-site

Table 1. Estimated Physical and Chemical Properties of the Soils.

| | | _ | | _ | | | | | | | | |
|--------------|------------|-------------|-------------|--------------|---------------|-------------|-------------|---------------------|-------------|--------------|-----------|----------|
| | | Dankh | | | | | | | | | | |
| | | Depth to | | | | | | | | | | |
| | | | | Danth | | | | | | | | |
| | | season- | | Depth | | | | | | | | |
| | | ally | - 43 | from | | | | _ | | | Corrosivi | - |
| | | high | Depth | surface | | | | Permea- | | | potential | |
| Soil | | water | to | typical | | ssification | 1 | bility $\frac{2}{}$ | | Shrink- | Untreated | |
| series or | Map | table | bedrock | profile | USDA | | | (inches/ | Reaction | swell | steel | Concrete |
| land type | Symbol | (feet) | (feet) | (inches) | Texture 1/ | Unified | AASHO | hour) | рН | potential | pipe | pipe |
| Am | AmA | < 2 | > 5 | 0-60 | fsl | SM or ML | A-2 or A-4 | 0.6 -2.0 | 5,1-5,5 | low | high | moderate |
| | AmB | | | | | | | | | | | moderate |
| Au | AuA | > 5 | > 5 | 0-9 | vgsl | GM | A-1 or A-2 | 2.0 .6.0 | 4.0~5.0 | low | moderate | moderate |
| | AuB | , | | 9-60 | vgs | GP or GW | A-1 | >6.0 | 4.0-5.0 | low | | |
| Ве | BeA | 4 to 5 | >5 | 0– 60 | vgs | GP or GW | A-1 | >6.0 | 5.1-5.5 | 10 w | moderate | moderate |
| | BeB | | | | | | | | | | | |
| | BeC BeD | | | | | | | | | | | |
| Со | CoA | <2 | >5 | 0-60 | sil | ML | A-4 | 0.6 -2.0 | 5.1-5.5 | low | high | moderat |
| Fu | FuA | <1 | > 5 | 0-24 | pt | Pt | A-8 | _ | 5.1-5.5 | high shrink, | high | high |
| | | | | | | | | | | low swell | | |
| | | | | 24-60 | si | ML | A-4 | 0.6 -2.0 | 5.5-6.0 | low | | |
| Gravelly | Gb | 0 | >5 | 0-60 | vgs or vgsl | GW or GM | A-1 | >6.0 | | low | high | high |
| beach | | | | | . , | | | | | | , | • |
| Gravel pit | Gp | Vari | able mate | rial | | ···· | | | | | | |
| Не | HeA | 4 to 5 | >5 | 0-52 | fsl | SM or ML | A-2 or A-4 | 0.62.0 | 5.1-5.5 | low | high | moderate |
| | | | | 52-60 | vgs | GP or GW | A-1 | >6.0 | 5.1-5.5 | low | _ | |
| Kaikli | KaB | <1 | 1 to 3 | 0-19 | pt | Pt. | A-8 | | 4.5-5.5 | high shrink, | high | moderate |
| | KaC | | | | 1 - | | | | | low swell | | |
| | KaD | | | 19-26 | vql | GM | A-1 or A-2 | 0.2 -0.6 | 4.5-5.5 | low | | |
| | KaE | | | 26+ | bedrock | | | - | | | _ | |
| Karheen | KhA | <2 | > 5 | 0-60 | very gravelly | GM | A-1 | 0.6 -2.0 | 5.1-5.5 | low | high | high |
| | KhC | | | | muck | | | | | | • | • |
| Karta | KtC | > 5 | >5 | 0-11 | gsil | ML | A-4 | 0.6 -2.0 | 4.5-5.0 | low | high | moderate |
| | KtE | | | 11-34 | vgsl | GM | A-1 | <0.06 | 4.5-5.0 | low | J | |
| | KtF | | | 34-60 | vgsl | GM | A-1 | 0.2 -0.6 | 4.5-5.5 | low | | |
| Kina | KiA | <1 | >5 | 0-60 | pt | Pt | A-8 | | 4.5-5.0 | high shrink, | high | high |
| | KiB | _ | | | 1 - | | | | | low swell | • | - |
| | KiC | | | | | | | | | | | |
| | KiD | | | | | | | | | | | |
| Kogish | KoA | <1 | >5 | 0-60 | pt | Pt | A-8 | * | <4.5 | high shrink, | high | high |
| | KoB | - | | • • • | F | - 0 | | | | low swell | 3 | |
| | KoC | | | | | | | | | J//V.* | | |
| | KoD | | | | | | | | | | | |
| V. Dung Bu & | KuA, KuB, | >5 | >5 | 0-18 | gsil | ML | A-4 | 0.6 -2.0 | 4.5-5.0 | low | high | moderat |
| Kupreanof | | | | | | | | | | | | |
| Kupreanor | KuC, KuD, | | | 18-60 | vas1 | GM | A-1 | 0.6 -2.0 | 5.1-5.5 | low | | |

Table 1. Estimated Physical and Chemical Properties of the Soils. (Continued)

| Soil series or land type | Map Symbol | Depth to season- ally high water table (feet) | Depth to bedrock (feet) | Depth from surface typical profile | Clausda 1/ | as s ification | a AASHO | Permea- bility 2/ (inches/ hour) | R e action pH | Shrink- swell potential | Corrosivi potential Untreated steel pipe | · |
|--------------------------------|---------------------------|--|----------------------------------|--|-----------------------|-----------------------|-------------------|---|-------------------------|---------------------------|--|----------|
| Tana type | Dymbo I | (1000) | (1000) | (11101105) | 10110110 | | | | F. | potential | F-PC | - F-F- |
| Le | LeA | <u></u> | > 5 | 0-60 | sil | ML | A-4_ | 0.6 -2.0 | 5.1-5.5 | low | high | moderate |
| Maybeso | MaA,MaB, MaC,MaD | - 2 | >5 | 0-27 | pt | Pt | A- 8 | - | 4.5-5.5 | high shrink, low swell | high | moderate |
| | MaE | | | 27-60 | val | GM | A-1 or A-2 | 0.06-0.2 | 5.1-5.5 | low | | |
| McGilvery-i with Tolst | | - | -1-1-2 | 0-14 14+ | pt bedrock | Pt - | A-8 - | - | 4.5 | high shrink, low swell | high | moderate |
| Mh | MhB,MhC, | >5 | > 5 | 0-60 | gsl | GM | A-1 | 0.6 -2.0 | 5.1-5.5 | low | high | moderate |
| Riverwash | Rw | 0 | > 5 | 0-60 | vgs | GP or GW | A-1 | >6.0 | | low | high | moderate |
| Salt Chuck | Sa A SaB SaC | 4 to 5 | >5 | 0-1 7 17-60 | vgsil or vgsl vgls | GM GP-GM | A-1 or A-2 A-1 | 0.6-2.0 2.0-6.0 | 4.5-5.5 4.5-5.5 | low low | high | moderate |
| Tidal Flats | Tf | 0 | > 5 | 0-60 | variable materi | al | | | | | | |
| Tolstoi | ToC ToD | - | 1 to 2 | 0-9 9+ | vstsil bedrock | ML - | A-4 | 0.6 -2.0 | 4.5-5.0 | low | ** | _ |
| | ToE ToF | | | | | | | | | | | |
| Wadleigh | WaA,WaB | <1 | ⇒ 5 . | 0-16 | vgsil or vgsl | GM | A-1 or A-2 | 0.6 -2.0 | 4.5-5.0 | low | high | moderate |
| | WaC,FoC, | | | 16-30 | vgsl | GM or SM | A-1 | <0.06 | 4.5-5.5 | low | | |
| | WaD,WaE, WaF | | | 30-60 | vgl | GM | A-1 or A-2 | 0.2 -0.6 | 4.5-5.5 | low | | |

Symbols have the following meanings (see glossary):

| Symbols have the following meanings (see glossary): | fsl - fine sandy loam | ygs - very gravelly sand | sil - silt loam | ygsil - very gravelly silt loam | ygsil - very gravelly sandy loam | ygsl - very stony silt loam | ygsl - very gravelly sandy loam | ygsl - y

 $[\]frac{2}{2}$ Permeability is for soil without comapction; for wet soils, the permeability is that to be expected after removal of free water.

| | αA | рΕ | - Soi | ı |
|--|----|----|-------|---|
|--|----|----|-------|---|

Soil Classification
Table from National
Engineering

Chapter 7 Hydrologic Soil Groups

Part 630 National Engineering Handbook

 $\textbf{Table 7-1} \quad \text{Criteria for assignment of hydrologic soil group (HSG)}$


| Depth to water impermeable layer ¹ / | Depth to high water table ^{2/} | K _{sat} of least transmissive layer in depth range | K _{sat} depth range | HSG ¾ | |
|--|--|--|---------------------------------|-------|---------------------------------|
| <50 cm [<20 in] | _ | _ | _ | D | K |
| | | >40.0 µm/s (>5.67 in/h) | 0 to 60 cm [0 to 24 in] | A/D | WaD Soil Type Classification |
| | <60 cm | >10.0 to ≤40.0 µm/s (>1.42 to ≤5.67 in/h) | 0 to 60 cm [0 to 24 in] | B/D | |
| | [<24 in] | >1.0 to ≤10.0 µm/s (>0.14 to ≤1.42 in/h) | 0 to 60 cm [0 to 24 in] | C/D | _ |
| 50 to 100 cm | | ≤1.0 µm/s (≤0.14 in/h) | 0 to 60 cm [0 to 24 in] | D | _ |
| [20 to 40 in] | | >40.0 µm/s (>5.67 in/h) | 0 to 50 cm [0 to 20 in] | A | _ |
| | ≥60 cm | >10.0 to ≤40.0 µm/s (>1.42 to ≤5.67 in/h) | 0 to 50 cm [0 to 20 in] | В | <u>-</u> |
| | [≥24 in] | >1.0 to ≤10.0 µm/s (>0.14 to ≤1.42 in/h) | 0 to 50 cm [0 to 20 in] | C | <u>-</u> |
| | | ≤1.0 μm/s (≤0.14 in/h) | 0 to 50 cm [0 to 20 in] | D | <u>.</u> |
| | | >10.0 µm/s (>1.42 in/h) | 0 to 100 cm [0 to 40 in] | A/D | <u>.</u> |
| | <60 cm [<24 in] | >4.0 to ≤10.0 µm/s (>0.57 to ≤1.42 in/h) | 0 to 100 cm [0 to 40 in] | B/D | _ |
| | | >0.40 to ≤4.0 µm/s (>0.06 to ≤0.57 in/h) | 0 to 100 cm [0 to 40 in] | C/D | _ |
| >100 cm | | ≤0.40 µm/s (≤0.06 in/h) | 0 to 100 cm [0 to 40 in] | D | _ |
| [>40 in] | 60 to 100 cm | >40.0 µm/s (>5.67 in/h) | 0 to 50 cm [0 to 20 in] | A | <u>.</u> |
| | | >10.0 to ≤40.0 μm/s (>1.42 to ≤5.67 in/h) | 0 to 50 cm [0 to 20 in] | В | _ |
| | [24 to 40 in] | >1.0 to ≤10.0 µm/s (>0.14 to ≤1.42 in/h) | 0 to 50 cm [0 to 20 in] | С | _ |
| | | ≤1.0 µm/s (≤0.14 in/h) | 0 to 50 cm [0 to 20 in] | D | _ |
| | - | >10.0 μm/s (>1.42 in/h) | 0 to 100 cm [0 to 40 in] | A | 7 |
| | >100 cm | $>4.0 \text{ to} \le 10.0 \text{ µm/s}$ (>0.57 to $\le 1.42 \text{ in/h}$) | 0 to 100 cm [0 to 40 in] | В | |
| | [>40 in] | >0.40 to ≤4.0 µm/s (>0.06 to ≤0.57 in/h) | 0 to 100 cm [0 to 40 in] | C | KuE Soil Type Classification |
| | | ≤0.40 µm/s (≤0.06 in/h) | 0 to 100 cm [0 to 40 in] | D | |


 $^{1/\,}$ An impermeable layer has a $\rm K_{sat}$ less than 0.01 µm/s [0.0014 in/h] or a component restriction of fragipan; duripan; petrocalcic; orstein; petrogypsic; cemented horizon; densic material; placic; bedrock, paralithic; bedrock, lithic; bedrock, densic; or permafrost.

(210-VI-NEH, January 2009)

 $^{2/\;}$ High water table during any month during the year.

 $^{3\}prime$ Dual HSG classes are applied only for wet soils (water table less than 60 cm [24 in]). If these soils can be drained, a less restrictive HSG can be assigned, depending on the K_{sat} .

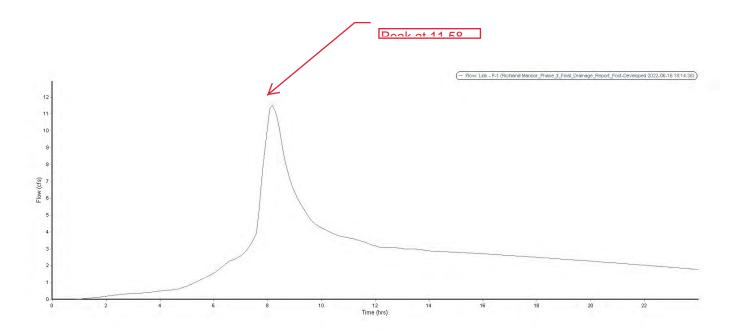

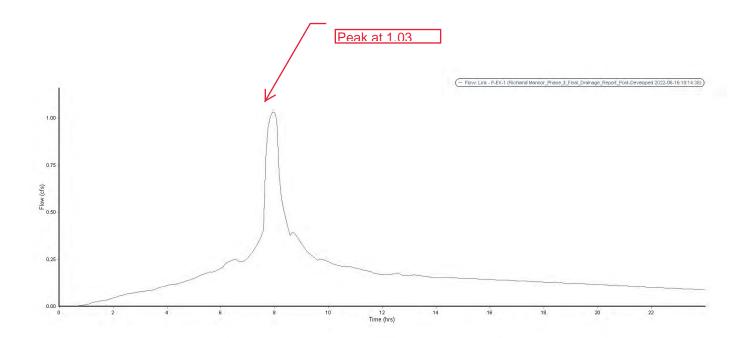



1945 Alex Holden Way #101 | Juneau, AK 99801 | 907-780-4004 | solutions@proHNS.com 219 Main Street #13 | Haines, AK 99827 | 907-419-6070 | www.proHNS.com

March 23, 2020

Michael and William Heumann 6000 Thane Rd Juneau, AK 99801 mpheumann@hotmail.com (971) 261-8014

RE: Hillcrest Extension Subdivision - Draft Drainage Report

To Whom It May Concern,

The following Drainage Plan has been prepared for the Richland Manor Subdivision in Juneau, AK, a proposed multi-phase major subdivision on a 30-acre site at 4506, 4508, and 4510 Hillcrest Avenue. This drainage report addresses the first phase of the overall subdivision that will create 14 new Lots and extend Hillcrest Avenue. The drainage report supplements the Richland Manor Subdivision – Drainage Report dated 10/31/19 and the Hooter Lane Phase I ROW Improvements – Drainage Report dated 1/23/20, attached in Appendix H, by providing an in-depth analysis of the improvements specific to this phase of the development. Improvements include extending Hillcrest Avenue by constructing new sidewalk, street, ditches, driveways and utilities along with building pads on the newly subdivided Lots. The 2010 CBJ Manual of Stormwater Best Management Practices was used to evaluate if the proposed and existing drainage features could convey runoff during the 25-year storm event.

Attachments to this report include sheets depicting survey data, proposed ROW improvements, as-built information, calculations and rainfall data used for the drainage analysis.

Site Runoff Calculation Method:

A total of three catchment areas were analyzed representing the existing and proposed drainage conveyance systems relevant to the project. The catchment areas include: the predeveloped subdivision labeled on the drainage map as Drainage Basin A, the post developed subdivision labeled on the drainage map as Drainage Basin C and, the post developed subdivision labeled on the drainage map as Drainage Basin D. The three catchment areas we determined using the proposed design model, Lidar data and aerial photos in AutoCAD C3D and were verify by several site visits. A delineation of the catchment areas can be found in Appendix A.

To calculate the site runoff for Drainage Basin D we have elected to use the Rational Method. The Rational Method is most appropriate for evaluating drainage basins less than 10 acres. Appendix D of the "2010 **CBJ** Manual of



Stormwater Best Management Practices" was utilized as a guide¹. The calculations and supporting documentation can be found in Appendix B, C, D & E of this Report.

To calculate the site runoff for Drainage Basin A and C we have elected to use the SCS Unit Hydrograph Method. The SCS Unit Hydrograph Method is most appropriate for evaluating drainage basins of 10 acres to 1,300 acres. Appendix D of the "2010 CBJ Manual of Stormwater Best Management Practices" was utilized as a guide². The calculations and supporting documentation can be found in Appendix B, C, D & F of this Report.

Anticipated Site Runoff (Q):

Using the Rational Method and SCS Unit Hydrograph Method, the amount of stormwater runoff during the 25-year storm event per catchment area was determined. The analysis shows that approximately 1.13 cfs will be removed from the discharge point due to the proposed development. See Table 1.1 below for results, the calculations can be found in Appendix E &F.

| Catchment Area | Q (cfs) | | | |
|------------------|---------|--|--|--|
| Drainage Basin A | 6.71 | | | |
| Drainage Basin C | 5.58 | | | |
| Drainage Basin D | 1.90 | | | |
| Table 1.1 | | | | |

Conveyance/Discharge Structure Capacities:

The capacity of the existing and proposed drainage systems was calculated using the Manning's Equation to determine if proposed 25-year storm event flows could be conveyed. The most vulnerable drainage structures to failure along the analyzed flow path were evaluated. See Table 1.2 below for results, the calculations can be found in Appendix F.

| Catchment Area | Q (cfs) |
|-----------------------------------|---------|
| Existing 18" CPP Culvert (P-7) | 7.02 |
| Existing Driveway Ditch Hooter LN | 10.58 |
| Table 1.2 | |

¹ There are no current municipal code requirements dictating adherence with the "2010 CBJ Manual of Stormwater Best Management Practices" when preparing a drainage plan that complies with 49.35.510. Regardless, we have elected to utilize portions of this Manual as a guide in the preparation of this Drainage Plan for the proposed development.

² There are no current municipal code requirements dictating adherence with the "2010 CBJ Manual of Stormwater Best Management Practices" when preparing a drainage plan that complies with 49.35.510. Regardless, we have elected to utilize portions of this Manual as a guide in the preparation of this Drainage Plan for the proposed development.



Summary:

Table 1.3 below compares anticipated 25-year runoff in the proposed and existing conveyance systems to their available hydraulic capacity. Runoff from the entire drainage basin was used for comparison even though in some cases the conveyance system would not need to handle the entire runoff making the comparison a conservative evaluation.

| | Anticipated | Capacity | Available | | | | |
|-----------------------------------|----------------|----------|------------------|--|--|--|--|
| Drainage Basin | Runoff Q (cfs) | Check | Capacity Q (cfs) | | | | |
| Proposed 18" CPP Culvert (P-7) | 5.58 | < | 7.02 | | | | |
| Existing Driveway Ditch Hooter LN | 1.90 | < | 10.58 | | | | |
| | Table 1.3 | | | | | | |

Our analysis shows that there is enough capacity in the existing and proposed drainage structures to handle flows from the altered drainage patterns as a result of the proposed Hooter Lane Phase I ROW improvements.

Respectfully,

Lucas Chambers, P.E.

Lucas Charles

Principal Engineer – proHNS LLC Juneau

Appendixes:

- A Catchment Areas
- **B** Runoff Coefficient
- C Time of Concentration
- D Rainfall Intensity
- E Rational Method
- F SCS Hydrograph
- G- Existing Capacity Calcs
- H Prior Drainage Reports "Richland Manor Subdivision Drainage Report dated 10/31/19, Hooter Lane Phase I ROW Improvements Drainage Report dated 1/23/20"

Appendix A Catchment Areas

HILLCREST EXTENSION SUBDIVISION DRAINAGE MAP

JUNEAU, AK

SHEET INDEX SHEET NO. DESCRIPTION 1 COVER SHEET PREDEVELOPED DRAINAGE BASIN CATCHMENT AREAS DEVELOPED DRAINAGE BASIN CATCHMENT AREAS

PREPARED FOR:

MICHAEL & WILLIAM HEUMANN



PROJECT LOCATION MAP

| | KOTZEBUE (|
|-------|--|
| | |
| | NOME |
| | AIRDAINAS |
| | |
| | ANGUARAGE (|
| | ANCHORAGE |
| | BERING SEA JUNEAU |
| 25-13 | DEMINO SEA |
| | |
| | SITKA SITTA SITKA SITTA SITKA SITTA SITKA SITKA SITKA SITKA SITKA SITTA |
| | KODIAK SITKA UV (Op) KETCHIKAN |
| | |
| | and the second s |
| 00°00 | ALASKA |
| | |

| | | RECORD OF REVISIONS | | |
|-----|------|---------------------|----|----------|
| No. | DATE | DESCRIPTION | BY | |
| | | | | |
| | | | | |
| | | | | L |
| | | | | pro |
| | | | | CERTIFIC |
| | | | | |


| . 1 | DRAWN BY: DESIGNED BY: | C. BYDLON L. CHAMBERS |
|---|---------------------------|--------------------------|
| | CHECKED BY: | L. CHAMBERS |
| proHNS LLC | | DEN WAY #101 AK 99801 |
| CERTIFICATE OF AUTHORIZATION #100662 | | oroHNS.com HNS.com |
| | | |


HILLCREST EXTENSION SUBDIVISION

WILLIAM & MICHAEL HUMEANN

COVER SHEET

1 0F

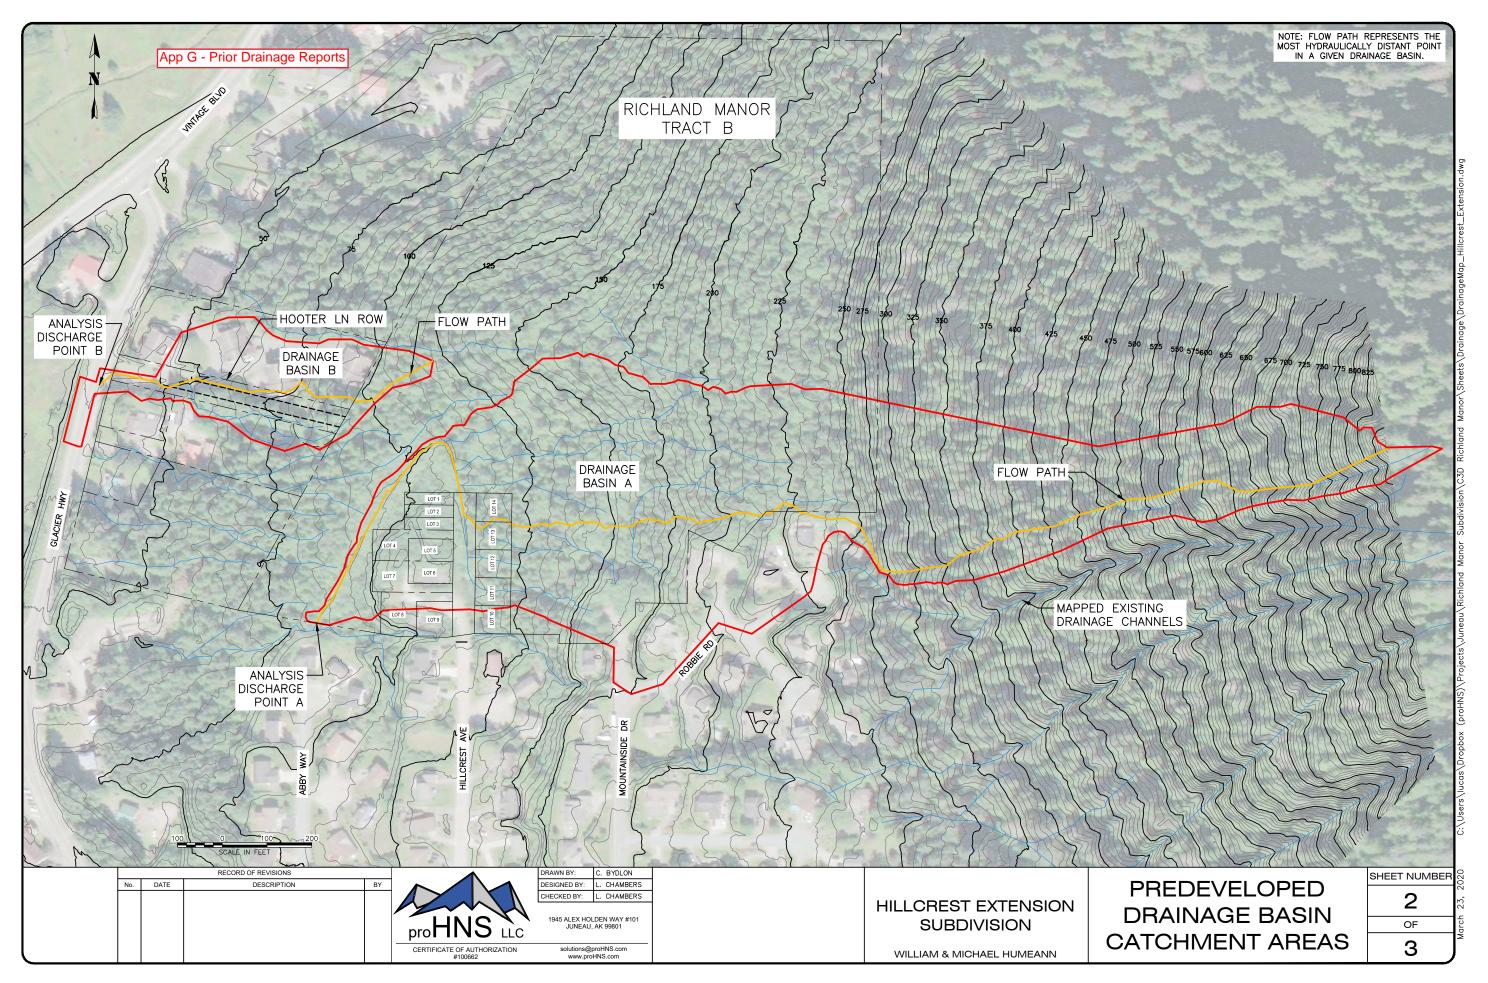

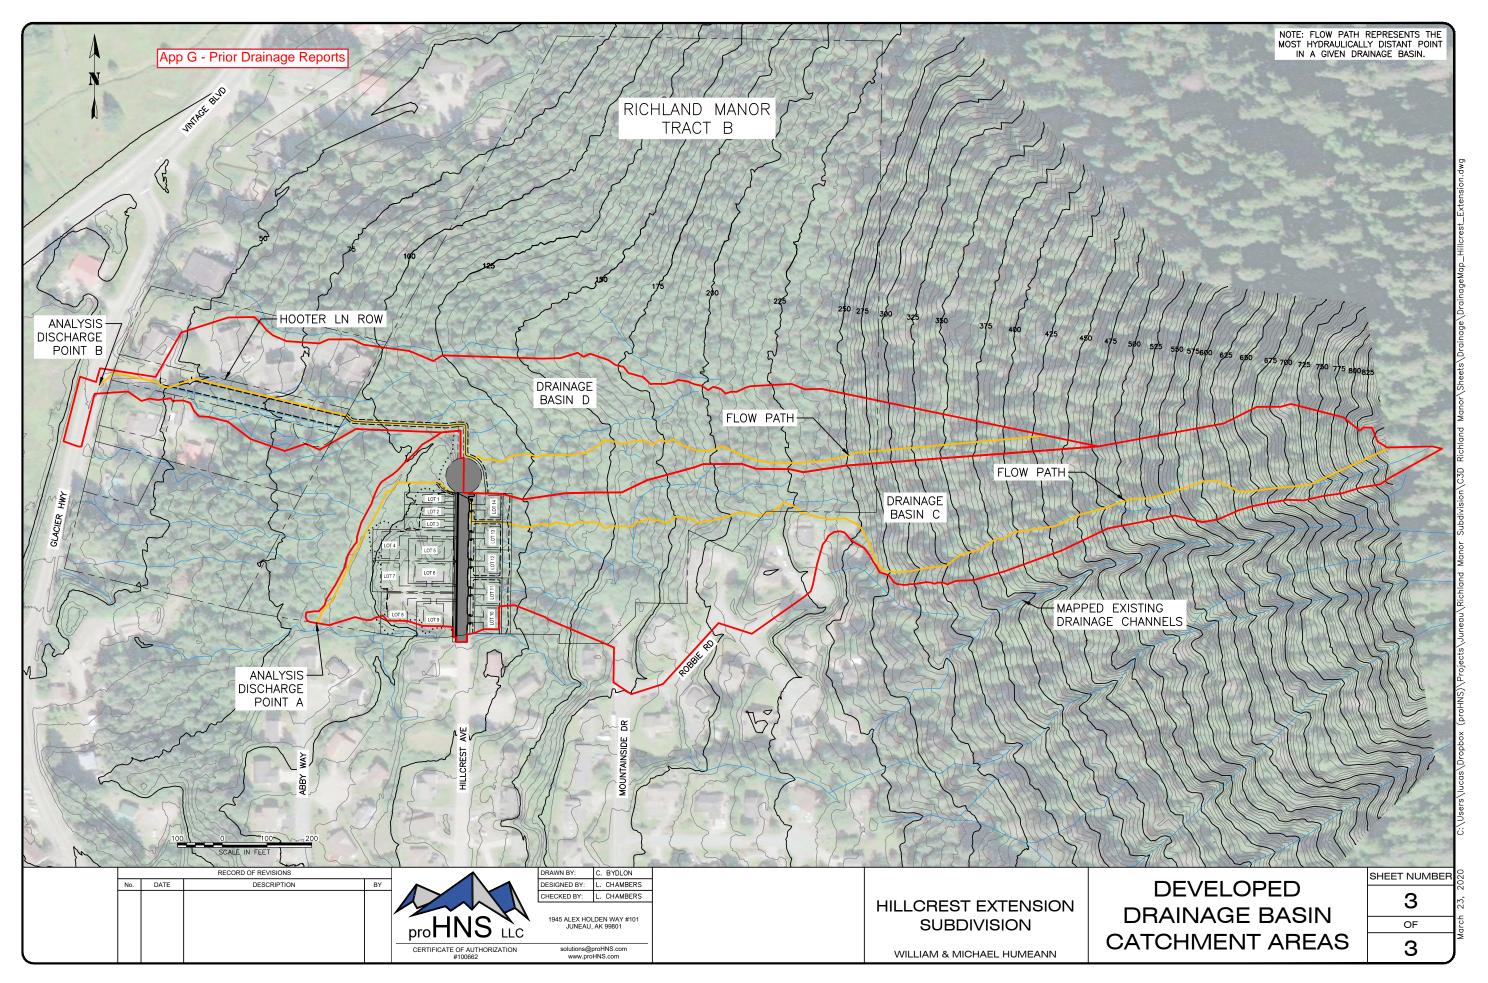

Appendix B Runoff Coefficient

| SCS Curve Number Hillcrest Extension Predeveloped | | | | | | |
|---|---|----------------|--|--|--|--|
| Project: | Hillcrest Ext Subdivision Drainage Analysis, PAC2018 0054 | | | | | |
| Owner: | Michael and William Heumann | | | | | |
| Date: | 3/21/2020 | | | | | |
| Prepared By: | Chris Bydlon | proHNS us | | | | |
| Checked By: | Lucas Chambers | pioi ii 40 lic | | | | |

| Total Basin Area(SQFT)= | 867827 | | | | | |
|-------------------------|-------------------------|-------------|--------------|--------------|-----------------|---------------------|
| Surface Type | Location | Area (SQFT) | Total (SQFT) | Total (Acre) | % Overall Basin | Unit Hydrograph CN* |
| Pavement | Mountianside/ Robbie Rd | 23565 | | | | |
| | | | 23565 | 0.540977961 | 2.72% | 98 |
| Building Roofs | Robbie Rd Homes | 14048 | | | | |
| | | | 14048 | 0.322497704 | 1.62% | 98 |
| Gravel | Existing Hillcrest Pads | 10824 | | | | |
| | | | 10824 | 0.248484848 | 1.25% | 89 |
| Lawns | Robbie Rd Homes | 14230 | | | | |
| | | | 14230 | 0.326675849 | 1.64% | 74 |
| Woods | Every where else | 805160 | | | | |
| | | | 805160 | 18.48393021 | 92.78% | 70 |
| | | | | | | |
| | | Total= | 867827 | 19.92256657 | 100.00% | 71.52 |
| | | | | | | |

^{*}Unit Hydrograph curve numbers were developed from Table D-6 & D-7 of the CBJ Manual of Stormwater BMP Manual. NRCS's online GIS database does not have data for the project location. I looked at adjacent areas with similar slopes and ground cover and the hydraulic soil group was C or D. For this analysis I am assuming the project location falls under soil group C.

| SCS Curve Number Proposed Hillcrest Ext. Subdivision | | | | | | |
|--|--|----------------|--|--|--|--|
| Project: | Hillcrest Ext. Subdivision Drainage Analysis, PAC2018 0054 | | | | | |
| Owner: | Michael and William Heumann | | | | | |
| Date: | 3/21/2020 | | | | | |
| Prepared By: | Chris Bydlon | proHNS WC | | | | |
| Checked By: | Lucas Chambers | piot ii to tac | | | | |

| Total Basin Area(SQFT)= | 642649 | | | | | |
|-------------------------|------------------------------|-------------|--------------|--------------|-----------------|---------------------|
| | | | | | | |
| Surface Type | Location | Area (SQFT) | Total (SQFT) | Total (Acre) | % Overall Basin | Unit Hydrograph CN* |
| Pavement | Hillcrest Extension | 12788 | | | | |
| | Mountianside/ Robbie Rd | 23565 | | | | |
| | | | 36353 | 0.834550046 | 5.66% | 98 |
| Building Roofs | Lot 1 Roof +Deck | 988 | | | | |
| *Areas from Developer | Lot 2 Roof +Deck | 988 | | | | |
| | Lot 3 Roof +Deck | 988 | | | | |
| | Lot 4 Roof +Deck | 1350 | | | | |
| | Lot 5 Roof +Deck | 1350 | | | | |
| | Lot 6 Roof +Deck | 1350 | | | | |
| | Lot 7 Roof +Deck | 1350 | | | | |
| | Lot 8 Roof +Deck | 1350 | | | | |
| | Lot 9 Roof +Deck | 1350 | | | | |
| | Lot 10 Roof +Deck | 1350 | | | | |
| | Lot 11 Roof+Deck | 1350 | | | | |
| | Lot 12 Roof+Deck | 1350 | | | | |
| | Lot 13 Roof+Deck | 1350 | | | | |
| | Lot 14 Roof+Deck | 1350 | | | | |
| | Robbie Rd Homes | 14048 | | | | |
| | | | 31862 | 0.731450872 | 4.96% | 98 |
| Gravel | Driveways & Ditches | 19536 | | | | |
| | Building Pad Lot 4 | 690 | | | | |
| | Building Pad Lot 5 | 1250 | | | | |
| | Building Pad Lot 6 | 1250 | | | | |
| | Building Pad Lot 7 | 690 | | | | |
| | Building Pad Lot 8 | 900 | | | | |
| | Building Pad Lot 9 | 900 | | | | |
| | Building Pad Lot 10 | 315 | | | | |
| | Building Pad Lot 11 | 315 | | | | |
| | Building Pad Lot 12 | 315 | | | | |
| | Building Pad Lot 13 | 315 | | | | |
| | Building Pad Lot 14 | 315 | | | | |
| | | | 26791 | 0.615036731 | 4.17% | 89 |
| Lawns | Robbie Rd Homes | 14230 | | | | |
| | Lot 1-14 Lawns & Fill Slopes | 27815 | | | | |
| | · | | 42045 | 0.965220386 | 6.54% | 74 |
| Woods | Every where else | 505598 | | | | |
| | · | | 505598 | 11.60693297 | 78.67% | 70 |
| | | | | | | |
| | | Total= | 642649 | 14.753191 | 100.00% | 74.03 |
| | | | | | | |

^{*}Unit Hydrograph curve numbers were developed from Table D-6 & D-7 of the CBJ Manual of Stormwater BMP Manual. NRCS's online GIS database does not have data for the project location. I looked at adjacent areas with similar slopes and ground cover and the hydraulic soil group was C or D. For this analysis I am assuming the project location falls under soil group C.

| | Runoff Coefficient Basin B Develop | ed |
|--------------|---|----------------|
| Project: | Hillcrest Extension Drainage Analysis, PAC2018 0054 | |
| Owner: | Michael and William Heumann | |
| Date: | 3/17/2020 | |
| Prepared By: | C. Bydlon | proHNS uc |
| Checked By: | L. Chambers | pior ii vo lic |

| Total Basin Area(SQFT)= | 400337 | | | | | |
|-------------------------|------------------------|-------------|--------------|--------------|-----------------|--------------------|
| Surface Type | Location | Area (SQFT) | Total (SQFT) | Total (Acre) | % Overall Basin | Runoff Coefficient |
| Pavement | Tamarack Trails Condos | 24950 | | | | |
| | | | 24950 | 0.572773186 | 6.23% | 0.9 |
| Building Roofs | Tamarack Trail Condos | 15130 | | | | |
| | | | 15130 | 0.347337006 | 3.78% | 0.9 |
| Lawns | Tamarack Trails | 6690 | | | | |
| | | | 6690 | 0.153581267 | 1.67% | 0.25 |
| Shot Rock Base & Ditch | Hooter Lane ROW | 21355 | | | | |
| | | | 21355 | 0.490243343 | 5.33% | 0.8 |
| Woods | Every where else | 332212 | | | | |
| | | | 332212 | 7.626538108 | 82.98% | 0.1 |
| | | | | | | |
| | | Total= | 400337 | 9.190472911 | 100.00% | 0.22 |

Appendix C Time of Concentration

```
SCS TR-55 Time of Concentration Computations Report
______
Sheet Flow Equation
       Tc = (0.007 * ((n * Lf)^0.8)) / ((P^0.5) * (Sf^0.4))
       Where:
       Tc = Time of Concentration (hrs)
       n = Manning's Roughness
       Lf = Flow Length (ft)
       P = 2 yr, 24 hr Rainfall (inches)
       Sf = Slope (ft/ft)
Shallow Concentrated Flow Equation
       V = 16.1345 * (Sf^0.5) (unpaved surface)
       V = 20.3282 * (Sf^0.5) (paved surface)
       V = 15.0 * (Sf^0.5) (grassed waterway surface)
       V = 10.0 * (Sf^0.5) (nearly bare & untilled surface)
       V = 9.0 * (Sf^0.5) (cultivated straight rows surface)
       V = 7.0 * (Sf^0.5) (short grass pasture surface)
       V = 5.0 * (Sf^0.5) (woodland surface)
       V = 2.5 * (Sf^0.5) (forest w/heavy litter surface)
       Tc = (Lf / V) / (3600 sec/hr)
       Where:
       Tc = Time of Concentration (hrs)
       Lf = Flow Length (ft)
       V = Velocity (ft/sec)
       Sf = Slope (ft/ft)
Channel Flow Equation
       V = (1.49 * (R^{(2/3)}) * (Sf^{(0.5)}) / n
       R = Aq / Wp
       Tc = (Lf / V) / (3600 sec/hr)
       Where:
       Tc = Time of Concentration (hrs)
```

```
Lf = Flow Length (ft)
       R = Hydraulic Radius (ft)
       Aq = Flow Area (ft<sup>2</sup>)
       Wp = Wetted Perimeter (ft)
       V = Velocity (ft/sec)
       Sf = Slope (ft/ft)
       n = Manning's Roughness
Subbasin PhaseAPreDevelop
=========
Sheet Flow Computations
-----
                                   Subarea A
                                                  Subarea B
                                                                 Subarea C
       Manning's Roughness:
                                                  0.00
                                                                 0.00
       Flow Length (ft):
                                   188
                                                                 0.00
                                                 0.00
       Slope (%):
                                   79.80
                                                0.00
                                                                 0.00
       2 yr, 24 hr Rainfall (in): 2.97
                                                0.00
                                                                 0.00
       Velocity (ft/sec):
                                 0.21
                                               0.00
                                                                 0.00
       Computed Flow Time (minutes): 14.72
                                                 0.00
                                                                 0.00
Shallow Concentrated Flow Computations
______
                                   Subarea A
                                                  Subarea B
                                                                 Subarea C
       Flow Length (ft):
                                                  0.00
                                                                 0.00
       Slope (%):
Surface Type:
                                 29.86
                                                  0.00
                                                                 0.00
      Velocity (ft/sec): 1.37
                                                  Unpaved
                                                                 Unpaved
                                                 0.00
                                                                 0.00
       Computed Flow Time (minutes): 24.89
                                                  0.00
                                                                 0.00
Channel Flow Computations
      Manning's Roughness: .05
Flow Length (ft): 715
Channel Slope (%): 3.48
Cross Section Area (ft²): 13
Wetted Perimeter (ft): 11.4
Velocity (ft/sec): 6.07
                                                                 Subarea C
                                  Subarea A Subarea B
                                               0.00
                                                                 0.00
                                               0.00
                                                                 0.00
                                                 0.00
                                                                 0.00
                                                 0.00
                                                                 0.00
                                                 0.00
                                                                 0.00
                                                0.00
                                                                 0.00
       Computed Flow Time (minutes): 1.96
                                                 0.00
       ______
       Total TOC (minutes): 41.57
```

```
SCS TR-55 Time of Concentration Computations Report
______
Sheet Flow Equation
       Tc = (0.007 * ((n * Lf)^0.8)) / ((P^0.5) * (Sf^0.4))
       Where:
       Tc = Time of Concentration (hrs)
       n = Manning's Roughness
       Lf = Flow Length (ft)
       P = 2 yr, 24 hr Rainfall (inches)
       Sf = Slope (ft/ft)
Shallow Concentrated Flow Equation
       V = 16.1345 * (Sf^0.5) (unpaved surface)
       V = 20.3282 * (Sf^0.5) (paved surface)
       V = 15.0 * (Sf^0.5) (grassed waterway surface)
       V = 10.0 * (Sf^0.5) (nearly bare & untilled surface)
       V = 9.0 * (Sf^0.5) (cultivated straight rows surface)
       V = 7.0 * (Sf^0.5) (short grass pasture surface)
       V = 5.0 * (Sf^0.5) (woodland surface)
       V = 2.5 * (Sf^0.5) (forest w/heavy litter surface)
       Tc = (Lf / V) / (3600 sec/hr)
       Where:
       Tc = Time of Concentration (hrs)
       Lf = Flow Length (ft)
       V = Velocity (ft/sec)
       Sf = Slope (ft/ft)
Channel Flow Equation
       V = (1.49 * (R^{(2/3)}) * (Sf^{(0.5)}) / n
       R = Aq / Wp
       Tc = (Lf / V) / (3600 sec/hr)
       Where:
       Tc = Time of Concentration (hrs)
```

```
Lf = Flow Length (ft)
       R = Hydraulic Radius (ft)
       Aq = Flow Area (ft<sup>2</sup>)
       Wp = Wetted Perimeter (ft)
       V = Velocity (ft/sec)
       Sf = Slope (ft/ft)
       n = Manning's Roughness
Subbasin HillcrestExtPostDevelemonet
=========
Sheet Flow Computations
-----
                                      Subarea A
                                                      Subarea B
                                                                       Subarea C
       Manning's Roughness:
                                                      0.00
                                                                       0.00
       Flow Length (ft):
Slope (%):
                                      188
                                                                       0.00
                                                      0.00
       Slope (%): 79.8
2 yr, 24 hr Rainfall (in): 2.97
                                                   0.00
                                                                       0.00
                                                    0.00
                                                                       0.00
       Velocity (ft/sec): 0.21
                                                    0.00
                                                                       0.00
       Computed Flow Time (minutes): 14.72
                                                      0.00
                                                                       0.00
Shallow Concentrated Flow Computations
______
                                      Subarea A
                                                       Subarea B
                                                                       Subarea C
       Flow Length (ft):
                                                                       0.00
       Slope (%):
Surface Type:
                                    30.65
                                                      0.00
                                                                       0.00
       Surface Type: Forest
Velocity (ft/sec): 1.38
                                                      Unpaved
                                                                       Unpaved
                                                      0.00
                                                                       0.00
       Computed Flow Time (minutes): 23.88
                                                      0.00
                                                                       0.00
Channel Flow Computations
      Manning's Roughness: .035 .015
Flow Length (ft): 91.6 82
Channel Slope (%): 6.10 1.22
Cross Section Area (ft²): 3.0 1.77
Wetted Perimeter (ft): 5.47 4.71
Velocity (ft/sec): 7.04 5.71
Crossted Flow Time (minutes): 0.22 0.24
                                     Subarea A Subarea B
                                                                       Subarea C
                                                   .015
                                                                       .035
                                                                       489
                                                                       5.32
                                                                       1.74
                                                                       4.59
                                                                       5.14
       ______
       Total TOC (minutes): 40.64
```

```
SCS TR-55 Time of Concentration Computations Report
______
Sheet Flow Equation
       Tc = (0.007 * ((n * Lf)^0.8)) / ((P^0.5) * (Sf^0.4))
       Where:
       Tc = Time of Concentration (hrs)
       n = Manning's Roughness
       Lf = Flow Length (ft)
       P = 2 yr, 24 hr Rainfall (inches)
       Sf = Slope (ft/ft)
Shallow Concentrated Flow Equation
       V = 16.1345 * (Sf^0.5) (unpaved surface)
       V = 20.3282 * (Sf^0.5) (paved surface)
       V = 15.0 * (Sf^0.5) (grassed waterway surface)
       V = 10.0 * (Sf^0.5) (nearly bare & untilled surface)
       V = 9.0 * (Sf^0.5) (cultivated straight rows surface)
       V = 7.0 * (Sf^0.5) (short grass pasture surface)
       V = 5.0 * (Sf^0.5) (woodland surface)
       V = 2.5 * (Sf^0.5) (forest w/heavy litter surface)
       Tc = (Lf / V) / (3600 sec/hr)
       Where:
       Tc = Time of Concentration (hrs)
       Lf = Flow Length (ft)
       V = Velocity (ft/sec)
       Sf = Slope (ft/ft)
Channel Flow Equation
       V = (1.49 * (R^{(2/3)}) * (Sf^{(0.5)}) / n
       R = Aq / Wp
       Tc = (Lf / V) / (3600 sec/hr)
       Where:
       Tc = Time of Concentration (hrs)
```

```
Lf = Flow Length (ft)
       R = Hydraulic Radius (ft)
       Aq = Flow Area (ft<sup>2</sup>)
       Wp = Wetted Perimeter (ft)
       V = Velocity (ft/sec)
       Sf = Slope (ft/ft)
       n = Manning's Roughness
Subbasin HillcrestHooter
=========
Sheet Flow Computations
-----
                                     Subarea A
                                                     Subarea B
                                                                      Subarea C
       Manning's Roughness:
                                                     0.00
                                                                      0.00
       Flow Length (ft):
       Flow Length (ft): 23-
Slope (%): 37.2
2 yr, 24 hr Rainfall (in): 2.97
                                     234
                                                                      0.00
                                                     0.00
                                                  0.00
                                                                     0.00
                                                   0.00
                                                                      0.00
       Velocity (ft/sec):
                                   0.16
                                                  0.00
                                                                      0.00
       Computed Flow Time (minutes): 23.80
                                                     0.00
                                                                      0.00
Shallow Concentrated Flow Computations
______
                                     Subarea A
                                                     Subarea B
                                                                      Subarea C
       Flow Length (ft):
                                                                      0.00
       Slope (%):
Surface Type:
                                   21.54
                                                     0.00
                                                                      0.00
       Surface Type: Forest Velocity (ft/sec): 1.16
                                                     Unpaved
                                                                      Unpaved
                                                     0.00
                                                                      0.00
       Computed Flow Time (minutes): 15.78
                                                     0.00
                                                                      0.00
Channel Flow Computations
      Manning's Roughness: .035 .035
Flow Length (ft): 361 439.5
Channel Slope (%): 5.7 11.37
Cross Section Area (ft²): 6 2
Wetted Perimeter (ft): 7.71 5.6
Velocity (ft/sec): 8.60 7.23
                                    Subarea A Subarea B
                                                                      Subarea C
                                                                      .03
                                                                     141
                                                                     7.8
                                                                     3.42
                                                                     6.12
                                                                     9.41
       ______
       Total TOC (minutes): 41.53
```

Appendix D Rainfall Intensity



NOAA Atlas 14, Volume 7, Version 2 Location name: Juneau, Alaska, USA* Latitude: 58.3454°, Longitude: -134.4896° Elevation: 120.33 ft** *source: ESRI Maps *source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Douglas Kane, Sarah Dietz, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Svetlana Stuefer, Amy Tidwell, Carl Trypaluk, Dale Unruh, Michael Yekta, Erica Betts, Geoffrey Bonnin, Sarah Heim, Lillian Hiner, Elizabeth Lilly, Jayashree Narayanan, Fengiln Yan, Tan Zhao

NOAA, National Weather Service, Silver Spring, Maryland

and
University of Alaska Fairbanks, Water and Environmental Research Center

PF_tabular | PF_graphical | Maps_&_aerials

PF tabular

| Dunasia | | Average recurrence interval (years) | | | | | | | | |
|----------|-------------------------|-------------------------------------|------------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------------------------|------------------------|
| Duration | 1 | 2 | 5 | 10 | 25 | 50 | 100 | 200 | 500 | 1000 |
| 5-min | 0.131 (0.106-0.166) | 0.153 (0.122-0.197) | 0.187 (0.146-0.246) | 0.215 (0.165-0.287) | 0.253 (0.189-0.346) | 0.282 (0.207-0.393) | 0.312 (0.225-0.442) | 0.350 (0.248-0.505) | 0.400 (0.277-0.590) | 0.438 (0.299-0.65 |
| 10-min | 0.176 (0.142-0.223) | 0.206 (0.164-0.265) | 0.251 (0.195-0.330) | 0.288 (0.220-0.385) | 0.339 (0.253-0.464) | 0.379 (0.278-0.528) | 0.418 (0.302-0.592) | 0.470 (0.333-0.678) | 0.537 (0.372-0.792) | 0.588 (0.401-0.88 |
| 15-min | 0.206 (0.166-0.261) | 0.241 (0.192-0.310) | 0.293 (0.228-0.385) | 0.337 (0.258-0.450) | 0.397 | 0.443 | 0.490 (0.353-0.694) | 0.549 (0.389-0.791) | 0.629 | 0.689 (0.470-1.0 |
| 30-min | 0.273 (0.220-0.346) | 0.320 (0.255-0.411) | 0.389 (0.303-0.511) | 0.447 (0.342-0.597) | 0.527 (0.394-0.721) | 0.588 (0.432-0.819) | 0.650 (0.469-0.921) | 0.729 (0.517-1.05) | 0.834 (0.578-1.23) | 0.914 (0.623-1.3 |
| 60-min | 0.374 (0.302-0.474) | 0.438 (0.349-0.563) | 0.533 (0.415-0.700) | 0.613 (0.469-0.819) | 0.722 (0.539-0.988) | 0.806 (0.592-1.12) | 0.890 (0.642-1.26) | 0.999 (0.708-1.44) | 1.14 (0.792-1.69) | 1.25 (0.853-1.8 |
| 2-hr | 0.552 (0.445-0.700) | 0.647 | 0.789 (0.614-1.04) | 0.906 (0.693-1.21) | 1.07 (0.798-1.46) | 1.19 (0.875-1.66) | 1.32 (0.949-1.86) | 1.48 (1.05-2.13) | 1.69 (1.17-2.49) | 1.85 (1.26-2.7) |
| 3-hr | 0.729 (0.588-0.925) | 0.854 (0.680-1.10) | 1.04 (0.811-1.37) | 1.20 (0.915-1.60) | 1.41 (1.05-1.93) | 1.57 (1.15-2.19) | 1.73 (1.25-2.46) | 1.95 (1.38-2.81) | 2.23 (1.54-3.29) | 2.44 (1.66-3.66 |
| 6-hr | 1.17 (0.944-1.48) | 1.37 (1.09-1.76) | 1.67 (1.30-2.19) | 1.92 (1.47-2.56) | 2.26 (1.69-3.09) | 2.52 (1.85-3.51) | 2.78 (2.01-3.94) | 3.13 (2.22-4.51) | 3.58 (2.48-5.27) | 3.92 (2.67-5.88 |
| 12-hr | 1.76 (1.42-2.23) | 2.06 (1.64-2.65) | 2.50 (1.95-3.29) | 2.87 (2.19-3.83) | 3.38 (2.53-4.62) | 3.79 (2.78-5.27) | 4.21 (3.04-5.96) | 4.73 (3.35-6.82) | 5.42 (3.76-7.99) | 5.94 (4.05-8.9 |
| 24-hr | 2.54 (2.30-2.84) | 2.97 (2.65-3.37) | 3.59 (3.14-4.16) | 4.10 (3.52-4.83) | 4.82 (4.05-5.81) | 5.41 (4.46-6.64) | 6.04 (4.90-7.54) | 6.78 (5.41-8.61) | 7.76 (6.05-10.1) | 8.51 (6.52-11.2 |
| 2-day | 3.45 (3.12-3.87) | 4.01 (3.58-4.55) | 4.79 (4.19-5.55) | 5.42 (4.65-6.38) | 6.29 (5.28-7.59) | 7.00 (5.77-8.59) | 7.74 (6.28-9.66) | 8.59 (6.85-10.9) | 9.72 (7.57-12.6) | 10.6 (8.10-13.9 |
| 3-day | 4.10 (3.70-4.58) | 4.73 (4.22-5.36) | 5.61 (4.90-6.49) | 6.30 (5.41-7.42) | 7.26 (6.09-8.75) | 8.03 (6.62-9.85) | 8.82 (7.15-11.0) | 9.72 (7.75-12.3) | 10.9 (8.51-14.2) | 11.8 (9.06-15. |
| 4-day | 4.63 (4.18-5.18) | 5.32 (4.75-6.04) | 6.28 (5.49-7.27) | 7.03 (6.04-8.28) | 8.07 (6.77-9.72) | 8.88 (7.33-10.9) | 9.73 (7.89-12.1) | 10.7 (8.51-13.6) | 11.9 (9.30-15.5) | 12.9 (9.87-17.0 |
| 7-day | 5.98 (5.40-6.69) | 6.84 (6.10-7.75) | 8.02 (7.00-9.28) | 8.94 (7.68-10.5) | 10.2 (8.57-12.3) | 11.2 (9.25-13.8) | 12.3 (9.93-15.3) | 13.4 (10.7-17.0) | 15.0 (11.7-19.4) | 16.1 (12.4-21.3 |
| 10-day | 7.07 (6.39-7.92) | 8.07 (7.20-9.15) | 9.44 (8.24-10.9) | 10.5 (9.02-12.4) | 12.0 (10.0-14.4) | 13.1 (10.8-16.1) | 14.3 (11.6-17.8) | 15.6 (12.5-19.8) | 17.4 (13.6-22.6) | 18.7 (14.4-24.7 |
| 20-day | 10.6 (9.59-11.9) | 12.1 (10.8-13.7) | 14.1 (12.3-16.3) | 15.6 (13.4-18.3) | 17.6 (14.8-21.2) | 19.2 (15.8-23.5) | 20.7 (16.8-25.9) | 22.4 (17.9-28.5) | 24.7 (19.3-32.1) | 26.4 (20.2-34.8 |
| 30-day | 14.0 (12.6-15.6) | 15.9 (14.2-18.1) | 18.5 (16.2-21.4) | 20.4 (17.5-24.0) | 22.9 (19.3-27.7) | 24.9 (20.5-30.5) | 26.8 (21.7-33.4) | 28.8 (23.0-36.6) | 31.5 (24.6-40.9) | 33.5 (25.7-44.2 |
| 45-day | 18.5 (16.7-20.7) | 21.1 (18.8-23.9) | 24.5 (21.4-28.4) | 27.0 (23.2-31.8) | 30.1 (25.3-36.3) | 32.5 (26.8-39.8) | 34.8 (28.2-43.4) | 37.1 (29.5-47.1) | 40.1 (31.3-52.0) | 42.4 (32.5-55. |
| 60-day | 22.1 (19.9-24.7) | 25.4 (22.6-28.8) | 29.5 (25.7-34.1) | 32.3 (27.8-38.1) | 35.9 (30.1-43.3) | 38.4 (31.7-47.1) | 40.8 (33.1-50.9) | 43.0 (34.2-54.5) | 45.8 (35.7-59.5) | 48.0 (36.8-63.4 |


Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).

Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.


[Please refer to NOAA Atlas 14 document for more information.

Back to Top

PF graphical

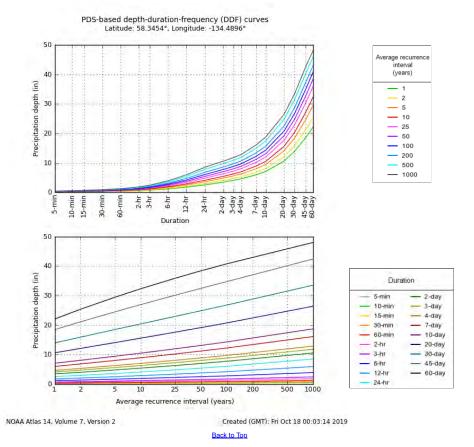



Maps & aerials




Large scale terrai

Precipitation Frequency Data Server







Back to Top

US Department of Commerce
National Oceanic and Atmospheric Administration
National Weather Service
National Weather Center
1325 East West Highway
Silver Spring, MD 20910
Questions?: HDSC_Questions@noaa.gov

Disclaime



NOAA Atlas 14, Volume 7, Version 2 Location name: Juneau, Alaska, USA* Latitude: 58.346°, Longitude: -134.4904° Elevation: 101.4 ft* *source: ESRI Mapps **source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Douglas Kane, Sarah Dietz, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Svetlana Stuefer, Amy Tidwell, Cad Trypaluk, Dale Unruh, Michael Yekta, Erica Betts, Geoffrey Bonnin, Sarah Heim, Lillian Hiner, Elizabeth Lilly, Jayashree Narayanan, Fengiln Yan, Tan Zhao

NOAA, National Weather Service, Silver Spring, Maryland

University of Alaska Fairbanks, Water and Environmental Research Center

PF tabular | PF graphical | Maps & aerials

PF tabular

| PDS- | based point precipitation frequency estimates with 90% confidence intervals (in inches/hour) ¹ | | | | | | | | | |
|----------|---|-------------------------------|-------------------------------|----------------------------|------------------------|-------------------------|------------------------|-------------------------|---------------------------|-------------------------|
| Duration | | | | Avera | ge recurren | ce interval (y | years) | | | |
| Duration | 1 | 2 | 5 | 10 | 25 | 50 | 100 | 200 | 500 | 1000 |
| 5-min | 1.58 (1.27-2.02) | 1.86 (1.48-2.40) | 2.27 (1.75-3.00) | 2.62 (1.99-3.52) | 3.08 (2.29-4.25) | 3.44 (2.51-4.82) | 3.80 (2.72-5.42) | 4.30 (3.02-6.23) | 4.94 (3.41-7.33) | 5.42 (3.67-8.17) |
| 10-min | 1.06 (0.852-1.36) | 1.25 (0.984-1.61) | 1.52 (1.18-2.02) | 1.75 (1.33-2.35) | 2.07 (1.54-2.85) | 2.31 (1.69-3.23) | 2.56 (1.83-3.64) | 2.89 (2.03-4.18) | 3.32 (2.29-4.92) | 3.64 (2.47-5.49) |
| 15-min | 0.828 (0.664-1.06) | 0.972 (0.768-1.26) | 1.19 (0.920-1.57) | 1.37 (1.04-1.84) | 1.62 (1.20-2.22) | 1.80 (1.32-2.53) | 2.00 (1.43-2.84) | 2.25 (1.59-3.26) | 2.59 (1.78-3.84) | 2.84 (1.93-4.29) |
| 30-min | 0.550 (0.440-0.702) | 0.646 (0.510-0.836) | 0.788 (0.610-1.04) | 0.908 (0.690-1.22) | 1.07 (0.796-1.47) | 1.20 (0.874-1.68) | 1.32 (0.950-1.89) | 1.49 (1.05-2.17) | 1.72 (1.18-2.54) | 1.89 (1.28-2.84) |
| 60-min | 0.377 | 0.442 | 0.540 | 0.622 | 0.734 | 0.820 | 0.907 | 1.02 | 1.18 | 1.29 |
| | (0.302-0.481) | (0.349-0.571) | (0.418-0.713) | (0.473-0.836) | (0.545-1.01) | (0.598-1.15) | (0.650-1.29) | (0.721-1.48) | (0.810-1.74) | (0.875-1.95) |
| 2-hr | 0.278 | 0.326 | 0.399 | 0.460 | 0.543 | 0.606 | 0.670 | 0.756 | 0.869 | 0.954 |
| | (0.223-0.356) | (0.258-0.422) | (0.308-0.527) | (0.350-0.618) | (0.403-0.747) | (0.442-0.850) | (0.480-0.954) | (0.532-1.10) | (0.598-1.29) | (0.646-1.44) |
| 3-hr | 0.245 (0.196-0.312) | 0.286 (0.226-0.370) | 0.351 (0.271-0.463) | 0.404 (0.307-0.543) | 0.477 (0.354-0.657) | 0.533 (0.389-0.746) | 0.588 (0.422-0.838) | 0.664 (0.468-0.962) | 0.763 (0.525-1.13) | 0.838 (0.568-1.26) |
| 6-hr | 0.197 | 0.231 | 0.282 | 0.324 | 0.383 | 0.428 | 0.473 | 0.534 | 0.614 | 0.675 |
| | (0.158-0.251) | (0.182-0.298) | (0.218-0.372) | (0.247-0.436) | (0.284-0.527) | (0.312-0.600) | (0.339-0.675) | (0.376-0.774) | (0.423-0.910) | (0.457-1.02) |
| 12-hr | 0.147 | 0.172 | 0.210 | 0.241 | 0.284 | 0.319 | 0.356 | 0.402 | 0.462 | 0.508 |
| | (0.118-0.188) | (0.136-0.223) | (0.162-0.277) | (0.183-0.323) | (0.211-0.391) | (0.233-0.447) | (0.255-0.507) | (0.283-0.582) | (0.318-0.686) | (0.344-0.767) |
| 24-hr | 0.107 | 0.125 | 0.151 | 0.172 | 0.203 | 0.229 | 0.256 | 0.289 | 0.332 | 0.365 |
| | (0.096-0.119) | (0.111-0.142) | (0.132-0.175) | (0.148-0.203) | (0.171-0.245) | (0.189-0.281) | (0.208-0.320) | (0.230-0.367) | (0.259-0.431) | (0.280-0.482) |
| 2-day | 0.073 | 0.084 | 0.101 | 0.114 | 0.133 | 0.148 | 0.164 | 0.183 | 0.209 | 0.227 |
| | (0.066-0.081) | (0.075-0.096) | (0.088-0.117) | (0.098-0.134) | (0.111-0.160) | (0.122-0.182) | (0.133-0.205) | (0.146-0.233) | (0.162-0.271) | (0.174-0.300) |
| 3-day | 0.057 | 0.066 | 0.079 | 0.088 | 0.102 | 0.113 | 0.125 | 0.139 | 0.156 | 0.170 |
| | (0.052-0.064) | (0.059-0.075) | (0.069-0.091) | (0.076-0.104) | (0.086-0.123) | (0.094-0.139) | (0.101-0.156) | (0.110-0.176) | (0.122-0.203) | (0.130-0.224) |
| 4-day | 0.049 | 0.056 | 0.066 | 0.074 | 0.085 | 0.094 | 0.103 | 0.114 | 0.128 | 0.139 |
| | (0.044-0.054) | (0.050-0.063) | (0.058-0.076) | (0.063-0.087) | (0.071-0.103) | (0.078-0.115) | (0.084-0.129) | (0.091-0.145) | (0.100-0.166) | (0.106-0.183) |
| 7-day | 0.035 | 0.040 | 0.047 | 0.053 | 0.061 | 0.067 | 0.074 | 0.081 | 0.091 | 0.098 |
| | (0.032-0.040) | (0.036-0.046) | (0.041-0.055) | (0.046-0.062) | (0.051-0.073) | (0.055-0.082) | (0.060-0.092) | (0.064-0.103) | (0.071-0.118) | (0.075-0.130) |
| 10-day | 0.029 | 0.033 | 0.039 | 0.043 | 0.049 | 0.054 | 0.060 | 0.066 | 0.073 | 0.079 |
| | (0.026-0.033) | (0.030-0.038) | (0.034-0.045) | (0.037-0.051) | (0.041-0.060) | (0.045-0.067) | (0.048-0.074) | (0.052-0.083) | (0.057-0.095) | (0.061-0.105) |
| 20-day | 0.022 | 0.025 | 0.029 | 0.032 | 0.036 | 0.040 | 0.043 | 0.047 | 0.052 | 0.056 |
| | (0.020-0.024) | (0.022-0.028) | (0.025-0.033) | (0.027-0.038) | (0.030-0.044) | (0.033-0.048) | (0.035-0.054) | (0.037-0.059) | (0.040-0.067) | (0.043-0.073) |
| 30-day | 0.019 | 0.022 | 0.025 | 0.028 | 0.031 | 0.034 | 0.037 | 0.040 | 0.044 | 0.047 |
| | (0.017-0.021) | (0.019-0.025) | (0.022-0.029) | (0.024-0.033) | (0.026-0.038) | (0.028-0.042) | (0.030-0.046) | (0.032-0.051) | (0.034-0.057) | (0.036-0.062) |
| 45-day | 0.017 | 0.019 | 0.022 | 0.025 | 0.028 | 0.030 | 0.032 | 0.034 | 0.037 | 0.039 |
| | (0.015-0.019) | (0.017-0.022) | (0.019-0.026) | (0.021-0.029) | (0.023-0.033) | (0.025-0.037) | (0.026-0.040) | (0.027-0.043) | (0.029-0.048) | (0.030-0.052) |
| 60-day | 0.015 | 0.017 | 0.020 | 0.022 | 0.025 | 0.027 | 0.028 | 0.030 | 0.032 | 0.034 |
| | (0.014-0.017) | (0.016-0.020) | (0.018-0.024) | (0.019-0.026) | (0.021-0.030) | (0.022-0.033) | (0.023-0.035) | (0.024-0.038) | (0.025-0.042) | (0.026-0.044) |

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).

Back to Top

PF graphical

Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.

Please refer to NOAA Atlas 14 document for more information.

Appendix E Rational Method

| Rational Method Site Runoff Drainage Basin D | | | | | | | | |
|--|---|---------------------|--|--|--|--|--|--|
| Project: | Hillcrest Extension Drainage Analysis, PAC2018 0054 | | | | | | | |
| Owner: | Michael and William Heumann | | | | | | | |
| Date: | 3/23/2020 | LIVIC | | | | | | |
| Prepared By: | L. Chambers | proHNS uc | | | | | | |
| Checked By: | G. Gladsjo | 0.007/22/30.000.000 | | | | | | |

Q = CIA

Q = peak flow in cubic feet per second (cfs)

C = runoff coefficient

I = rainfall intensity (inches per hour)

A = catchment area (acres)

$$C_c = (C_1 A_1 + C_2 A_2)/A_t$$

C_c = composite runoff coefficient

 $C_{1,2}$ = runoff coefficient for each area land cover type

 $A_t = total area (acres)$

 $A_{1,2}$ = areas of land cover types (acres)

Cc = 0.22, See Appendix C for calculation

$$T_c = T_1 + T_2 + \dots + T_n$$

 T_c = time of concentration (min)

 $T_{1,2}$ = travel time across separate flow path segments (min)

Tc = 41.51 min., See Appendix D for calculation

$$T_t = L/60V$$

 $T_t = travel time (min)$

L= the distance of flow across a given segment (feet)

 $V=k_R Sqrt(S_0)$ =average velocity (feet/sec) across land cover

 k_{R} = time of concentration velocity factor (CBJ Manual of Storm Water BMP 2010, Table D-5, PG. D-10)

 S_0 = slope of flow path (feet/feet)

Per CBJ Manual of Storm Water BMP 2010, Table 5-1, page. 5-1, design event frequencies are specified. For driveway culvert, a 25-year storm event is the required design return period. We will base our analysis on a 25-year design return period for all drainage structures and catchment areas. Per CBJ Manual of Storm Water BMP 2010, page. D-9, Basins with a time and concentration 10 minutes or less shall use the 10 minute intensity. Basins with a time of concentration greater than 10 minutes and less than 30 minutes shall interpolate between the 10 and 10 minute values. Rainfall intensity for the site was sourced from the NOAA Atlas 14, Point Precipitation Frequency Estimates, see Appendix E, and is summarized as follows:

Design Return Period

Tc 41.51(min)

25-year

Interpolated Intensity (in/hr) =

0.94

There is an existing 24" CMP culvert that drains into the existing Glacier Highway ditch system at the location where the new subdivision access will tie into the shoulder of the Highway. The area currently contributing runoff to this culvert was delinated in AutoCAD from aerial photos and 2013 Lidar Data provided by CBJ.

A = 400337 sqft / 43,560 = **9.19 acres**

Q (cfs)= 0.22 0.94 9.19 = 1.90

Appendix F SCS Hydrograph

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2020


Saturday, 03 / 21 / 2020

Hyd. No. 1

Hillcrest Ext Predeveloped Drainage Basin A

Hydrograph type = SCS Runoff Peak discharge = 6.711 cfs Storm frequency = 25 yrs Time to peak $= 8.33 \, hrs$ Time interval = 10 min Hyd. volume = 148,969 cuft Drainage area Curve number = 19.920 ac= 72* Basin Slope = 0.0 % Hydraulic length = 0 ftTime of conc. (Tc) Tc method = User $= 41.60 \, \text{min}$ Distribution Total precip. = 4.82 in= Type IA Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.540 \times 98) + (0.320 \times 98) + (0.250 \times 89) + (0.330 \times 74) + (18.480 \times 70)] / 19.920$

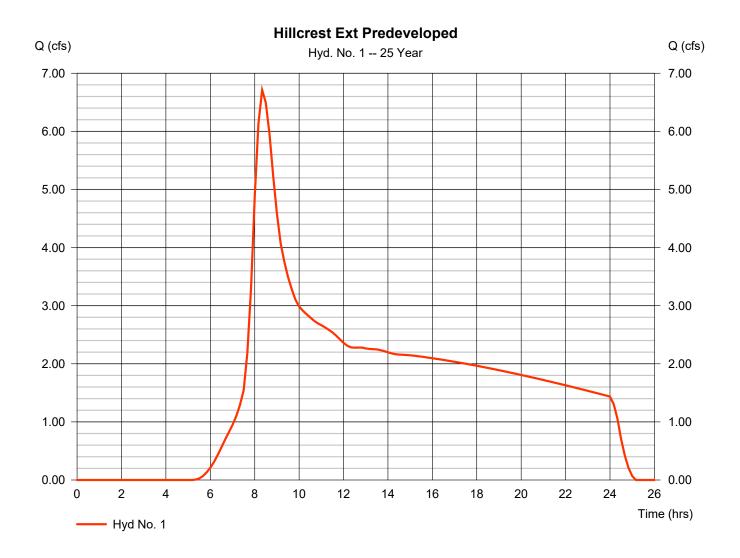

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2020


Saturday, 03 / 21 / 2020

Hyd. No. 3

Hillcrest Ext Post Develope Drainage Basin C

Hydrograph type = SCS Runoff Peak discharge = 5.576 cfs Storm frequency = 25 yrs Time to peak $= 8.33 \, hrs$ Time interval = 10 min Hyd. volume = 118,944 cuft Curve number Drainage area = 14.750 ac = 74* Basin Slope = 0.0 % Hydraulic length = 0 ftTime of conc. (Tc) Tc method = User $= 40.60 \, \text{min}$ Total precip. = 4.82 inDistribution = Type IA Storm duration = 24 hrs Shape factor = 484

^{*} Composite (Area/CN) = $[(0.835 \times 98) + (0.731 \times 98) + (0.615 \times 89) + (0.965 \times 74) + (11.607 \times 70)] / 14.750$

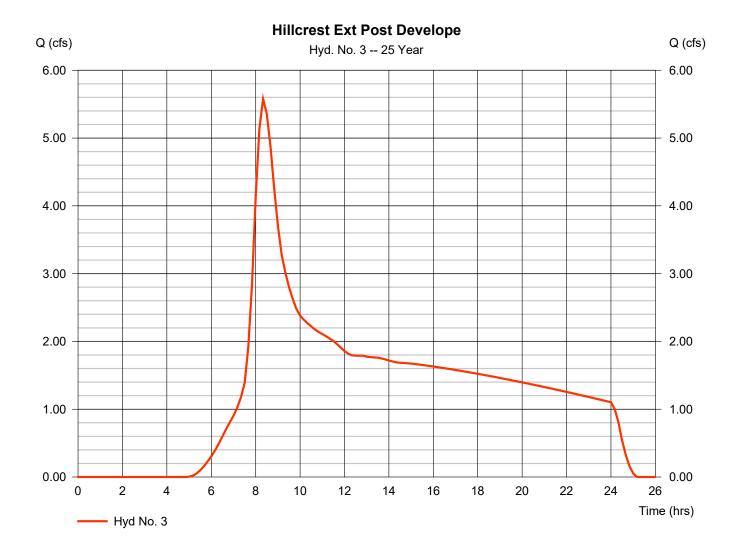

Appendix G Existing Capacity

| | Proposed 18" CPP Discharge C | apacity |
|--------------|--|--------------------|
| Project: | Hillcrest Ext. Subdivision Drainage Analysis, PAC2018 0054 | |
| Owner: | Michael and William Heumann | |
| Date: | 3/23/2020 | LIVIC |
| Prepared By: | L. Chambers | proHNS uc |
| Checked By: | G. Gladsjo | B/ #2/35 .5 E/ 655 |

The following equations were used to calculate the proposed 18" CPP culvert P-7 acts as the driveway culvert to Lot 14 and is the first pipe in the proposed storm drain system and were obtained from "Urban Drainage Design Manual: Hydraulic Engineering Circular No. 22, Third Edition".

$$Q = (K/n) \times A \times R^{0.67} \times S^{0.5}$$

Q = discharge rate in ft³/sec

K = coefficient for English units (1.486)

n = Manning's coefficient of roughness, obtained from Table 5-3, Page 5-5, of the CBJ Stormwater Manual

 $A = cross sectional area in ft^2$

R = hydraulic radius

S = slope

Existing 18" Ditch Culvert; Inlet Invert = 30.0', Outlet Invert = 29.0', Length = 40', n = 0.014. The Manning's n value of 0.014 was determined by the pipe type (CPP-smooth interior) Table 5-3.

K n A R S Q(cfs) 1.486 0.014 1.77 0.375 0.0052 = 7.022094

App G - Prior Drainage

| | Existing Driveway Ditch Discharge Ca | apacity |
|--------------|--|-----------------------|
| Project: | Hillcrest Ext. Subdivision Drainage Analysis, PAC2018 0054 | |
| Owner: | Michael and William Heumann | |
| Date: | 3/23/2020 | TIVIC |
| Prepared By: | L. Chambers | proHNS uc |
| Checked By: | G. Gladsjo | (D) 7.2-33 . 1 Z. 658 |

The following equations were used to calculate the capacity of the driveway ditch leading into the 18" CPP at the bottom of the ditch run and were obtained from "Urban Drainage Design Manual: Hydraulic Engineering Circular No. 22, Third Edition".

$$Q = (K/n) \times A \times R^{0.67} \times S^{0.5}$$

- Q = discharge rate in ft³/sec
- K = coefficient for English units (1.486)
- n = Manning's coefficient of roughness, obtained from Table D-10, Page D-19, of the CBJ Stormwater Manual
- $A = cross sectional area in ft^2$, from survey basemap
- R = hydraulic radius, from survey basemap
- S = slope, from survey basemap

Existing driveway ditch; Top Elev. = 37.0', Bottom Elev. = 30.0', Length = 80', n = 0.03. The Manning's n value of 0.03 comes from Table D-10 (grass, some weeds), elevation and length data are from survey basemap.

 K
 n
 A
 R
 S

 Q (cfs)
 1.486
 0.03
 1.55
 0.319588
 0.0875
 =
 10.57569



MEMORANDUM

DATE: February 28, 2020

TO: William Heumann, Owner

FROM: Michael Read, PE, Principal, TENW

SUBJECT: Richland Manor-Traffic Impact Analysis

TENW Project No. 3709

This memorandum summarizes a traffic impact analysis of *Richland Manor*, a proposed residential development in the vicinity of Hooter Lane and Craig Street north of Glacier Highway in Juneau, Alaska. This memo includes a summary of the project, a description of existing transportation conditions within the immediate site vicinity, methodology used to derive the trip generation estimate, traffic operational traffic impact analysis at key study intersections, review of site access, and identification of any transportation mitigation measures.

Project Description

The proposed *Richland Manor r*esidential development would consist of up to 47 single family homes (detached) and approximately 356 multifamily homes in the vicinity of Hooter Lane and Craig Street north of Glacier Highway in Juneau, Alaska. A site vicinity map is provided in **Figure 1**. The proposed development would be constructed in phases, beginning in 2020, with full build-out and occupancy anticipated by 2029.

Primary vehicular access would be provided via construction of a public roadway within the undeveloped right-of-way of Hooter Lane, with secondary vehicular access via Hillcrest Drive and Abey Way via Craig Street. Additional gated access would be provided onto Robbie Road for emergency vehicles only. A conceptual site plan has been developed for the project and is shown in **Figure 2**.


Existing Transportation Conditions

This section includes an inventory of existing roadway conditions, traffic volumes, levels of service and planned roadway improvements.


Roadway Conditions

The following paragraphs describe existing arterial roadways that would be used for site access. Roadway characteristics are described in terms of number of lanes, speed limits, shoulder types and widths.

Glacier Highway is a three-lane roadway with a center southbound left-turn lane north of Glacier Highway. East of Vanderbilt Road and Glacier Highway, the roadway consists of two lanes with curbs and gutters on both sides of the street, and a sidewalk on the north side of street. Bicycle lanes are provided on both sides of the street. The posted speed limit is 40 mph.

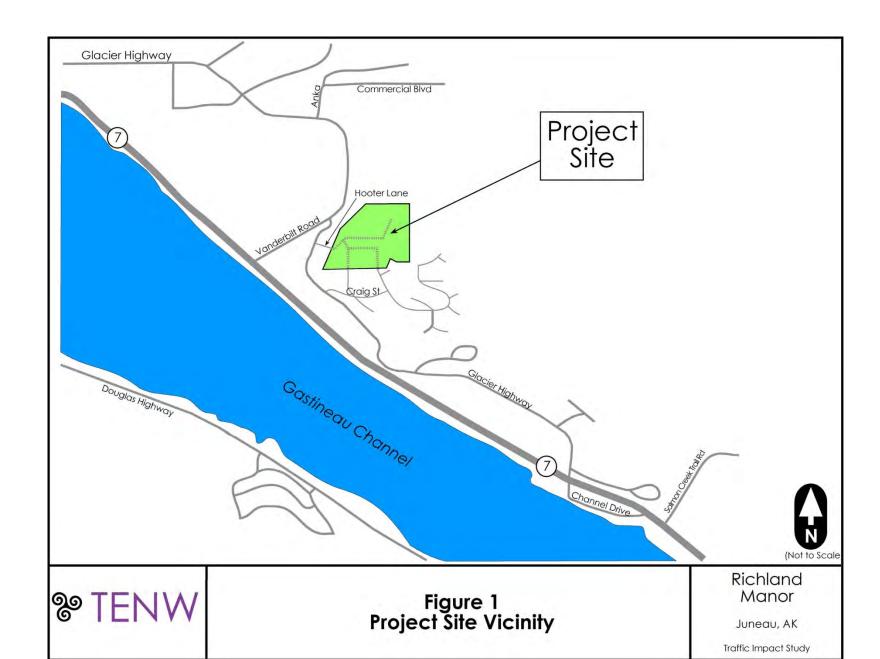



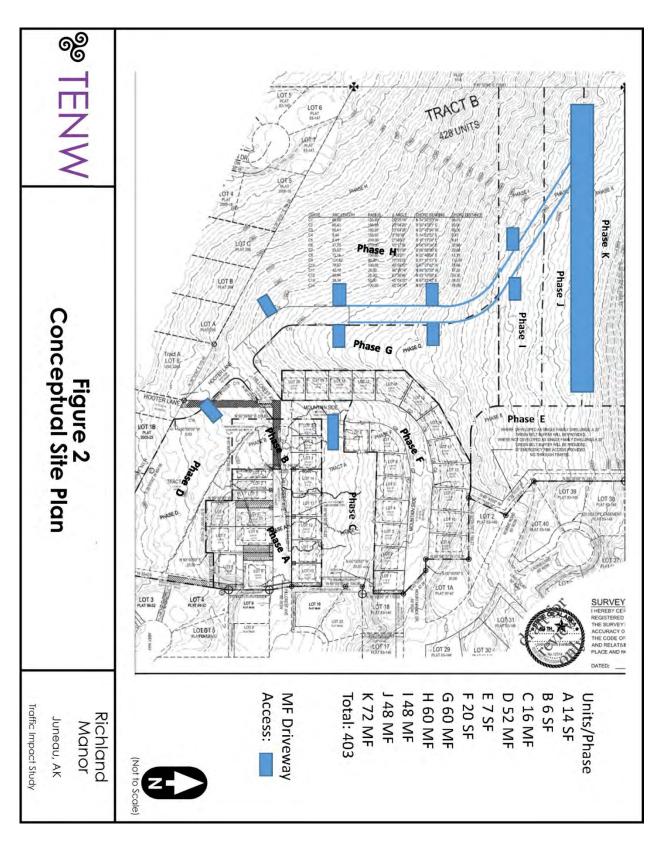

Vanderbilt Road is a three-lane roadway with a center refuge lane, which transitions into a left turn lane at Egan Drive. Bicycle lanes are provided on both sides of the street. The posted speed limit is 45 mph south of Glacier Highway.

Hillcrest Drive is a local street approximately 26 feet in width. The roadway is unchannelized with two travel lanes, curbs, and gutters, but no sidewalks. There is no posted speed.

Traffic Counts

Peak hour traffic volumes represent the highest hourly volume of vehicles passing through an intersection during a typical 7-9 a.m. and 4-6 p.m. weekday peak period. Peak period turning movement counts at several study intersections during the afternoon p.m. peak period were conducted by PDC Engineers early December 2019 (Attachment 1). Figure 3 overviews channelization/traffic control at study intersections. Figure 4 summarizes the existing p.m. peak period turning movements at study intersections determined in scoping discussions with the Alaska Department of Transportation and Public Facilities (DOT&PF).

Intersection Levels of Service

Intersection level of service (LOS) analyses were conducted at the study intersections during the weekday p.m. peak hour of existing conditions and with and without project traffic generated by the proposed development. LOS refers to the degree of congestion on a roadway or intersection. It is a measure of vehicle operating speed, travel time, travel delays, and driving comfort. A letter scale from A to F generally describes LOS. At signalized intersections, LOS A represents free-flow conditions-motorists experience little or no delays, and LOS F represents forced-flow conditions-motorists experience an average delay in excess of 80 seconds per vehicle. The LOS reported for signalized intersections represents the average control delay per vehicle entering the intersection. The LOS reported at stop-controlled intersections is also based on the average control delay (sec/veh) and is reported for each movement. Therefore, the reported LOS at unsignalized intersections does not represent a measure of the overall operations of the intersection.

LOS calculations for both signalized and stop-controlled intersections were calculated using the methodologies and procedures outlined in the 2000 and 2010 *Highway Capacity Manual (HCM)*, Special Report 209, Transportation Research Board (TRB), using the *Synchro 10* software program.

Table 1 outlines the LOS criteria for signalized and unsignalized intersections based on these methodologies. ADOT&PF maintains a level of service standard of LOS D for development review. Existing p.m. peak hour LOS analyses are summarized in Table 2. As shown, all intersections or critical movements operate at LOS B or better under existing conditions. Detailed LOS summary worksheets are included in Attachment 2.


Table 1: Level of Service Criteria for Signalized and Unsignalized Intersections

| | | 3 |
|------------------|---------------------------|---------------------------|
| 1 | Signalized Intersection | Unsignalized Intersection |
| Level of Service | Average Delay Range (sec) | Delay Range (sec) |
| A | ≤ 10 | ≤ 10 |
| В | > 10 to ≤ 20 | > 10 to ≤ 15 |
| С | > 20 to ≤ 35 | > 15 to ≤ 25 |
| D | > 35 to ≤ 55 | > 25 to ≤ 35 |
| E | > 55 to ≤ 80 | > 35 to ≤ 50 |
| F | > 80 | > 50 |

Source: "Highway Capacity Manual", Special Report 209, Transportation Research Board, 2000.





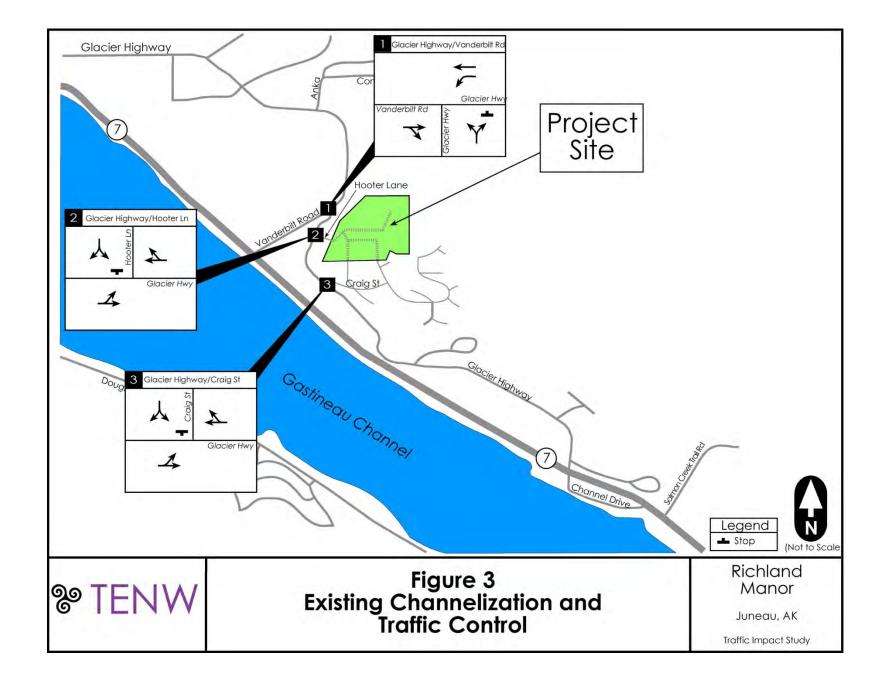



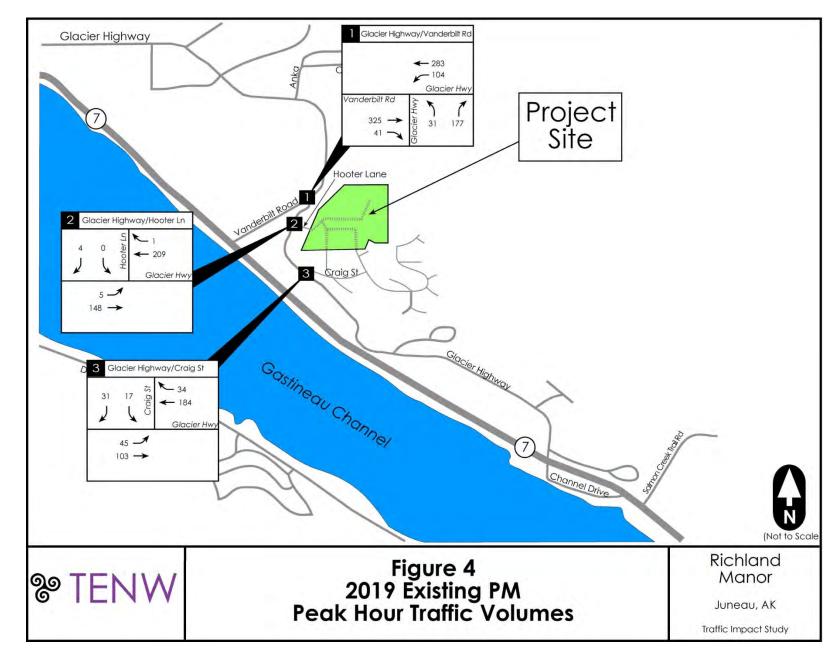


Table 2: Existing PM Peak Hour Intersection Levels of Service

| _ | | | | |
|---|-------------|-----------|-------------|-----------|
| | | <u>PN</u> | Л Peak Hour | |
| Study Intersection | | LOS | Delay (sec) | V/C Ratio |
| Stop Controlled Intersections | | | | |
| #1 - Glacier Highway at Vanderbilt Road | (NB – Stop) | В | 14.2 | 0.37 |
| | (WB - Left) | Α | 8.4 | 0.10 |
| #2 - Glacier Highway at Hooter Lane | (SB – Stop) | Α | 9.6 | 0.01 |
| #3 - Glacier Highway at Craig Street | (SB – Stop) | В | 10.4 | 0.07 |

Source: TENW.

Planned Transportation Improvements

ADOT&PF has a programmed improvement at the intersection of Glacier Highway and Vanderbilt Road intersection. The improvement is part of a larger regional trail/bicycle plan and would involve installation of a pedestrian/bicycle crossing treatment west side of the intersection to include a median refuge island and pedestrian-activated rectangular rapid flashing beacon (RRFB) system. The currently planned improvement would eliminate the existing median refuge lane for northbound left turning movements from Glacier Highway onto Vanderbilt Road.

Traffic Impact Analysis

The following section describes projected future baseline traffic growth, new trips generated by the proposed development, distribution and assignment of new project trips, intersection level of service impacts, site access, safety and circulation issues, and identification of transportation mitigation to offset impacts.

2029 Baseline Traffic Volumes

To evaluate project traffic impacts at full buildout, traffic counts obtained in 2019 were factored by a 1 percent annual background growth rate to forecast 2029 future baseline traffic volumes.

Project Trip Generation

Documented trip rate equations compiled by the Institute of Transportation Engineers (ITE) *Trip Generation Manual, 10th Edition,* 2017, were used to estimate daily, a.m. peak hour and p.m. peak hour traffic that would be generated by the proposed residential uses within *Richland Manor,* assuming new detached single-family homes (ITE Land Use Code 210) and Low-Rise Multifamily uses (LUC 220).

As shown in **Table 3**, total site trip generation of the project is estimated to generate a approximately 3,050 new weekday daily trips, 199 new a.m. peak hour trips (46 entering and 153 exiting), and 246 new p.m. peak hour trips (155 entering and 91 new exiting).

Table 3: Richland Manor - Trip Generation

| Time Period | In | Out | Total |
|----------------------|-------|-------|-------|
| Weekday Daily | 1,525 | 1,525 | 3,050 |
| Weekday AM Peak Hour | 46 | 153 | 199 |
| Weekday PM Peak Hour | 155 | 91 | 246 |

Source: TENW. See also Attachment 3



Trip Distribution and Assignment

To distribute trips onto the vicinity-street and arterial network, trip distribution patterns were determined based on review of existing travel patterns, and the relative distribution of employment and residential density in the vicinity (see also **Attachment 4**). Generally, average distribution and assignment of project trips were assumed as:

- > 45 percent easterly via Glacier Highway; and
- 55 percent westerly and northwesterly via Glacier Highway and Vanderbilt Road.

Figure 5 shows p.m. peak hour trip distribution, while **Figure 6** summarizes p.m. peak hour trip assignment. **Figure 7** summarizes p.m. peak hour traffic volume forecasts without and with the proposed *Richland Manor* project for the 2029 horizon year.

Intersection Level of Service Impacts

Table 4 summarizes level of service impacts in 2029 with and without completion of the proposed project. All study intersections and site access driveways would operate at LOS D or better with and without the project in the 2029 horizon year. Per the footnote in Table 4, the Alaska DOT&PF's proposal to remove the median refuge lane for vehicular capacity would drop the future level of service with buildout of *Richland Manor* to LOS D by 2029. If the existing intersection capacity is maintained, buildout of *Richland Manor* would operate at LOS C and not require any mitigation. Detailed LOS summary worksheets are included in **Attachment 1**.

Table 4: 2029 PM Intersection Level of Service Impacts

| | | PM \ | Without Pr | <u>oject</u> | <u>P1</u> | M With Pro | oject |
|---|-------------|------|------------|--------------|-----------|------------|-------|
| | | | Delay | V/C | | Delay | V/C |
| Study Intersection | | LOS | (sec) | Ratio | LOS | (sec) | Ratio |
| Stop Controlled Intersections | | | | | | | |
| #1 - Glacier Highway at Vanderbilt Road | (NB – Stop) | С | 18.3 | 0.48 | D* | 25.8 | 0.65 |
| | (WB – Left) | Α | 8.6 | 0.11 | Α | 9.0 | 0.19 |
| #2 - Glacier Highway at Hooter Lane | (SB – Stop) | Α | 9.8 | 0.01 | В | 11.9 | 0.14 |
| #3 - Glacier Highway at Craig Street | (SB – Stop) | В | 10.7 | 0.09 | В | 19.3 | 0.55 |

Source: TENW. * - At the intersection of Glacier Highway and Vanderbilt Road, the DOT&PF project to remove intersection capacity to install the RRFB results in a LOS D condition in at buildout of *Richland Manor* by 2029. If the median refuge lane remains available for left turns, with buildout of the project in 2029 this approach would operate at LOC C with an average delay of 19.3 Seconds per vehicle.


Site Access and Circulation

Primary vehicular access would be provided via construction of a public roadway within the undeveloped right-of-way of Hooter Lane, with secondary vehicular access via Hillcrest Drive and Abey Way via Craig Street. Additional gated access would be provided onto Robbie Road for emergency vehicles only to meet the minimum fire accessibility codes (above 200 multifamily housing units) per the International Fire Code to provide for secondary access beyond the Hooter Lane and Abey Way intersection.


The main access points to the site would be located on Glacier Highway at Hooter Lane and Craig Street. As identified previously, all critical stop-controlled movements at these two intersections are anticipated to operate at LOS B or better with the proposed development in 2029, with little or no vehicular queuing.



Traffic Impact Analysis Richland Manor

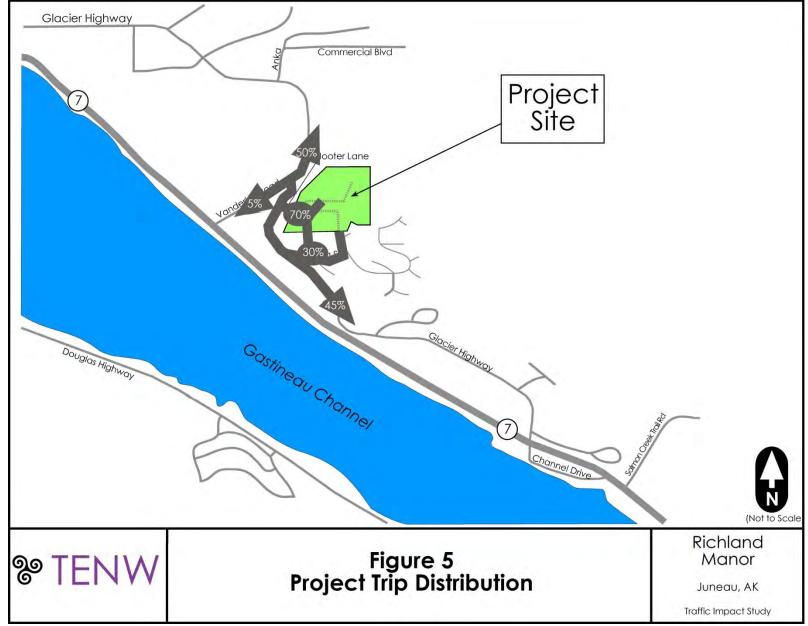

February 28, 2020 Page 10

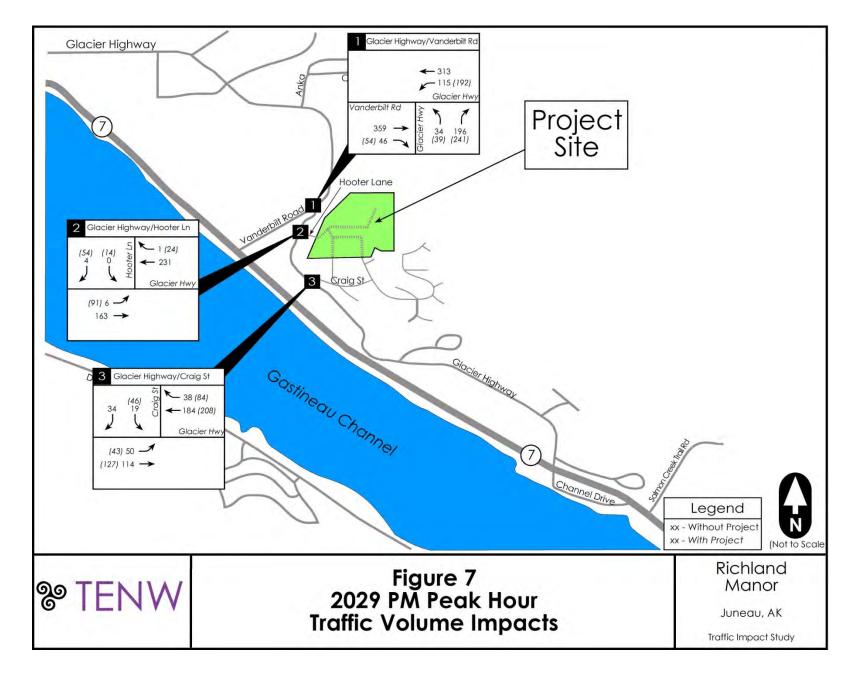

Sight Distance

The American Association of State and Highway Transportation Officials (AASHTO) was used to determine entering and stopping sight distance requirements. AASHTO requires 555 feet of entering sight distance and 425 feet of stopping sight distance for a 50 mph design speed (10 mph over posted speed limit of 40 mph) on Glacier Highway. Field-measured sight distances by TENW in 2006 on Glacier Highway east and west of Hooter Lane are estimated to be greater than 700 feet, and are estimated to be greater than 1,000 feet east of and more than 700 feet west of Craig Street. Therefore, entering sight distance at the main site access points onto Glacier Highway at Hooter Lane and Craig Street would exceed AASHTO requirements.

Left-Turn Lane Warrants

Left-turn movements represent critical turning movements at unsignalized intersections, increasing the potential for intersection delay and safety issues. Therefore, the potential need for a left-turn lane onto Glacier Highway at Hooter Lane was analyzed considering typical evening commute periods.

Based upon procedures and guideline's found in Volume Warrants for Left-Turn Storage Lanes at Unsignalized Intersections (Highway Research Record 211), an eastbound left-turn lane is not warranted based upon approximately 35 percent of eastbound left-turns, a 40 mph posted speed limit, advancing volume of approximately 255 vehicles and an opposing volume of 255 vehicles (Attachment 5).

Project Mitigation

A traffic analysis and review was conducted of vehicular trip generation, intersection impacts, and site access, circulation, and safety issues for the proposed *Richland Manor* residential development in Juneau, AK. No direct mitigation measures were found to be necessary as a result of the proposed project. To meet level of service objectives of DOT&PF, the planned pedestrian/bicycle crossing treatment should be modified to preserve existing intersection capacity at its intersection with Vanderbilt Road or review of traffic operational impacts consider that level of service standards would not trigger any project mitigation if existing intersection capacity was maintained under existing conditions per 17 AAC 10.070.

As part of the development, the development would pay for the improvement and/or construction of all new site public access roadways and access connections including construction of Hooter Lane the extension of Abey Way and Hillcrest Drive, and Robbie Road (to serve as secondary fire/emergency vehicle access). A gated control for fire/emergency vehicles utilizing Opticom preemption is recommended for ease of fire/emergency vehicle access via Robbie Road.

If you have any questions regarding the information presented in this memo, please call me at $(206) 361-7333 \times 101$ or mikeread@tenw.com.

Attachments:

- 1. 2019 Traffic Counts
- 2. Level of Service Summary Sheets
- 3. Trip Generation Estimates
- 4. Trip Distribution Observations
- 5. Turn Lane Warrant per HRR 211



Attachment 1 2019 Traffic Counts

| Name: _ | PDC | | | Date: Project: | | 5/2019 Mano r | | | | City: | <u>Juneau</u> | | | |
|-----------------|----------|-----------|------------|-------------------|------------|-------------------------|-------|----------|-------------|-------|---------------|-------------|--------------|---------------|
| ntersection of: | Craig S | treet | | and | Glacier I | lighway | 1 | | | _ | | | | |
| Street: | <u>c</u> | raig Stre | <u>eet</u> | <u>c</u> | raig Stree | <u>et</u> | Glaci | ier High | <u>ıway</u> | Glac | ier Higl | <u>ıway</u> | Total All | Hour Total |
| Time | Е | ast Boui | _ | W | est Boun | _ | No | rth Bou | ınd | Soi | uth Bot | ınd | | |
| Begins | L | T | R | L | T | R | L | T | R | L | T | R | | |
| 3:00 PM | | | | | | | | | | | | | 0 | |
| 3:15 PM | | | | | | | | | | | | | 0 | |
| 3:30 PM | | | | | | | | | | | | | 0 | |
| 3:45 PM | | | | | | | | | | | | | 0 | (|
| 4:00 PM | | | | 3 | | 12 | | 39 | 12 | 14 | 17 | | 97 | 97 |
| 4:15 PM | | | | 4 | | 10 | | 36 | 16 | 8 | 27 | | 101 | 198 |
| 4:30 PM | | | | 3 | | 8 | | 45 | 10 | 9 | 33 | | 108 | 306 |
| 4:45 PM | | | | 3 | | | | 35 | 11 | 12 | 24 | | 88 | 394 |
| 5:00 PM | | | | 8 | | 13 | | 50 | | 12 | 21 | | 112 | 409 |
| 5:15 PM | | | | 3 | | 7 | | 37 | 5 | 12 | 25 | | 89 | 397 |
| 5:30 PM | | | | 1 | | 5 7 | | 24 | | 12 | 19 | | 72 | 361 |
| 5:45 PM | | | | 3 | | 7 | | 37 | 5 | 12 | 25 | | 89 | 362 |
| Peak Hour | 0 | 0 | 0 | 18 | 0 | 34 | 0 | 166 | 45 | 41 | 105 | 0 | [| 150 |

| Name: _ | PDC | | | Date: Project: | Richland | | | | | City: | <u>Juneau</u> | | | |
|-----------------|----------|----------|------------|-------------------|-----------|-----------|-------|----------|-------------|-------|---------------|-------------|--------------|---------------|
| ntersection of: | Hoote | Lane | | and | Glacier I | Highway | | | | | | | | |
| Street: | <u>H</u> | ooter La | <u>ine</u> | <u>H</u> | ooter Lai | <u>ne</u> | Glaci | ier High | <u>ıway</u> | Glac | ier Higł | <u>ıway</u> | Total All | Hour Total |
| Time | E | ast Bou | nd | W | est Bour | nd | No | rth Bou | ınd | Soi | uth Bou | ınd | | |
| Begins | L | T | R | L | T | R | L | T | R | L | T | R | | |
| 3:00 PM | | | | | | | | | | | | | 0 | |
| 3:15 PM | | | | | | | | | | | | | 0 | |
| 3:30 PM | | | | | | | | | | | | | 0 | |
| 3:45 PM | | | | | | | | | | | | | 0 | (|
| 4:00 PM | | | | 0 | | 0 | | 52 | 1 | 1 | 30 | | 84 | 84 |
| 4:15 PM | | | | 0 | | 1 | | 42 | 1 | 0 | 37 | | 81 | 165 |
| 4:30 PM | | | | 0 | | 0 | | 65 | | 2 | 45 | | 113 | 278 |
| 4:45 PM | | | | 0 | | 0 | | 34 | 0 | 1 | 30 | | 65 | 343 |
| 5:00 PM | | | | 0 | | 2 2 | | 62 | 0 | 2 | 34 | | 100 | 359 |
| 5:15 PM | | | | 0 | | 2 | | 48 | 0 | 0 | 39 | | 89 | 367 |
| 5:30 PM | | | | 1 | | 0 | | 35 | 1 | 1 | 29 | | 67 | 321 |
| 5:45 PM | | | | 0 | | 1 | | 33 | 0 | 0 | 27 | | 61 | 317 |
| Peak Hour | 0 | 0 | 0 | 0 | 0 | 4 | 0 | 209 | 1 | 5 | 148 | 0 | [| 1347 |

| Name: | PDC | | | Date: Project: | 9/26 Richland | 6/2019 Manor | | | | City: | Juneau | | | |
|-----------------|---------|-----------|-------------|-------------------|-------------------------|-----------------|------|------------------|------|-------|-----------|------|--------------|---------------|
| ntersection of: | Glacier | Highwa | ıy | • | Vanderb | | 1 | | | T | | | | |
| Street: | Glad | cier High | <u>ıway</u> | Glad | cier High | <u>way</u> | Vand | lerbilt R | Road | Vano | lerbilt F | Road | Total All | Hour Total |
| Time | E | ast Boui | nd | W | est Bour | nd | No | rth Bou | ınd | Sou | ith Bou | nd | | |
| Begins | L | T | R | L | T | R | L | T | R | L | T | R | | |
| 3:00 PM | | | | | | | | | | | | | 0 | |
| 3:15 PM | | | | | | | | | | | | | 0 | |
| 3:30 PM | | | | | | | | | | | | | 0 | |
| 3:45 PM | | | | | | | | | | | | | 0 | (|
| 4:00 PM | | | | 15 | | 47 | | 97 | 5 | 25 | 56 | | 245 | 245 |
| 4:15 PM | | | | 11 | | 46 | | 85 | 10 | 26 | 61 | | 239 | 484 |
| 4:30 PM | | | | 8 | | 53 | | 80 | 8 | 27 | 61 | | 237 | 72 1 |
| 4:45 PM | | | | 7 | | 36 | | 84 | 8 | 20 | 65 | | 220 | 941 |
| 5:00 PM | | | | 12 | | 40 | | 74 | 15 | 28 | 89 | | 258 | 954 |
| 5:15 PM | | | | 4 | | 48 | | 87 | 11 | 29 | 68 | | 247 | 962 |
| 5:30 PM | | | | 10 | | 32 | | 45 | 9 | 18 | 55 | | 169 | 894 |
| 5:45 PM | | | | 12 | | 16 | | 45 | 10 | 18 | 38 | | 139 | 813 |
| Peak Hour | 0 | 0 | 0 | 31 | 0 | 177 | 0 | 325 | 42 | 104 | 283 | 0 | Γ | 3578 |

Attachment 2 Intersection LOS Summary Sheets

| Intersection | | | | | | | |
|--------------------------------------|--------------|----------|-------|---------|------|--------|------|
| Int Delay, s/veh | 4 | | | | | | |
| , , , , , , | | | | | | | |
| Movement | WBL | WBR | | NBT | NBR | SBL | SBT |
| Vol, veh/h | 31 | 177 | | 325 | 42 | 104 | 283 |
| Conflicting Peds, #/hr | 0 | 0 | | 0 | 0 | 0 | 203 |
| Sign Control | Stop | Stop | | Free | Free | Free | Free |
| RT Channelized | Stop | None | | - | None | 1166 | None |
| Storage Length | 0 | None - | | | - | 0 | - |
| Veh in Median Storage, # | 0 | _ | | 0 | _ | - | 0 |
| Grade, % | 0 | _ | | 0 | _ | - | 0 |
| Peak Hour Factor | 93 | 93 | | 93 | 93 | 93 | 93 |
| Heavy Vehicles, % | 2 | 2 | | 2 | 2 | 2 | 2 |
| Mvmt Flow | 33 | 190 | | 349 | 45 | 112 | 304 |
| | | | | | | | |
| Maian/Minan | N //: 1 | | | N/a!au1 | | Maiano | |
| Major/Minor | Minor1 | 272 | | Major1 | | Major2 | |
| Conflicting Flow All | 900 | 372 | | 0 | 0 | 395 | 0 |
| Stage 1 | 372 | - | | - | - | - | - |
| Stage 2 | 528 | - / 22 | | - | - | 4 1 2 | - |
| Critical Hdwy Critical Hdwy Stg 1 | 6.42 5.42 | 6.22 | | - | - | 4.12 | - |
| Critical Hdwy Stg 2 | 5.42 | - | | - | - | - | - |
| Follow-up Hdwy | 3.518 | 3.318 | | - | - | 2.218 | - |
| Pot Cap-1 Maneuver | 3.516 | 674 | | - | - | 1164 | - |
| Stage 1 | 697 | - 074 | | - | - | 1104 | - |
| Stage 2 | 592 | | | _ | _ | | |
| Platoon blocked, % | 372 | | | | - | | |
| Mov Cap-1 Maneuver | 279 | 674 | | _ | _ | 1164 | _ |
| Mov Cap-2 Maneuver | 400 | - | | - | - | 1104 | _ |
| Stage 1 | 697 | _ | | _ | _ | _ | _ |
| Stage 2 | 535 | - | | - | _ | - | _ |
| o tago L | | | | | | | |
| 0 | MD | | | ND | | 0.0 | |
| Approach | WB | | | NB | | SB | |
| HCM Control Delay, s | 14.2 | | | 0 | | 2.3 | |
| HCM LOS | В | | | | | | |
| | | | | | | | |
| Minor Lane/Major Mvmt | NBT | NBRWBLn1 | SBL | SBT | | | |
| Capacity (veh/h) | - | - 612 | 1164 | - | | | |
| HCM Lane V/C Ratio | - | - 0.365 | 0.096 | - | | | |
| HCM Control Delay (s) | - | - 14.2 | 8.4 | - | | | |
| HCM Lane LOS | - | - B | Α | - | | | |
| HCM 95th %tile Q(veh) | - | - 1.7 | 0.3 | - | | | |

| Intersection | | | | | | | | |
|--------------------------|----------|----------|-----|-----------|----------|------|----------|----------|
| Int Delay, s/veh | 0.2 | | | | | | | |
| ., | | | | | | | | |
| Movement | EBL | EBT | | | WBT | WBR | SBL | . SBR |
| Vol, veh/h | 5 | 148 | | | 209 | | | |
| Conflicting Peds, #/hr | 0 | 0 | | | 0 | | | |
| Sign Control | Free | Free | | | Free | Free | Stop | Stop |
| RT Channelized | - | None | | | - | None | | |
| Storage Length | - | - | | | - | - | 0 | - |
| Veh in Median Storage, # | # - | 0 | | | 0 | - | 0 | - |
| Grade, % | - | 0 | | | 0 | - | 0 | - |
| Peak Hour Factor | 81 | 81 | | | 81 | 81 | 81 | 81 |
| Heavy Vehicles, % | 2 | 2 | | | 2 | 2 | 2 | . 2 |
| Mvmt Flow | 6 | 183 | | | 258 | 1 | 0 | 5 |
| | | | | | | | | |
| Major/Minor | Major1 | | | | Major2 | | Minor2 | 1 |
| Conflicting Flow All | 259 | 0 | | | - Wajorz | 0 | | |
| Stage 1 | - | - | | | <u>-</u> | - | 259 | |
| Stage 2 | _ | - | | | | _ | 195 | |
| Critical Hdwy | 4.12 | _ | | | - | _ | (10 | |
| Critical Hdwy Stg 1 | - | - | | | - | _ | 5.42 | |
| Critical Hdwy Stg 2 | - | - | | | - | - | F 40 | |
| Follow-up Hdwy | 2.218 | - | | | - | - | 3.518 | |
| Pot Cap-1 Maneuver | 1306 | - | | | - | - | 564 | |
| Stage 1 | - | - | | | - | - | 784 | |
| Stage 2 | - | - | | | - | - | 838 | - |
| Platoon blocked, % | | - | | | - | - | | |
| Mov Cap-1 Maneuver | 1306 | - | | | - | - | 561 | 780 |
| Mov Cap-2 Maneuver | - | - | | | - | - | 561 | |
| Stage 1 | - | - | | | - | - | 784 | |
| Stage 2 | - | - | | | - | - | 834 | <u>-</u> |
| | | | | | | | | |
| Approach | EB | | | | WB | | SB | |
| HCM Control Delay, s | 0.3 | | | | 0 | | 9.6 | |
| HCM LOS | 0.0 | | | | | | 7.0 A | |
| HOM EOO | | | | | | | | |
| Minor Lane/Major Mvmt | EBL | EBT | WBT | WBR SE | RI n1 | | | |
| Capacity (veh/h) | 1306 | LDI - | - | - WDIX 3L | 780 | | | |
| HCM Lane V/C Ratio | 0.005 | - | - | | .006 | | | |
| HCM Control Delay (s) | 7.8 | 0 | - | - 0 | 9.6 | | | |
| HCM Lane LOS | 7.0 A | A | - | - | 4.0 A | | | |
| HCM 95th %tile Q(veh) | 0 | - A | - | - | 0 | | | |
| TIGINI 75HT /OHIE Q(VEH) | U | - | - | - | U | | | |

| Intersection | | | | | | | | |
|--------------------------|------------|------|-----|--------|--------|------|--------|-------|
| Int Delay, s/veh | 2.2 | | | | | | | |
| | | | | | | | | |
| Movement | EBL | EBT | | | WBT | WBR | SBL | SBR |
| Vol, veh/h | 45 | 103 | | | 167 | 34 | 17 | 31 |
| Conflicting Peds, #/hr | 0 | 0 | | | 0 | 0 | 0 | 0 |
| Sign Control | Free | Free | | | Free | Free | Stop | Stop |
| RT Channelized | - | None | | | - | None | · - | None |
| Storage Length | - | - | | | - | - | 0 | - |
| Veh in Median Storage, # | <i>+</i> - | 0 | | | 0 | - | 0 | - |
| Grade, % | - | 0 | | | 0 | - | 0 | - |
| Peak Hour Factor | 91 | 91 | | | 91 | 91 | 91 | 91 |
| Heavy Vehicles, % | 2 | 2 | | | 2 | 2 | 2 | 2 |
| Mvmt Flow | 49 | 113 | | | 184 | 37 | 19 | 34 |
| | | | | | | | | |
| Major/Minor | Major1 | | | | Major2 | | Minor2 | |
| Conflicting Flow All | 221 | 0 | | | - | 0 | 414 | 202 |
| Stage 1 | | - | | | - | - | 202 | - |
| Stage 2 | - | - | | | | - | 212 | - |
| Critical Hdwy | 4.12 | - | | | - | - | 6.42 | 6.22 |
| Critical Hdwy Stg 1 | - | - | | | - | - | 5.42 | - |
| Critical Hdwy Stg 2 | - | - | | | - | - | 5.42 | - |
| Follow-up Hdwy | 2.218 | - | | | - | - | 3.518 | 3.318 |
| Pot Cap-1 Maneuver | 1348 | - | | | - | - | 595 | 839 |
| Stage 1 | - | - | | | - | - | 832 | - |
| Stage 2 | - | - | | | - | - | 823 | - |
| Platoon blocked, % | | - | | | - | - | | |
| Mov Cap-1 Maneuver | 1348 | - | | | - | - | 572 | 839 |
| Mov Cap-2 Maneuver | - | - | | | - | - | 572 | - |
| Stage 1 | - | - | | | - | - | 832 | - |
| Stage 2 | - | - | | | - | - | 791 | - |
| | | | | | | | | |
| Approach | EB | | | | WB | | SB | |
| HCM Control Delay, s | 2.4 | | | | 0 | | 10.4 | |
| HCM LOS | | | | | | | В | |
| | | | | | | | | |
| Minor Lane/Major Mvmt | EBL | EBT | WBT | WBR SB | ll n1 | | | |
| Capacity (veh/h) | 1348 | - | - | | 720 | | | |
| HCM Lane V/C Ratio | 0.037 | _ | _ | - 0. | | | | |
| HCM Control Delay (s) | 7.8 | 0 | - | | 10.4 | | | |
| HCM Lane LOS | Α. | A | _ | _ | В | | | |
| HCM 95th %tile Q(veh) | 0.1 | - | _ | _ | 0.2 | | | |
| /511 /5110 (2(1011) | 0.1 | | | | | | | |

| Intersection | | | | | | | |
|--------------------------|--------|----------|------|--------|------|--------|------|
| | 4.9 | | | | | | |
| ini Delay, Siven | 4.7 | | | | | | |
| | | | | | | | |
| Movement | WBL | WBR | | NBT | NBR | SBL | SBT |
| Vol, veh/h | 34 | 196 | | 359 | 46 | 115 | 313 |
| Conflicting Peds, #/hr | 0 | 0 | | 0 | 0 | 0 | 0 |
| Sign Control | Stop | Stop | | Free | Free | Free | Free |
| RT Channelized | - | None | | - | None | - | None |
| Storage Length | 0 | - | | - | - | 0 | - |
| Veh in Median Storage, # | 0 | - | | 0 | - | - | 0 |
| Grade, % | 0 | - | | 0 | - | - | 0 |
| Peak Hour Factor | 93 | 93 | | 93 | 93 | 93 | 93 |
| Heavy Vehicles, % | 2 | 2 | | 2 | 2 | 2 | 2 |
| Mvmt Flow | 37 | 211 | | 386 | 49 | 124 | 337 |
| | | | | | | | |
| Major/Minor | Minor1 | | | Major1 | | Major2 | |
| Conflicting Flow All | 995 | 411 | | 0 | 0 | 435 | 0 |
| Stage 1 | 411 | - | | - | - | - | - |
| Stage 2 | 584 | _ | | | | _ | _ |
| Critical Hdwy | 6.42 | 6.22 | | _ | _ | 4.12 | _ |
| Critical Hdwy Stg 1 | 5.42 | 0.22 | | _ | _ | 7.12 | _ |
| Critical Hdwy Stg 2 | 5.42 | <u>-</u> | | _ | _ | _ | _ |
| Follow-up Hdwy | 3.518 | 3.318 | | _ | _ | 2.218 | _ |
| Pot Cap-1 Maneuver | 271 | 641 | | _ | _ | 1125 | _ |
| Stage 1 | 669 | - | | _ | _ | - | _ |
| Stage 2 | 557 | _ | | _ | _ | _ | _ |
| Platoon blocked, % | 337 | | | _ | _ | | _ |
| Mov Cap-1 Maneuver | 241 | 641 | | _ | _ | 1125 | _ |
| Mov Cap-2 Maneuver | 241 | - | | _ | _ | 1123 | _ |
| Stage 1 | 669 | _ | | _ | _ | _ | _ |
| Stage 2 | 496 | _ | | _ | _ | | _ |
| Olugo Z | 770 | | | | | | |
| | 14/5 | | | | | 0.5 | |
| Approach | WB | | | NB | | SB | |
| HCM Control Delay, s | 18.3 | | | 0 | | 2.3 | |
| HCM LOS | С | | | | | | |
| | | | | | | | |
| Minor Lane/Major Mvmt | NBT | NBRWBLn1 | SBL | SBT | | | |
| Capacity (veh/h) | - | - 515 | 1125 | - | | | |
| HCM Lane V/C Ratio | - | - 0.48 | 0.11 | - | | | |
| HCM Control Delay (s) | - | - 18.3 | 8.6 | - | | | |
| HCM Lane LOS | - | - C | Α | - | | | |
| HCM 95th %tile Q(veh) | - | - 2.6 | 0.4 | - | | | |
| ` ' | | | | | | | |

| Intersection | | | | | | | | |
|---------------------------------------|----------|------|-----|--------|--------|------|--------------|----------|
| Int Delay, s/veh | 0.2 | | | | | | | |
| in Dolay, 5/1011 | U.Z | | | | | | | |
| Movement | EBL | EBT | | | WBT | WBR | SBL | SBR |
| Vol, veh/h | 6 | 163 | | | 231 | 1 1 | 0 | 3DR 4 |
| Conflicting Peds, #/hr | 0 | 0 | | | 0 | 0 | 0 | 0 |
| Sign Control | Free | Free | | | Free | Free | Stop | Stop |
| RT Channelized | - | None | | | - | None | - Jiop | None |
| Storage Length | _ | - | | | _ | - | 0 | - |
| Veh in Median Storage, # | : _ | 0 | | | 0 | _ | 0 | _ |
| Grade, % | | 0 | | | 0 | _ | 0 | _ |
| Peak Hour Factor | 81 | 81 | | | 81 | 81 | 81 | 81 |
| Heavy Vehicles, % | 2 | 2 | | | 2 | 2 | 2 | 2 |
| Mvmt Flow | 7 | 201 | | | 285 | 1 | 0 | 5 |
| | | | | | | | | |
| Major/Minor | Mojor1 | | | | Majora | | Minor | |
| Major/Minor | Major1 | 0 | | | Major2 | 0 | Minor2 | 207 |
| Conflicting Flow All | 286 | 0 | | | - | 0 | 502 | 286 |
| Stage 1 | - | - | | | - | - | 286 | - |
| Stage 2 | 110 | - | | | - | - | 216 | 4 22 |
| Critical Hdwy | 4.12 | - | | | - | - | 6.42 5.42 | 6.22 |
| Critical Hdwy Stg 1 | | - | | | - | - | 5.42 | - |
| Critical Hdwy Stg 2 Follow-up Hdwy | 2.218 | - | | | - | - | 3.518 | 3.318 |
| Pot Cap-1 Maneuver | 1276 | - | | | - | - | 529 | 753 |
| Stage 1 | 1270 | - | | | - | - | 763 | 103 |
| Stage 2 | - | - | | | - | - | 820 | - |
| Platoon blocked, % | <u>-</u> | | | | - | | 020 | - |
| Mov Cap-1 Maneuver | 1276 | - | | | - | - | 526 | 753 |
| Mov Cap-1 Maneuver | 1270 | _ | | | | | 526 | 755 |
| Stage 1 | _ | _ | | | _ | _ | 763 | _ |
| Stage 2 | _ | _ | | | _ | _ | 815 | _ |
| Olugo Z | | | | | | | - 010 | |
| Annroach | - FD | | | | WD | | CD | |
| Approach | EB | | | | WB | | SB | |
| HCM LOS | 0.3 | | | | 0 | | 9.8 | |
| HCM LOS | | | | | | | А | |
| | | | | | | | | |
| Minor Lane/Major Mvmt | EBL | EBT | WBT | WBR SB | | | | |
| Capacity (veh/h) | 1276 | - | - | | 753 | | | |
| HCM Lane V/C Ratio | 0.006 | - | - | - 0. | | | | |
| HCM Control Delay (s) | 7.8 | 0 | - | - | 9.8 | | | |
| HCM Lane LOS | А | Α | - | - | А | | | |
| HCM 95th %tile Q(veh) | 0 | - | - | - | 0 | | | |

| Intersection | | | | | | | | |
|--------------------------------|----------|----------|-----|-----------|----------|--------|---------|--------------|
| Int Delay, s/veh | 2.2 | | | | | | | |
| in Delay, Siven | 2.2 | | | | | | | |
| Mayramant | EDI | ГПТ | | | WDT | WDD | CDI | CDD |
| Movement Val. vah/h | EBL | EBT | | | WBT | WBR | SBL | SBR |
| Vol, veh/h | 50 0 | 114 0 | | | 185 0 | 38 | 19 0 | 34 |
| Conflicting Peds, #/hr | | Free | | | | Free | | |
| Sign Control RT Channelized | Free | None | | | Free | None | Stop | Stop None |
| Storage Length | - | None | | | - | None - | 0 | None |
| Veh in Median Storage, | - # - | 0 | | | 0 | - | 0 | - |
| Grade, % | # - - | 0 | | | 0 | - | 0 | - |
| Peak Hour Factor | 91 | 91 | | | 91 | 91 | 91 | 91 |
| Heavy Vehicles, % | 2 | 2 | | | 2 | 2 | 2 | 2 |
| Mymt Flow | 55 | 125 | | | 203 | 42 | 21 | 37 |
| IVIVIIIL FIOW | 33 | 123 | | | 203 | 42 | ۷1 | 37 |
| | | | | | | | | |
| Major/Minor | Major1 | | | N | 1ajor2 | | Minor2 | |
| Conflicting Flow All | 245 | 0 | | | - | 0 | 459 | 224 |
| Stage 1 | - | - | | | - | - | 224 | - |
| Stage 2 | - | - | | | - | - | 235 | - |
| Critical Hdwy | 4.12 | - | | | - | - | 6.42 | 6.22 |
| Critical Hdwy Stg 1 | - | - | | | - | - | 5.42 | - |
| Critical Hdwy Stg 2 | - | - | | | - | - | 5.42 | - |
| Follow-up Hdwy | 2.218 | - | | | - | - | 3.518 | 3.318 |
| Pot Cap-1 Maneuver | 1321 | - | | | - | - | 560 | 815 |
| Stage 1 | - | - | | | - | - | 813 | - |
| Stage 2 | - | - | | | - | - | 804 | - |
| Platoon blocked, % | | - | | | - | - | | |
| Mov Cap-1 Maneuver | 1321 | - | | | - | - | 535 | 815 |
| Mov Cap-2 Maneuver | - | - | | | - | - | 535 | - |
| Stage 1 | - | - | | | - | - | 813 | - |
| Stage 2 | - | - | | | - | - | 768 | - |
| | | | | | | | | |
| Approach | EB | | | | WB | | SB | |
| HCM Control Delay, s | 2.4 | | | | 0 | | 10.7 | |
| HCM LOS | ۷.٦ | | | | U | | В | |
| TICIVI LOS | | | | | | | D | |
| | | | | | | | | |
| Minor Lane/Major Mvmt | EBL | EBT | WBT | WBR SBLn1 | | | | |
| Capacity (veh/h) | 1321 | - | - | - 686 | | | | |
| HCM Lane V/C Ratio | 0.042 | - | - | - 0.085 | | | | |
| HCM Control Delay (s) | 7.8 | 0 | - | - 10.7 | | | | |
| HCM Lane LOS | А | Α | - | - B | | | | |
| HCM 95th %tile Q(veh) | 0.1 | - | - | - 0.3 | | | | |

| Intersection | | | | | | | |
|--------------------------|--------|----------|-------|--------|------|--------|------|
| | 7.5 | | | | | | |
| ilit Delay, Siveri | | | | | | | |
| | | | | | | 201 | |
| Movement | WBL | WBR | | NBT | NBR | SBL | SBT |
| Vol, veh/h | 39 | 241 | | 359 | 54 | 192 | 313 |
| Conflicting Peds, #/hr | 0 | 0 | | 0 | 0 | 0 | 0 |
| Sign Control | Stop | Stop | | Free | Free | Free | Free |
| RT Channelized | - | None | | - | None | - | None |
| Storage Length | 0 | - | | - | - | 0 | - |
| Veh in Median Storage, # | 0 | - | | 0 | - | - | 0 |
| Grade, % | 0 | - | | 0 | - | - | 0 |
| Peak Hour Factor | 93 | 93 | | 93 | 93 | 93 | 93 |
| Heavy Vehicles, % | 2 | 2 | | 2 | 2 | 2 | 2 |
| Mvmt Flow | 42 | 259 | | 386 | 58 | 206 | 337 |
| | | | | | | | |
| Major/Minor | Minor1 | | | Major1 | | Major2 | |
| Conflicting Flow All | 1164 | 415 | | 0 | 0 | 444 | 0 |
| Stage 1 | 415 | - | | - | - | - | - |
| Stage 2 | 749 | _ | | _ | - | - | - |
| Critical Hdwy | 6.42 | 6.22 | | - | _ | 4.12 | _ |
| Critical Hdwy Stg 1 | 5.42 | - | | _ | - | - | - |
| Critical Hdwy Stg 2 | 5.42 | - | | - | _ | - | _ |
| Follow-up Hdwy | 3.518 | 3.318 | | - | _ | 2.218 | _ |
| Pot Cap-1 Maneuver | 215 | 637 | | - | _ | 1116 | |
| Stage 1 | 666 | - | | - | _ | - | _ |
| Stage 2 | 467 | - | | - | _ | - | - |
| Platoon blocked, % | 741 | | | - | _ | | - |
| Mov Cap-1 Maneuver | 175 | 637 | | - | _ | 1116 | _ |
| Mov Cap-2 Maneuver | 175 | - | | _ | - | - | - |
| Stage 1 | 666 | - | | - | _ | - | _ |
| Stage 2 | 381 | - | | _ | - | _ | _ |
| Jugo Z | | | | | | | |
| Annroach | MD | | | MD | | CD | |
| Approach | WB | | | NB | | SB | |
| HCM Control Delay, s | 25.8 | | | 0 | | 3.4 | |
| HCM LOS | D | | | | | | |
| | | | | | | | |
| Minor Lane/Major Mvmt | NBT | NBRWBLn1 | SBL | SBT | | | |
| Capacity (veh/h) | - | | 1116 | - | | | |
| HCM Lane V/C Ratio | - | - 0.646 | 0.185 | - | | | |
| HCM Control Delay (s) | - | - 25.8 | 9 | - | | | |
| HCM Lane LOS | - | - D | Α | - | | | |
| HCM 95th %tile Q(veh) | - | - 4.5 | 0.7 | - | | | |

| Intersection | | | | | | | | | |
|--------------------------|--------|------|-----|--------|--------|----|-----|------------|-------|
| Int Delay, s/veh | 2.7 | | | | | | | | |
| | | | | | | | | | |
| Movement | EBL | EBT | | | WBT | WE | RR. | SBL | SBR |
| Vol, veh/h | 91 | 163 | | | 231 | | 24 | 14 | 54 |
| Conflicting Peds, #/hr | 0 | 0 | | | (| | 0 | 0 | 0 |
| Sign Control | Free | Free | | | Free | | | Stop | Stop |
| RT Channelized | - | None | | | | No | | - | None |
| Storage Length | _ | - | | | | | - | 0 | - |
| Veh in Median Storage, | # - | 0 | | | (|) | - | 0 | - |
| Grade, % | - | 0 | | | (| | - | 0 | - |
| Peak Hour Factor | 81 | 81 | | | 81 | | 81 | 81 | 81 |
| Heavy Vehicles, % | 2 | 2 | | | 2 | | 2 | 2 | 2 |
| Mvmt Flow | 112 | 201 | | | 285 | | 30 | 17 | 67 |
| | | | | | | | | | |
| Major/Minor | Major1 | | | | Major2 |) | | Minor2 | |
| | | 0 | | | | | 0 | | 200 |
| Conflicting Flow All | 315 | 0 | | | | | 0 | 726 | 300 |
| Stage 1 | - | - | | | · | | - | 300 426 | - |
| Stage 2 Critical Hdwy | 4.12 | - | | | | | - | 6.42 | 6.22 |
| Critical Hdwy Stg 1 | 4.12 | - | | | | | - | 5.42 | 0.22 |
| Critical Hdwy Stg 2 | - | _ | | | | | - | 5.42 | - |
| Follow-up Hdwy | 2.218 | - | | | | | - | 3.518 | 3.318 |
| Pot Cap-1 Maneuver | 1245 | | | | | | _ | 3.310 | 740 |
| Stage 1 | 1245 | | | | | | _ | 752 | 740 |
| Stage 2 | _ | _ | | | | | _ | 659 | |
| Platoon blocked, % | | _ | | | | | _ | 007 | |
| Mov Cap-1 Maneuver | 1245 | _ | | | | | _ | 352 | 740 |
| Mov Cap-2 Maneuver | - | _ | | | | | - | 352 | - |
| Stage 1 | - | - | | | | | - | 752 | |
| Stage 2 | - | - | | | | | - | 592 | - |
| | | | | | | | | | |
| Annroach | - FD | | | | \ | | | CD | |
| Approach | EB | | | | WE | | | SB | |
| HCM Control Delay, s | 2.9 | | | | (|) | | 11.9 | |
| HCM LOS | | | | | | | | В | |
| | | | | | | | | | |
| Minor Lane/Major Mvmt | EBL | EBT | WBT | WBR SB | Ln1 | | | | |
| Capacity (veh/h) | 1245 | - | - | | 603 | | | | |
| HCM Lane V/C Ratio | 0.09 | - | - | - 0. | 139 | | | | |
| HCM Control Delay (s) | 8.2 | 0 | - | - | | | | | |
| HCM Lane LOS | А | Α | - | - | В | | | | |
| HCM 95th %tile Q(veh) | 0.3 | - | - | - | 0.5 | | | | |

| Intersection | | | | | | | | |
|--------------------------|----------|------|-----|---------------|--------|------|--------|----------|
| Int Delay, s/veh | 2.5 | | | | | | | |
| in Delay, Sivell | ۷.J | | | | | | | |
| Marriana | ED: | EDT | | | WDT | MDD | CDI | CDD |
| Movement | EBL | EBT | | | WBT | WBR | SBL | SBR |
| Vol, veh/h | 50 | 127 | | | 208 | 84 | 46 | 34 |
| Conflicting Peds, #/hr | 0 | 0 | | | 0 | 0 | 0 | 0 |
| Sign Control | Free | Free | | | Free | Free | Stop | Stop |
| RT Channelized | - | None | | | - | None | - | None |
| Storage Length | - | - | | | - | - | 0 | - |
| Veh in Median Storage, # | + - | 0 | | | 0 | - | 0 | - |
| Grade, % | - | 0 | | | 0 | - | 0 | - |
| Peak Hour Factor | 91 | 91 | | | 91 | 91 | 91 | 91 |
| Heavy Vehicles, % | 2 | 2 | | | 2 | 2 | 2 | 2 |
| Mvmt Flow | 55 | 140 | | | 229 | 92 | 51 | 37 |
| | | | | | | | | |
| Major/Minor | Major1 | | | N | lajor2 | | Minor2 | |
| Conflicting Flow All | 321 | 0 | | | - | 0 | 524 | 275 |
| Stage 1 | - | - | | | _ | - | 275 | - |
| Stage 2 | _ | _ | | | _ | _ | 249 | - |
| Critical Hdwy | 4.12 | _ | | | _ | _ | 6.42 | 6.22 |
| Critical Hdwy Stg 1 | | _ | | | _ | _ | 5.42 | - |
| Critical Hdwy Stg 2 | _ | _ | | | _ | _ | 5.42 | _ |
| Follow-up Hdwy | 2.218 | _ | | | _ | _ | 3.518 | 3.318 |
| Pot Cap-1 Maneuver | 1239 | _ | | | _ | _ | 514 | 764 |
| Stage 1 | 1237 | _ | | | _ | _ | 771 | 704 |
| Stage 2 | _ | _ | | | _ | _ | 792 | _ |
| Platoon blocked, % | | | | | | _ | 1 / 2 | |
| Mov Cap-1 Maneuver | 1239 | | | | _ | _ | 489 | 764 |
| Mov Cap-2 Maneuver | 1237 | | | | | - | 489 | 704 |
| Stage 1 | - | - | | | - | - | 771 | - |
| Stage 2 | <u>-</u> | - | | | _ | - | 754 | <u>-</u> |
| Jiago Z | - | | | | | | 7.54 | • |
| | | | | | | | | |
| Approach | EB | | | | WB | | SB | |
| HCM Control Delay, s | 2.3 | | | | 0 | | 12.4 | |
| HCM LOS | | | | | | | В | |
| | | | | | | | | |
| Minor Lane/Major Mvmt | EBL | EBT | WBT | WBR SBLn1 | | | | |
| Capacity (veh/h) | 1239 | | - | - 577 | | | | |
| HCM Lane V/C Ratio | 0.044 | _ | _ | - 0.152 | | | | |
| HCM Control Delay (s) | 8 | 0 | _ | - 12.4 | | | | |
| HCM Lane LOS | A | A | - | - 12.4 - B | | | | |
| HCM 95th %tile Q(veh) | 0.1 | - | - | - 0.5 | | | | |
| HOW FULL FORME Q(VEH) | 0.1 | - | - | - 0.5 | | | | |

1: Vanderbilt Rd & Glacier Highway/Existing Geometry in 2029

| Intersection | F 0 | | | | | | |
|--------------------------|--------|----------|-------|--------|------|--------|------|
| Int Delay, s/veh | 5.9 | | | | | | |
| | | | | | | | |
| Movement | WBL | WBR | | NBT | NBR | SBL | SBT |
| Vol, veh/h | 39 | 241 | | 359 | 54 | 192 | 313 |
| Conflicting Peds, #/hr | 0 | 0 | | 0 | 0 | 0 | 0 |
| Sign Control | Stop | Stop | | Free | Free | Free | Free |
| RT Channelized | - | None | | - | None | - | None |
| Storage Length | 0 | - | | - | - | 0 | - |
| Veh in Median Storage, # | 0 | - | | 0 | - | - | 0 |
| Grade, % | 0 | - | | 0 | - | - | 0 |
| Peak Hour Factor | 93 | 93 | | 93 | 93 | 93 | 93 |
| Heavy Vehicles, % | 2 | 2 | | 2 | 2 | 2 | 2 |
| Mvmt Flow | 42 | 259 | | 386 | 58 | 206 | 337 |
| | | | | | | | |
| Major/Minor | Minor1 | | | Major1 | | Major2 | |
| Conflicting Flow All | 1164 | 415 | | 0 | 0 | 444 | 0 |
| Stage 1 | 415 | - | | - | - | - | - |
| Stage 2 | 749 | - | | - | - | - | - |
| Critical Hdwy | 6.42 | 6.22 | | - | - | 4.12 | - |
| Critical Hdwy Stg 1 | 5.42 | - | | - | - | - | - |
| Critical Hdwy Stg 2 | 5.42 | - | | - | - | - | - |
| Follow-up Hdwy | 3.518 | 3.318 | | - | - | 2.218 | - |
| Pot Cap-1 Maneuver | 215 | 637 | | - | - | 1116 | - |
| Stage 1 | 666 | - | | - | - | - | - |
| Stage 2 | 467 | - | | - | - | - | - |
| Platoon blocked, % | | | | - | - | | - |
| Mov Cap-1 Maneuver | 175 | 637 | | - | - | 1116 | - |
| Mov Cap-2 Maneuver | 292 | - | | - | - | - | - |
| Stage 1 | 666 | - | | - | - | - | - |
| Stage 2 | 381 | - | | - | - | - | - |
| | | | | | | | |
| Approach | WB | | | NB | | SB | |
| HCM Control Delay, s | 19.3 | | | 0 | | 3.4 | |
| HCM LOS | С | | | | | | |
| | | | | | | | |
| Minor Lane/Major Mvmt | NBT | NBRWBLn1 | SBL | SBT | | | |
| Capacity (veh/h) | - | - 547 | | - | | | |
| HCM Lane V/C Ratio | - | | 0.185 | - | | | |
| HCM Control Delay (s) | - | - 19.3 | 9 | - | | | |
| HCM Lane LOS | - | - C | A | - | | | |
| HCM 95th %tile Q(veh) | - | - 3.3 | 0.7 | - | | | |
| ` ' | | | | | | | |

Attachment 3
Trip Generation Estimates

| Richland Manor Site Plan (47 SF and 356 MF units) October 2019 | | | | | | | | | | | |
|--|----------|------|-------|---------|------|---------|-------|------|-------|-------|---------|
| | Land Use | | | AM Peak | | PM Peak | | | Daily | | |
| New | Code | Size | X | Enter | Exit | Trips | Enter | Exit | Trips | Trips | Method |
| Single Family Detached Housing | 210 | 47 | Units | 9 | 26 | 35 | 30 | 17 | 47 | 444 | average |
| Residential Condominiums/Townhouses/Apartments | 220 | 356 | Units | 38 | 126 | 164 | 125 | 74 | 199 | 2,606 | average |
| Total Trip Generation | 46 | 153 | 199 | 155 | 91 | 246 | 3.050 | | | | |

Attachment 4
Trip Distribution Observations

Neighborhood Traffic Distribution along Glacier Highway

AM Peak 2006

To/From West 69 57% To/From East 52 43%

122

PM Peak 2006

To/From West 93 56% To/From East 72 44%

165

PM Peak 2019

To/From West 94 62% To/From East 57 38%

151

Study Assumptions Were: Average From Observations Above:

To/From West 55% 58% To/From East 45% 42%

Attachment 5 Turn Lane Warrants per HRR 211

Contents

| VOLUME WARRANTS FOR LEFT-TURN STORAGE LANES AT UNSIGNALIZED GRADE INTERSECTIONS | |
|--|----|
| M.D. Harmelink | 1 |
| A PRACTICAL COMPUTER PROGRAM FOR DESIGNING TRAFFIC-SIGNAL-SYSTEM TIMING PLANS | |
| Robert L. Bleyl | 19 |
| USE OF A COMPUTER AND VEHICLE LOOP DETECTORS TO MEASURE QUEUES AND DELAYS AT SIGNALIZED INTERSECTIONS | |
| A. Christensen | 34 |
| THE EFFECTS OF STREET GEOMETRICS AND SIGNALIZATION ON TRAVEL TIME AND THEIR RELATIONSHIPS TO TRAFFIC OPERATIONS EVALUATION | |
| J. F. Torres | 54 |

Volume Warrants for Left-Turn Storage Lanes At Unsignalized Grade Intersections

M. D. HARMELINK, Project Research Engineer (Traffic), Department of Highways, Ontario

This paper describes the derivation of volume warrants and design charts for left-turn storage lanes at unsignalized grade intersections on four-lane and two-lane highways. The design charts are based on a theoretical analysis and on a series of field studies of traffic behavior at intersections.

The analysis is based on a queuing model in which arrival and service times are assumed to follow a negative exponential distribution. The arrival rates are determined by the volumes of left-turning, through or "advancing," and opposing traffic, and by the time interval required by the left-turning vehicle to clear the advancing lane. The service rates are determined by the volume of opposing traffic, and by the time interval required to make a left-turn maneuver.

Field studies of traffic behavior conducted at seven unsignalized Ontario intersections provided average values of the time interval required by a left-turning vehicle to make a left turn and to clear the advancing lane, the delay experienced by a left-turning vehicle because of opposing traffic, gap acceptance and rejection behavior, and actual arrival rates and headway distributions at various volume levels.

*THIS study was undertaken because of the lack of consistent volume warrants for leftturn storage lanes at unsignalized intersections. The usual method of analyzing such intersections individually on the basis of past experience, accident records, complaints from the traveling public, and engineering judgment has led to inconsistency from location to location.

It was felt that the volume warrants developed should be consistent in their evaluation of traffic parameters from location to location; they should be provide reasonable recommendations for specific intersections; and they should be based on traffic and operational considerations, rather than on a benefit-cost analysis, because of the difficulty of translating the benefits received to a monetary value on a suitable rational basis.

The study contained three phases: a theoretical analysis, a series of field studies of traffic behavior, and analysis of a series of questionnaires completed for specific intersections by Department of Highways regional traffic engineers.


THEORETICAL ANALYSIS

Queuing theory may be used to analyze operational flow problems where the state of the system changes from time to time and which have elements that follow his basic behavior: A sequence of units arrives at some facility which services each unit and eventually discharges it (1). In our problem, a sequence of left-turning vehicles arrives at some intersection that permits each left-turning vehicle to proceed if and when there is a suitable gap in the opposing traffic stream, and then discharges the vehicle from the intersection. Morse (1) explains that instead of trying to predict in detail how the state of the system changes with time, we can calculate the probabilities that the system is in each of the possible states.

Paper sponsored by Committee on Traffic Control Devices.

SMP2021 0004 ATTACHMENT D, Page 33

0



Attachment F - Traffic Impact Analysis